


Lead & Copper Rule Corrosion Control

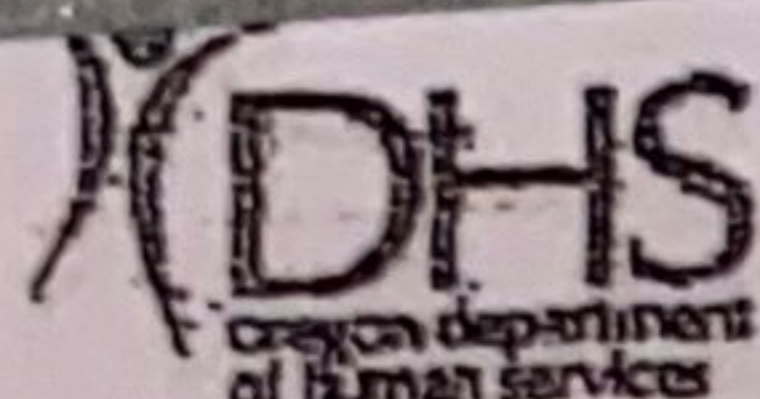

Chlorine

Day	pH	Alk	CaCO ₃	Sili	Y/N
10/12	7.8	1			Y
10/13	7.6	1			Y
10/15	7.7	0.9			Y
10/17	7.8	0.9			Y
10/18	7.8	0.8			Y
10/19	7.8	0.9			Y
10/14	7.7	1			Y
10/16	7.9	1.4			Y
10/18	7.8	1.3			Y
10/20	7.7	1			Y
10/22	7.9	1			Y
10/24	7.8	1.2			Y
10/26	7.8	1.3			Y
10/28	7.9	1.4			Y
10/30	7.9	1.2			Y

<<Have minimums been met for this day?

ENTRY POINT

PWS ID: 41 4

System Name: Albany Trailer Court

Entry Point: Water room

Sample Period: 10/20/24

Month/Year

Number of excursions* during this month: 0

(Count the number of days when any WQP was less than the minimum required)

Total excursions during the previous 5 months: 0

(Over 9 excursions in 6 months is a violation. Entry Point and Distribution excursions are cumulative.)

For DHS use only

Minimum Water Quality Parameters as set by State:

pH	<input type="text" value="7.2"/>	
Alk	<input type="text"/>	(Alkalinity)
PO4	<input type="text"/>	(Orthophosphate)
Sili	<input type="text"/>	(Silicate)

Print Name: Megan M'Gravhey

Signature: Megan M'Gravhey

Date: 10/31/24

(No = N = Excursion) Total N's

Send to DHS within 10 days after end of sampling period