

Lead & Copper Rule Corrosion Control

Day	pH	Alk	Phos	Other	Y/N
1	7.57				Y
2	7.57				Y
3	7.40				Y
4	7.56				Y
5	7.56				Y
6	7.29				Y
7	7.50				Y
8	7.55				Y
9	7.56				Y
10	7.63				Y
11	7.52				Y
12	7.67				Y
13	7.76				Y
14	7.70				Y
15	7.82				Y
16	7.85				Y
17	7.87				Y
18	7.94				Y
19	8.00				Y
20	8.05				Y
21	8.03				Y
22	8.09				Y
23	8.02				Y
24	8.04				Y
25	7.98				Y
26	7.91				Y
27	7.93				Y
28	7.80				Y
29	8.02				Y
30	8.05				Y
31	8.09				Y

(No = N = Excursion) Total N's

0

<<Have minimums
been met for
this day?

ENTRY POINT

PWS ID: 41

0 0 0 7 4

System Name: Bandon, City of

Entry Point: A

Sample Period:

Jan 2025

Month / Year

Number of excursions* during this month: 0

(Count the number of days when any WQP was less
than the minimum required)

Total excursions during the previous 5 months: 0

(Over 9 excursions in 6 months is a violation.
Entry Point and Distribution excursions are

For OHA

Minimum Water Quality Parameters as set by

pH

7.1

ALK

(Alkalinity)

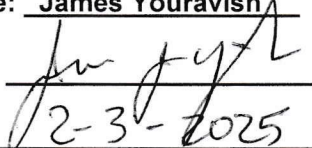
PO4

(Orthophosphate)

Other

()

Print Name: James Youravish

Signature: 

Date: 2-3-2025

Send to DWP with 10 days after end of
sampling period