

Lead & Copper Rule Corrosion Control

Day	pH	Alk	Phos	Other	Y/N
1	7.81				Y
2	7.94				Y
3	8.03				Y
4	8.02				Y
5	7.87				Y
6	7.74				Y
7	7.65				Y
8	7.69				Y
9	7.72				Y
10	7.66				Y
11	7.65				Y
12	7.71				Y
13	7.79				Y
14	7.80				Y
15	7.74				Y
16	7.62				Y
17	7.62				Y
18	7.83				Y
19	8.04				Y
20	8.09				Y
21	8.00				Y
22	7.91				Y
23	7.82				Y
24	7.81				Y
25	7.95				Y
26	8.08				Y
27	8.11				Y
28	8.03				Y
29	7.94				Y
30	7.90				Y
31					
(No = N = Excursion) Total N's					0

<<Have minimums
been met for
this day?

ENTRY POINT

PWS ID: 41

0 0 0 7 4

System Name: Bandon, City of

Entry Point: A

Sample Period: September 2025
Month / Year

Number of excursions* during this month: 0
(Count the number of days when any WQP was less
than the minimum required)

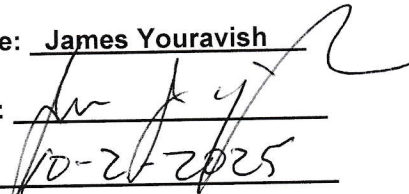
Total excursions during the previous 5 months: 0
(Over 9 excursions in 6 months is a violation.
Entry Point and Distribution excursions are

For OHA

Minimum Water Quality Parameters as set by

pH 7.1
ALK (Alkalinity)
PO4 (Orthophosphate)
Other ()

Print Name: James Youravish

Signature: 

Date: 10-26-2025

Send to DWP with 10 days after end of
sampling period