

## Lead & Copper Rule Corrosion Control

| Day                            | pH   | Alk | Phos | Other | Y/N |
|--------------------------------|------|-----|------|-------|-----|
| 1                              | 7.90 |     |      |       | Y   |
| 2                              | 7.92 |     |      |       | Y   |
| 3                              | 7.87 |     |      |       | Y   |
| 4                              | 7.80 |     |      |       | Y   |
| 5                              | 7.78 |     |      |       | Y   |
| 6                              | 7.78 |     |      |       | Y   |
| 7                              | 7.73 |     |      |       | Y   |
| 8                              | 7.76 |     |      |       | Y   |
| 9                              | 7.81 |     |      |       | Y   |
| 10                             | 7.85 |     |      |       | Y   |
| 11                             | 7.86 |     |      |       | Y   |
| 12                             | 7.89 |     |      |       | Y   |
| 13                             | 7.91 |     |      |       | Y   |
| 14                             | 7.93 |     |      |       | Y   |
| 15                             | 7.91 |     |      |       | Y   |
| 16                             | 7.93 |     |      |       | Y   |
| 17                             | 7.92 |     |      |       | Y   |
| 18                             | 7.91 |     |      |       | Y   |
| 19                             | 7.92 |     |      |       | Y   |
| 20                             | 7.91 |     |      |       | Y   |
| 21                             | 7.85 |     |      |       | Y   |
| 22                             | 7.76 |     |      |       | Y   |
| 23                             | 7.71 |     |      |       | Y   |
| 24                             | 7.70 |     |      |       | Y   |
| 25                             | 7.69 |     |      |       | Y   |
| 26                             | 7.67 |     |      |       | Y   |
| 27                             | 7.63 |     |      |       | Y   |
| 28                             | 7.56 |     |      |       | Y   |
| 29                             | 7.59 |     |      |       | Y   |
| 30                             | 7.65 |     |      |       | Y   |
| 31                             | 7.70 |     |      |       | Y   |
| (No = N = Excursion) Total N's |      |     |      |       | 0   |

<<Have minimums  
been met for  
this day?

### ENTRY POINT

PWS ID: 41

0 0 0 7 4

System Name: Bandon, City of

Entry Point: A

Sample Period: OCT 2025  
Month / Year

Number of excursions\* during this month: 0  
(Count the number of days when any WQP was less  
than the minimum required)

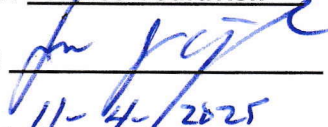
Total excursions during the previous 5 months: 0  
(Over 9 excursions in 6 months is a violation.  
Entry Point and Distribution excursions are

For OHA

Minimum Water Quality  
Parameters as set by

pH 7.1  
ALK            (Alkalinity)  
PO4            (Orthophosphate)  
Other            ( )

Print Name: James Youravish

Signature: 

Date: 11-4-2025

Send to DWP with 10 days after end of  
sampling period