

Lead & Copper Rule Corrosion Control

Day	pH	Alk	Phos	Other	Y/N
1	7.72				Y
2	7.74				Y
3	7.75				Y
4	7.75				Y
5	7.77				Y
6	7.80				Y
7	7.73				Y
8	7.66				Y
9	7.56				Y
10	7.52				Y
11	7.53				Y
12	7.60				Y
13	7.66				Y
14	7.68				Y
15	7.71				Y
16	7.70				Y
17	7.67				Y
18	7.62				Y
19	7.53				Y
20	7.44				Y
21	7.41				Y
22	7.38				Y
23	7.37				Y
24	7.36				Y
25	7.39				Y
26	7.40				Y
27	7.41				Y
28	7.43				Y
29	7.48				Y
30	7.54				Y
31					

(No = N = Excursion) Total N's

0

<<Have minimums
been met for
this day?

ENTRY POINT

PWS ID: 41

0 0 0 7 4

System Name: Bandon, City of

Entry Point: A

Sample Period: Nov 2025
Month / Year

Number of excursions* during this month: 0

(Count the number of days when any WQP was less
than the minimum required)

Total excursions during the previous 5 months: 0

(Over 9 excursions in 6 months is a violation.)

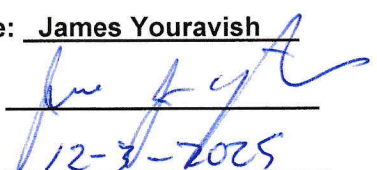
Entry Point and Distribution excursions are

For OHA

Minimum Water Quality Parameters as set by

pH 7.1
ALK (Alkalinity)
PO4 (Orthophosphate)
Other ()

Print Name: James Youravish

Signature: 

Date: 12-3-2025

Send to DWP with 10 days after end of
sampling period