



## Water Quality Parameter Monitoring Form Lead & Copper Rule Corrosion Control

Day	рН	Alk	Phos	Other	Y/N	< <have< th=""></have<>
1						minimums ENTRY POINT
2	7.2	43.4				this day? <b>PWS ID: 41</b> 00523
3						And and a second becaused becaused becaused becaused becaused becaused
4						System Name: Villadom mHP
5						Entry Point: A

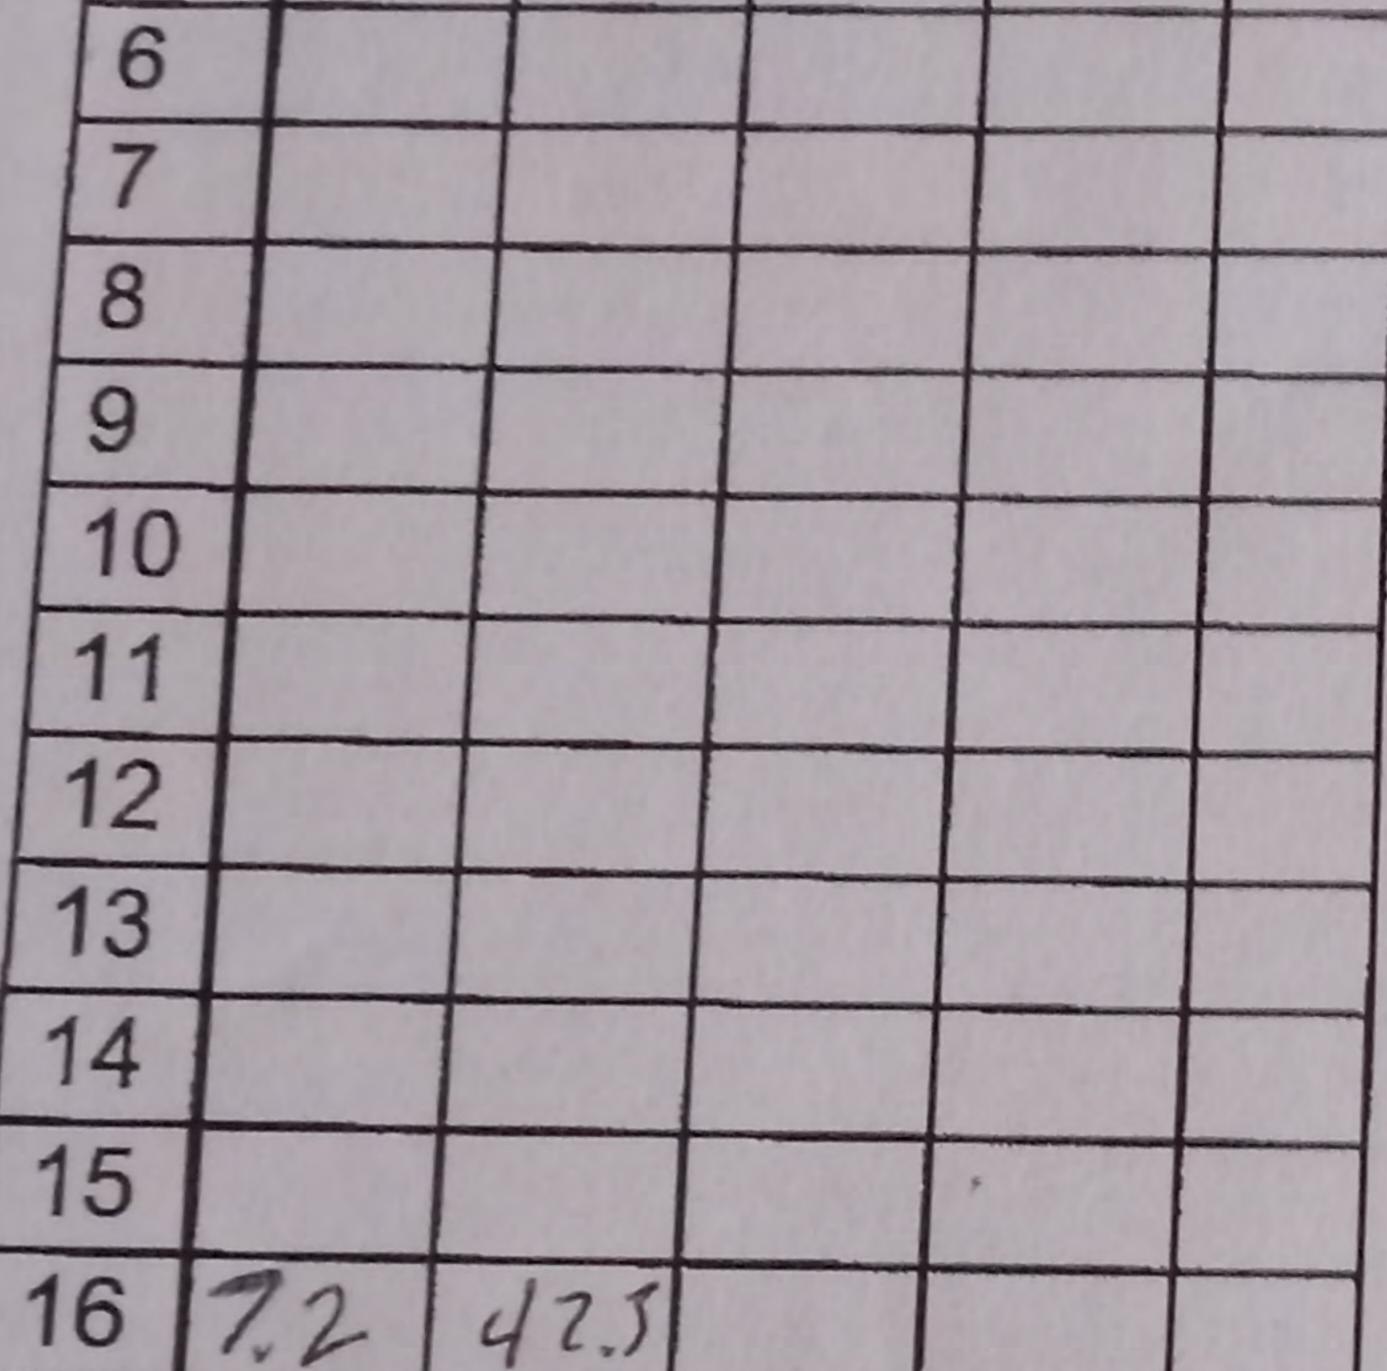

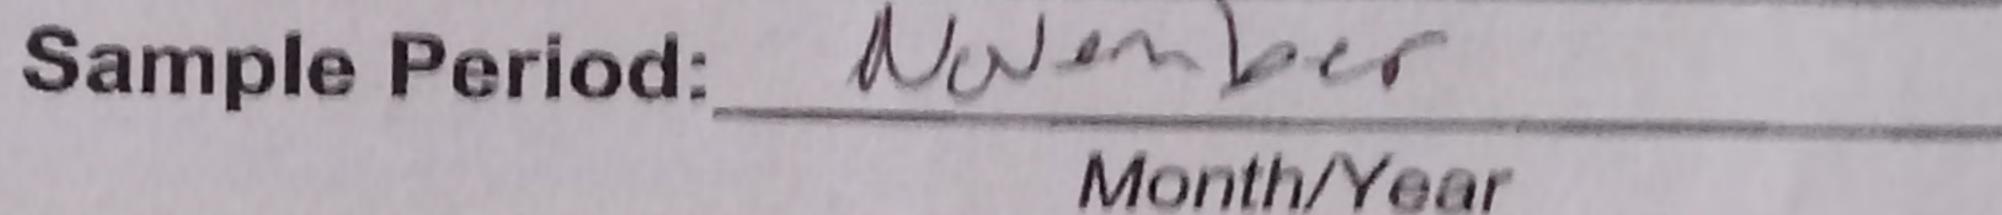


Number of excursions\* during this month:\_\_\_\_\_ (Count the number of days when any WQP was less than the minimum required)


Total excursions during the previous 5 months: (Over 9 excursions in 6 months is a violation. Entry Point and Distribution excursions are cumulative)


For OHA use only

	1 1 -			-			 	
	17							
18		3				1		1
1	19					1		1
	20			T				1
	21	T	T	T		1		1
	22	Ι	T	T		T		1
	23	Ι	T	T				1
	24		T	T	-			1
	25			T				
- 4	26							
1	17			-			 	

## Minimum Water Quality Parameters as set by

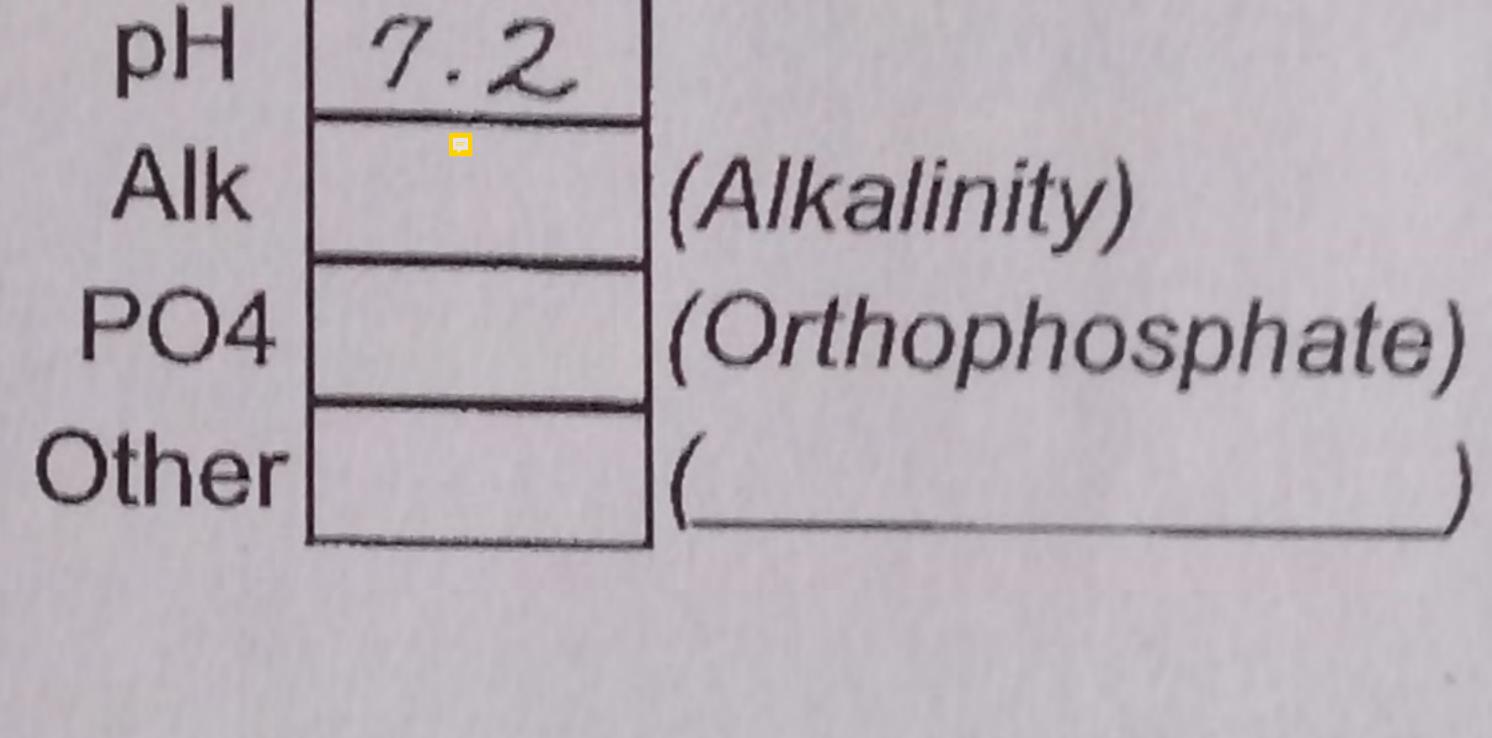

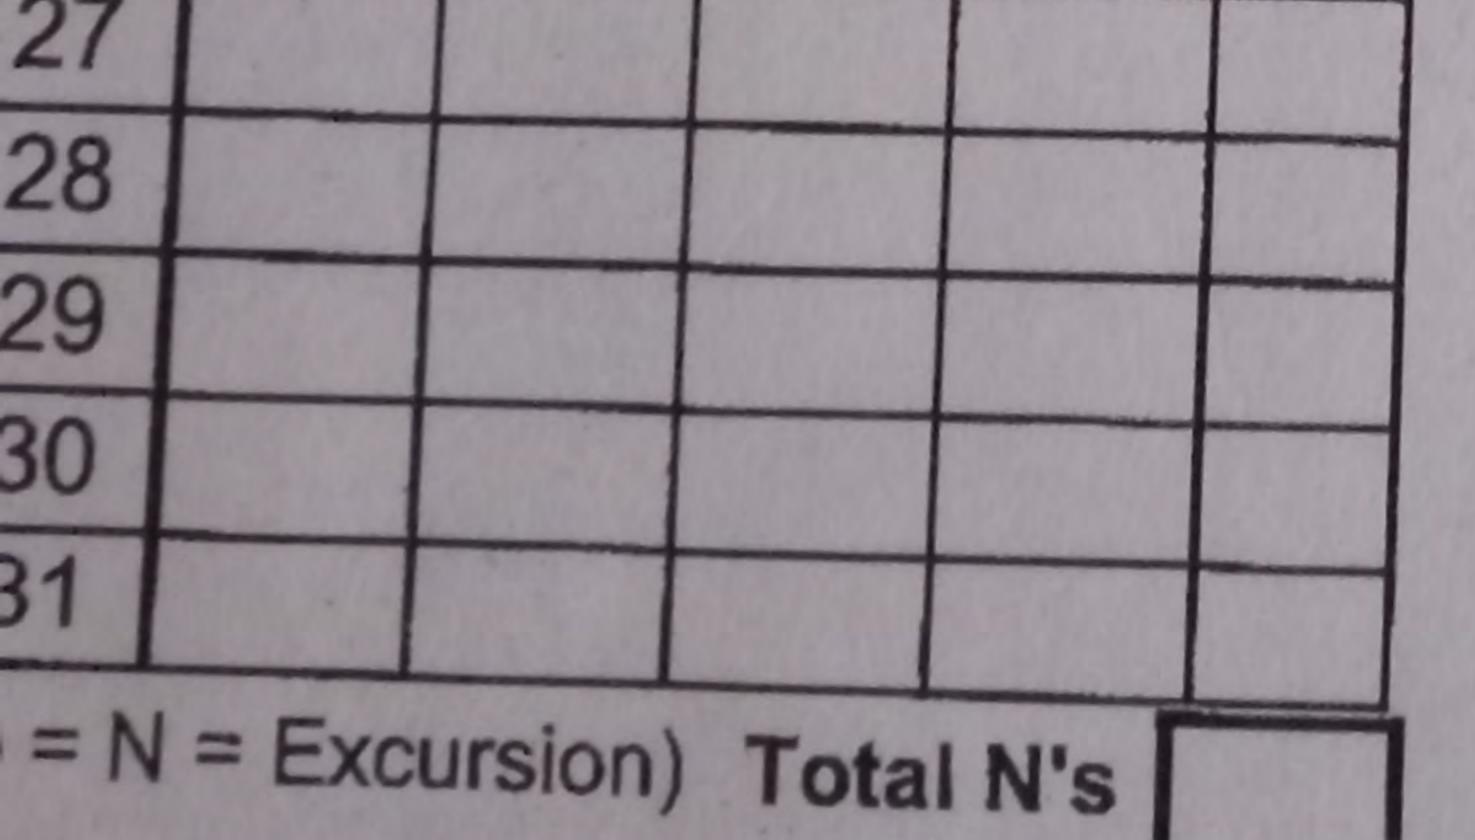

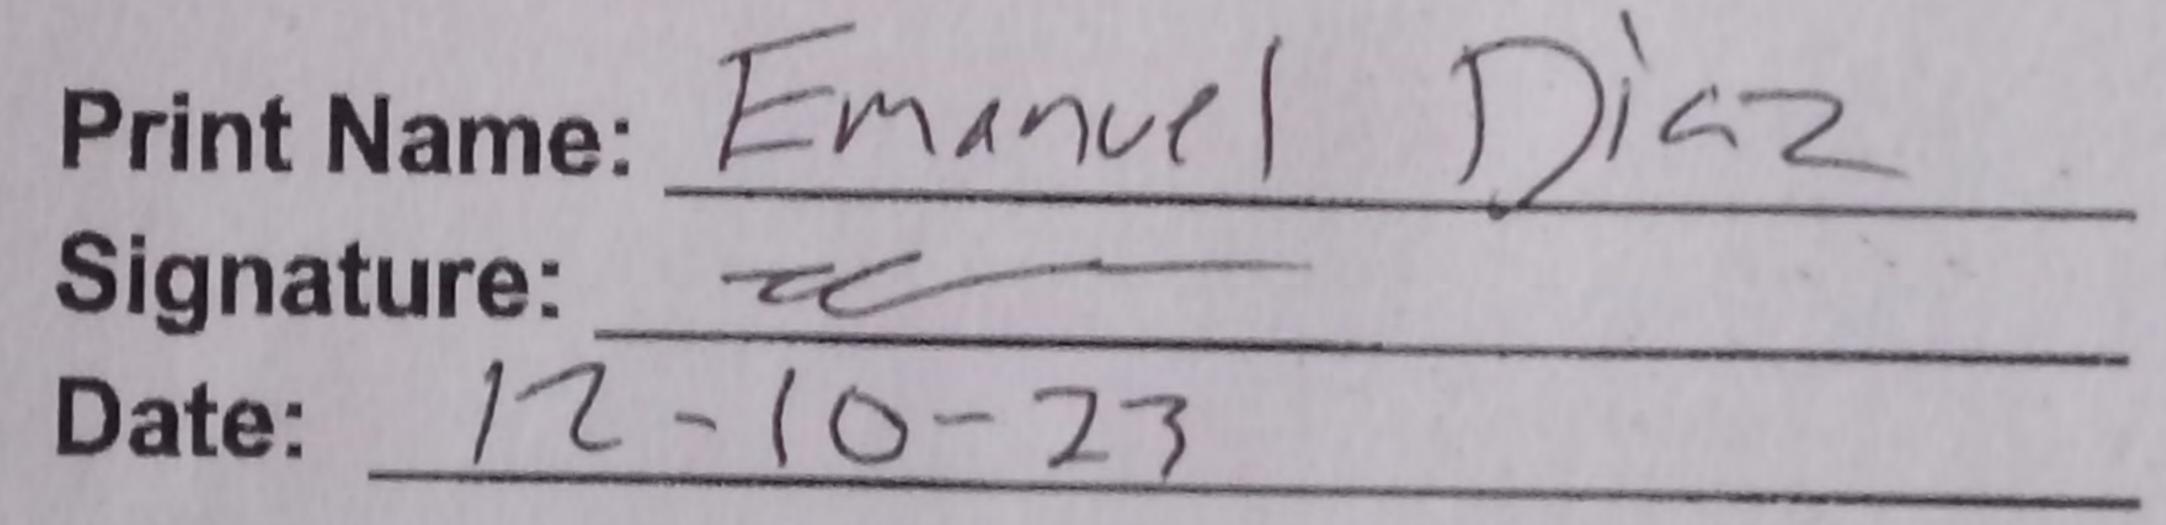

Send to DWP within 10 days after end of sampling period

OHA Drinking Water Program, PO Box 14350, Portland, OR 97293-0350 Phone (971) 673-0405 Website: http://healthoregon.org/dwp/