

Water Quality Parameter Monitoring Form - EP-A and Distribution

**Lead & Copper Rule Corrosion Control**

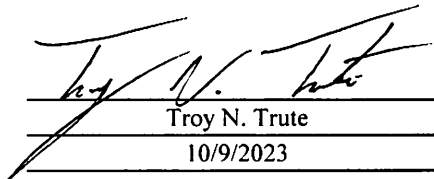
**PWS Name/ID:** Neskowin Reg Water Dist - 4100970  
**Sample Period (Month/Year):** September-23  
**Required Sample Frequency:** Ph Every Day  
**Required Sample Frequency:** Alaklinity 2 Samples Per Month

| Day       | Sample Location                         | pH  | Alk  | PO4 | Other | yes/no |
|-----------|---|-----|------|-----|-------|--------|
| 9/1/2023  | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.4 |     |       | Yes    |
| 9/2/2023  | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/3/2023  | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/4/2023  | 1st User for PH and EP-A for Alkalinity | 7.8 | 26.2 |     |       | Yes    |
| 9/5/2023  | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.0 |     |       | Yes    |
| 9/6/2023  | 1st User for PH and EP-A for Alkalinity | 7.9 | 25.7 |     |       | Yes    |
| 9/7/2023  | 1st User for PH and EP-A for Alkalinity | 7.9 | 25.7 |     |       | Yes    |
| 9/8/2023  | 1st User for PH and EP-A for Alkalinity | 7.9 | 25.8 |     |       | Yes    |
| 9/9/2023  | 1st User for PH and EP-A for Alkalinity | 7.9 |      |     |       | Yes    |
| 9/10/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 |      |     |       | Yes    |
| 9/11/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.1 |     |       | Yes    |
| 9/12/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 25.0 |     |       | Yes    |
| 9/13/2023 | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.6 |     |       | Yes    |
| 9/14/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 25.8 |     |       | Yes    |
| 9/15/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.0 |     |       | Yes    |
| 9/16/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/17/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/18/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 26.4 |     |       | Yes    |
| 9/19/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.4 |     |       | Yes    |
| 9/20/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 26.0 |     |       | Yes    |
| 9/21/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 25.8 |     |       | Yes    |
| 9/22/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 25.8 |     |       | Yes    |
| 9/23/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/24/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
| 9/25/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 25.9 |     |       | Yes    |
| 9/26/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 25.6 |     |       | Yes    |
| 9/27/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 | 25.7 |     |       | Yes    |
| 9/28/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.0 |     |       | Yes    |
| 9/29/2023 | 1st User for PH and EP-A for Alkalinity | 7.9 | 26.2 |     |       | Yes    |
| 9/30/2023 | 1st User for PH and EP-A for Alkalinity | 7.8 |      |     |       | Yes    |
|           |   |     |      |     |       |        |
|           |   |     |      |     |       |        |

Total number of excursions for PH during this monitoring period = 0  
 Total number of excursions for Alkalinity during this monitoring period = 0

Send to [dwp.dmce@state.or.us](mailto:dwp.dmce@state.or.us) within 10 days after end of sampling period

|   |     |
|---|-----|
| For OHA use only:                               |     |
| Minimum Water Quality Parameters as set by: DHS |     |
| pH  | 7.2 |
| Alk   | 23  |

Signature:   
 Print Name: Troy N. Trute  
 Date: 10/9/2023