

Water Quality Parameter Monitoring Form - EP-A and Distribution

**Lead & Copper Rule Corrosion Control**

PWS Name/ID: Neskowin Reg Water Dist - 4100970

Sample Period (Month/Year): June-24

Required Sample Frequency: Ph Every Day

Required Sample Frequency: Alaklinity 2 Samples Per Month

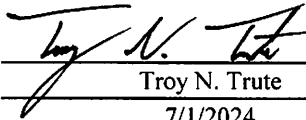
| Day       | Sample Location                         | pH  | Alk  | PO4 | Other | yes/no |
|-----------|---|-----|------|-----|-------|--------|
| 6/1/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/2/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/3/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.0 |     |       | Yes    |
| 6/4/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.2 |     |       | Yes    |
| 6/5/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.5 |     |       | Yes    |
| 6/6/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.2 |     |       | Yes    |
| 6/7/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.8 |     |       | Yes    |
| 6/8/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/9/2024  | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/10/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.8 |     |       | Yes    |
| 6/11/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.8 |     |       | Yes    |
| 6/12/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.6 |     |       | Yes    |
| 6/13/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.0 |     |       | Yes    |
| 6/14/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.5 |     |       | Yes    |
| 6/15/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/16/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/17/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.3 |     |       | Yes    |
| 6/18/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.0 |     |       | Yes    |
| 6/19/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.2 |     |       | Yes    |
| 6/20/2024 | 1st User for PH and EP-A for Alkalinity | 8.2 | 26.4 |     |       | Yes    |
| 6/21/2024 | 1st User for PH and EP-A for Alkalinity | 8.2 | 26.0 |     |       | Yes    |
| 6/22/2024 | 1st User for PH and EP-A for Alkalinity | 8.1 |      |     |       | Yes    |
| 6/23/2024 | 1st User for PH and EP-A for Alkalinity | 8.1 |      |     |       | Yes    |
| 6/24/2024 | 1st User for PH and EP-A for Alkalinity | 8.2 | 26.5 |     |       | Yes    |
| 6/25/2024 | 1st User for PH and EP-A for Alkalinity | 8.2 | 26.8 |     |       | Yes    |
| 6/26/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.2 |     |       | Yes    |
| 6/27/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 26.0 |     |       | Yes    |
| 6/28/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 | 25.8 |     |       | Yes    |
| 6/29/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |
| 6/30/2024 | 1st User for PH and EP-A for Alkalinity | 8.0 |      |     |       | Yes    |

Total number of excursions for PH during this monitoring period = 0

Total number of excursions for Alkalinity during this monitoring period = 0

Send to [dvp.dmce@state.or.us](mailto:dvp.dmce@state.or.us) within 10 days after end of sampling period

|   |     |
|---|-----|
| For OHA use only:                               |     |
| Minimum Water Quality Parameters as set by: DHS |     |
| pH  | 7.2 |
| Alk   | 23  |

Signature: 

Print Name: Troy N. Trute

Date: 7/1/2024