

Water Quality Parameter Monitoring Form - EP-A and Distribution

**Lead & Copper Rule Corrosion Control**

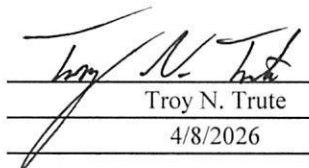
**PWS Name/ID:** Neskowin Reg Water Dist - 4100970  
**Sample Period (Month/Year):** March-26  
**Required Sample Frequency:** Ph Every Day  
**Required Sample Frequency:** Alaklinity 2 Samples Per Month

Day	Sample Location	pH	Alk	PO4	Other	yes/no
3/1/2026	1st User for PH and EP-A for Alkalinity	7.7				Yes
3/2/2026	1st User for PH and EP-A for Alkalinity	7.8	28.0			Yes
3/3/2026	1st User for PH and EP-A for Alkalinity	7.8	26.5			Yes
3/4/2026	1st User for PH and EP-A for Alkalinity	7.8	26.5			Yes
3/5/2026	1st User for PH and EP-A for Alkalinity	7.7	26.8			Yes
3/6/2026	1st User for PH and EP-A for Alkalinity	7.7	27.2			Yes
3/7/2026	1st User for PH and EP-A for Alkalinity	7.7				Yes
3/8/2026	1st User for PH and EP-A for Alkalinity	7.7				Yes
3/9/2026	1st User for PH and EP-A for Alkalinity	7.7	27.0			Yes
3/10/2026	1st User for PH and EP-A for Alkalinity	7.7	27.5			Yes
3/11/2026	1st User for PH and EP-A for Alkalinity	7.8	28.0			Yes
3/12/2026	1st User for PH and EP-A for Alkalinity	7.8	26.8			Yes
3/13/2026	1st User for PH and EP-A for Alkalinity	7.8	27.1			Yes
3/14/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/15/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/16/2026	1st User for PH and EP-A for Alkalinity	7.7	27.9			Yes
3/17/2026	1st User for PH and EP-A for Alkalinity	7.7	26.5			Yes
3/18/2026	1st User for PH and EP-A for Alkalinity	7.7	26.6			Yes
3/19/2026	1st User for PH and EP-A for Alkalinity	7.7	26.8			Yes
3/20/2026	1st User for PH and EP-A for Alkalinity	7.8	27.0			Yes
3/21/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/22/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/23/2026	1st User for PH and EP-A for Alkalinity	7.8	27.2			Yes
3/24/2026	1st User for PH and EP-A for Alkalinity	7.8	27.2			Yes
3/25/2026	1st User for PH and EP-A for Alkalinity	7.8	26.5			Yes
3/26/2026	1st User for PH and EP-A for Alkalinity	7.8	26.8			Yes
3/27/2026	1st User for PH and EP-A for Alkalinity	7.8	26.3			Yes
3/28/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/29/2026	1st User for PH and EP-A for Alkalinity	7.8				Yes
3/30/2026	1st User for PH and EP-A for Alkalinity	7.8	26.5			Yes
3/31/2026	1st User for PH and EP-A for Alkalinity	7.8	26.8			Yes

Total number of excursions for PH during this monitoring period = 0  
 Total number of excursions for Alkalinity during this monitoring period = 0

Send to [dvp.dmce@state.or.us](mailto:dvp.dmce@state.or.us) within 10 days after end of sampling period

For OHA use only:	
Minimum Water Quality	
Parameters as set by: DHS	
pH	7.2
Alk	23

Signature:   
 Print Name: Troy N. Trute  
 Date: 4/8/2026