

Water Quality Parameter Monitoring Form - EP-A and Distribution

**Lead & Copper Rule Corrosion Control**

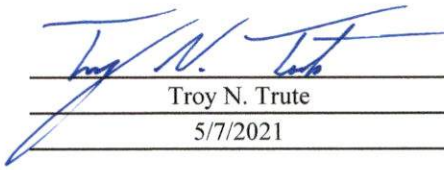
**PWS Name/ID:** Neskowin Reg Water Dist - 4100970  
**Sample Period (Month/Year):** April-21  
**Required Sample Frequency:** Ph Every Day  
**Required Sample Frequency:** Alaklinity 2 Samples Per Month

Day	Sample Location	pH	Alk	PO4	Other	yes/no
4/1/2021	1st User for PH and EP-A for Alkalinity	7.7	44			Yes
4/2/2021	1st User for PH and EP-A for Alkalinity	7.6	38			Yes
4/3/2021	1st User for PH and EP-A for Alkalinity	7.6				Yes
4/4/2021	1st User for PH and EP-A for Alkalinity	7.6				Yes
4/5/2021	1st User for PH and EP-A for Alkalinity	7.7	44			Yes
4/6/2021	1st User for PH and EP-A for Alkalinity	7.7	38			Yes
4/7/2021	1st User for PH and EP-A for Alkalinity	7.7	38			Yes
4/8/2021	1st User for PH and EP-A for Alkalinity	7.9	40			Yes
4/9/2021	1st User for PH and EP-A for Alkalinity	7.8	44			Yes
4/10/2021	1st User for PH and EP-A for Alkalinity	7.7				Yes
4/11/2021	1st User for PH and EP-A for Alkalinity	7.8				Yes
4/12/2021	1st User for PH and EP-A for Alkalinity	7.7	42			Yes
4/13/2021	1st User for PH and EP-A for Alkalinity	7.8	40			Yes
4/14/2021	1st User for PH and EP-A for Alkalinity	7.7	42			Yes
4/15/2021	1st User for PH and EP-A for Alkalinity	7.7	40			Yes
4/16/2021	1st User for PH and EP-A for Alkalinity	7.6	40			Yes
4/17/2021	1st User for PH and EP-A for Alkalinity	7.7				Yes
4/18/2021	1st User for PH and EP-A for Alkalinity	7.7				Yes
4/19/2021	1st User for PH and EP-A for Alkalinity	7.6	42			Yes
4/20/2021	1st User for PH and EP-A for Alkalinity	7.6	44			Yes
4/21/2021	1st User for PH and EP-A for Alkalinity	7.7	42			Yes
4/22/2021	1st User for PH and EP-A for Alkalinity	7.8	46			Yes
4/23/2021	1st User for PH and EP-A for Alkalinity	7.8	44			Yes
4/24/2021	1st User for PH and EP-A for Alkalinity	7.9				Yes
4/25/2021	1st User for PH and EP-A for Alkalinity	7.9				Yes
4/26/2021	1st User for PH and EP-A for Alkalinity	7.7	44			Yes
4/27/2021	1st User for PH and EP-A for Alkalinity	7.6	40			Yes
4/28/2021	1st User for PH and EP-A for Alkalinity	7.7	40			Yes
4/29/2021	1st User for PH and EP-A for Alkalinity	7.7	44			Yes
4/30/2021	1st User for PH and EP-A for Alkalinity	7.8	46			Yes

Total number of excursions for PH during this monitoring period = 0  
 Total number of excursions for Alkalinity during this monitoring period = 0

Send to [dwp.dmce@state.or.us](mailto:dwp.dmce@state.or.us) within 10 days after end of sampling period

For OHA use only:	
Minimum Water Quality Parameters as set by: DHS	
pH	7.2
Alk	23

Signature:   
 Print Name: Troy N. Trute  
 Date: 5/7/2021