

Water Quality Parameter Monitoring Form - EP-A and Distribution

Lead & Copper Rule Corrosion Control

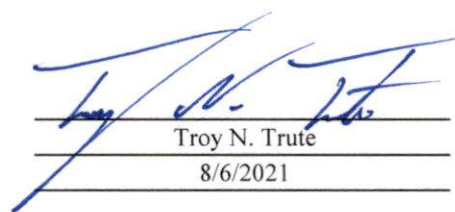
PWS Name/ID: Neskowin Reg Water Dist - 4100970
Sample Period (Month/Year): July-21
Required Sample Frequency: Ph Every Day
Required Sample Frequency: Alaklinity 2 Samples Per Month

Day	Sample Location	pH	Alk	PO4	Other	yes/no
7/1/2021	1st User for PH and EP-A for Alkalinity	7.9	24.5			Yes
7/2/2021	1st User for PH and EP-A for Alkalinity	7.9	24.0			Yes
7/3/2021	1st User for PH and EP-A for Alkalinity	7.8				Yes
7/4/2021	1st User for PH and EP-A for Alkalinity	7.9				Yes
7/5/2021	1st User for PH and EP-A for Alkalinity	7.9	26.3			Yes
7/6/2021	1st User for PH and EP-A for Alkalinity	8.0	24.2			Yes
7/7/2021	1st User for PH and EP-A for Alkalinity	8.0	24.5			Yes
7/8/2021	1st User for PH and EP-A for Alkalinity	7.9	24.0			Yes
7/9/2021	1st User for PH and EP-A for Alkalinity	8.1	24.0			Yes
7/10/2021	1st User for PH and EP-A for Alkalinity	7.7				Yes
7/11/2021	1st User for PH and EP-A for Alkalinity	7.8				Yes
7/12/2021	1st User for PH and EP-A for Alkalinity	7.9	25.1			Yes
7/13/2021	1st User for PH and EP-A for Alkalinity	7.7	25.1			Yes
7/14/2021	1st User for PH and EP-A for Alkalinity	7.8	24.8			Yes
7/15/2021	1st User for PH and EP-A for Alkalinity	8.0	24.3			Yes
7/16/2021	1st User for PH and EP-A for Alkalinity	7.8	24.0			Yes
7/17/2021	1st User for PH and EP-A for Alkalinity	7.8				Yes
7/18/2021	1st User for PH and EP-A for Alkalinity	7.8				Yes
7/19/2021	1st User for PH and EP-A for Alkalinity	7.8	24.9			Yes
7/20/2021	1st User for PH and EP-A for Alkalinity	7.8	25.0			Yes
7/21/2021	1st User for PH and EP-A for Alkalinity	7.7	25.7			Yes
7/22/2021	1st User for PH and EP-A for Alkalinity	7.7	25.1			Yes
7/23/2021	1st User for PH and EP-A for Alkalinity	7.4	25.6			Yes
7/24/2021	1st User for PH and EP-A for Alkalinity	8.3				Yes
7/25/2021	1st User for PH and EP-A for Alkalinity	8.2				Yes
7/26/2021	1st User for PH and EP-A for Alkalinity	7.6	25.3			Yes
7/27/2021	1st User for PH and EP-A for Alkalinity	7.6	24.3			Yes
7/28/2021	1st User for PH and EP-A for Alkalinity	7.4	24.6			Yes
7/29/2021	1st User for PH and EP-A for Alkalinity	7.3	24.6			Yes
7/30/2021	1st User for PH and EP-A for Alkalinity	7.4	25.2			Yes
7/31/2021	1st User for PH and EP-A for Alkalinity	7.5				Yes

Total number of excursions for PH during this monitoring period = 0
 Total number of excursions for Alkalinity during this monitoring period = 0

Send to dwp.dmce@state.or.us within 10 days after end of sampling period

For OHA use only:	
Minimum Water Quality Parameters as set by: DHS	
pH	7.2
Alk	23

Signature: 
 Print Name: Troy N. Trute
 Date: 8/6/2021