

Lake Oswego - Tigard Water Supply, PWS 4101542

Water Quality Parameter Monitoring Form
Lead and Copper Corrosion Control

Surface Water Quality Data - POE Alkalinity and pH Report

City of Lake Oswego - Water Treatment Plant

Report Month: February 2022

State Minimum = 7.2 pH


Date	Average Finished pH	Average Finished Alkalinity	Standard Met ?
02/01/2022	7.81	23.0	Yes
02/02/2022	7.87	23.5	Yes
02/03/2022	7.90	22.5	Yes
02/04/2022	7.83	23.0	Yes
02/05/2022	7.84	23.5	Yes
02/06/2022	7.80	22.5	Yes
02/07/2022	7.80	22.5	Yes
02/08/2022	7.80	23.0	Yes
02/09/2022	7.77	23.0	Yes
02/10/2022	7.85	24.0	Yes
02/11/2022	7.86	23.5	Yes
02/12/2022	7.80	24.5	Yes
02/13/2022	7.81	22.5	Yes
02/14/2022	7.83	23.0	Yes
02/15/2022	7.82	23.0	Yes
02/16/2022	7.89	23.5	Yes
02/17/2022	7.91	23.0	Yes
02/18/2022	7.92	23.0	Yes
02/19/2022	7.89	22.3	Yes
02/20/2022	7.77	22.0	Yes
02/21/2022	7.86	22.0	Yes
02/22/2022	7.87	22.5	Yes
02/23/2022	7.83	22.0	Yes
02/24/2022	7.81	21.5	Yes
02/25/2022	7.86	23.0	Yes
02/26/2022	7.89	22.5	Yes
02/27/2022	7.79	22.5	Yes
02/28/2022	7.75	22.5	Yes

Number of excursions this month = 0
 Number of excursions last 5 months = 0

Is System in Compliance?

Y/N

Supervisor's Signature

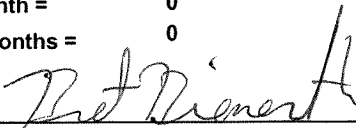

Print Name

Bret Bienerth

Certification #:

08749

Phone (503) 635-0394

03-Mar-22