

Lake Oswego - Tigard Water Supply, PWS 4101542

Water Quality Parameter Monitoring Form
Lead and Copper Corrosion Control

Surface Water Quality Data - POE Alkalinity and pH Report

City of Lake Oswego - Water Treatment Plant

Report Month: March 2022

State Minimum = 7.2 pH


Date	Average Finished pH	Average Finished Alkalinity	Standard Met ?
03/01/2022	7.81	22.5	Yes
03/02/2022	7.85	17.5	Yes
03/03/2022	7.87	18.0	Yes
03/04/2022	7.84	18.0	Yes
03/05/2022	7.82	18.0	Yes
03/06/2022	7.80	18.5	Yes
03/07/2022	7.82	19.5	Yes
03/08/2022	7.88	21.0	Yes
03/09/2022	7.87	21.0	Yes
03/10/2022	7.85	22.0	Yes
03/11/2022	7.82	21.3	Yes
03/12/2022	7.87	22.5	Yes
03/13/2022	7.93	22.0	Yes
03/14/2022	7.89	22.0	Yes
03/15/2022	7.90	22.0	Yes
03/16/2022	7.87	22.0	Yes
03/17/2022	7.90	22.0	Yes
03/18/2022	7.95	22.5	Yes
03/19/2022	7.86	22.5	Yes
03/20/2022	7.89	21.5	Yes
03/21/2022	7.87	20.5	Yes
03/22/2022	7.83	20.0	Yes
03/23/2022	7.83	21.0	Yes
03/24/2022	7.98	21.0	Yes
03/25/2022	7.88	20.5	Yes
03/26/2022	7.89	20.5	Yes
03/27/2022	7.79	20.5	Yes
03/28/2022	7.88	21.0	Yes
03/29/2022	7.86	21.5	Yes
03/30/2022	7.81	20.0	Yes
03/31/2022	7.86	21.0	Yes

Number of excursions this month = 0
 Number of excursions last 5 months = 0

Is System in Compliance?

Y/N

Supervisor's Signature

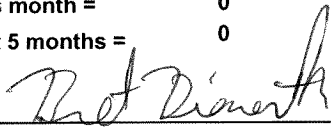

Print Name

Bret Bienerth

Certification #:

08749

Phone (503) 635-0394

04-Apr-22