

State of Oregon Drinking Water Program  
**Monthly Disinfection Report for Ground Water Systems**

System Name Casey's Riverside RV Park

PWS ID# 41 01007

Month/Year FEB/2021

Entry Point SRC-AC

Required Minimum Residual .72 mg/L

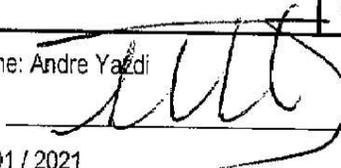
Date	Time	Source(s) in use	Lowest free chlorine residual at entry point to distribution system (mg/L)	Notes
1	10:40	Pavilion	1.3	
2	11:32	Pool	1.3	
3	7:05	House	1.4	
4	12:36	#56	1.5	
5	9:12	Clubhouse	1.5	
6	11:22	Pavilion	1.4	
7	12:00	Pool	1.3	
8	6:55	House	1.3	
9	10:38	#56	1.3	
10	11:50	Clubhouse	1.3	
11	12:45	Pavilion	1.3	
12	12:05	Pool	1.4	
13	6:50	House	1.4	
14	11:42	#56	1.5	
15	11:05	Clubhouse	1.5	
16	10:11	Pavilion	1.5	
17	11:05	Pool	1.5	
18	7:10	House	1.6	
19	9:44	#56	1.6	
20	10:30	Clubhouse	1.6	
21	1:15	Pavilion	1.6	
22	11:20	Pool	1.6	
23	6:30	House	1.6	
24	12:00	#56	1.6	
25	11:33	Clubhouse	1.6	
26	2:45	Pavilion	1.5	
27	10:40	Pool	1.5	
28	7:20	House	1.5	
29		#56		
30		Clubhouse		
31		Pavilion		

Was the chlorine residual ever less than the required minimum residual of \_\_\_\_\_ mg/L?  Yes  No  
 If yes, what was the longest time period until the required level was restored? \_\_\_\_\_ hours - If > 4 hours, Drinking Water Program to be notified by end of next business day.

**GWS Serving 3,300 or Fewer**  
 If yes, did you monitor every four hours until the residual returned to \_\_\_\_\_ mg/L as required?  Yes  No  
 Attach those results and submit them with this form.

**GWS Serving More Than 3,300**  
 Did continuous monitoring equipment fail at any time this reporting month?  Yes  No  
 If yes, were grab samples collected every four hours until the continuous monitoring equipment was returned to service as required?  Yes  No  
 Attach grab sample results and submit them with this form.

Date continuous monitoring equipment failed: / /  
 Date it was returned to service: / /

Printed Name: Andre Yazdi  
 Signature:   
 Date: 03/01/2021

Title: Owner/Operator  
 Phone #: (541) 782-1906  
 Operator Certification #: \_\_\_\_\_  
 OR  
 Small Groundwater System