

OHA - Drinking Water Services -Turbidity Monitoring Report Form
Conventional or Direct Filtration

County: **Benton**
 Month/Year: **Mar-25**

System Name:		Adair Village		1-00003		WTP : TP -	
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1							
2							
3			0.08	0.07	0.07		0.08
4							
5			0.08	0.08	0.07		0.08
6							
7			0.07	0.06	0.06		0.07
8							
9							
10			0.07	0.07	0.07		0.07
11							
12			0.06	0.07	0.07		0.07
13							
14			0.08	0.08	0.08		0.07
15							
16							
17			0.09	0.09	0.09		0.09
18							
19			0.09	0.09	0.08		0.09
20							
21			0.08	0.09	0.08		0.09
22							
23							
24			0.10	0.09	0.09		0.10
25							
26			0.08	0.08	0.08		0.08
27							
28			0.08	0.07	0.07		0.08
29							
30							
31			0.09	0.08	0.08		0.09

Conventional or Direct Filtration		Monthly Summary (Answer Yes or No)	
95% of 4-hour turbidity readings $\leq$ 0.3 NTU?	<u>Yes</u> / No	CT's met everyday? (see back)	All Cl ₂ residual at entry point $\geq$ 0.2 mg/l?
All 4-hour turbidity readings $\leq$ 1 NTU?	<u>Yes</u> / No	<u>Yes</u> / No	<u>Yes</u> / No
All turbidity readings < IFE ² triggers	<u>Yes</u> / No		
Notes:		PRINTED NAME: Matt Lydon Revised 4/17/25	
		SIGNATURE: <i>Matt Lydon</i> DATE: 4/9/25	
		503-302-4317 CERT #:8763	

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² IFE = Indiv. Filter Effl. (333-061-0040(1)(d)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP - :

System Name:

Adair Village

ID#: 41 00003

Month/Year:

25-Mar

**Disinfection *Giardia*
Log Inactive:**

1


Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1								
2								
3	1.14	74	84.4	11.3	7.44	42.0	YES	672
4								
5	1.17	74	86.6	11.1	7.42	42.4	YES	668
6								
7	1.23	74	91.0	11.4	7.44	42.1	YES	667
8	↑ <i>corrected</i>							
9								
10	1.09	74	80.7	11.2	7.45	42.2	YES	664
11								
12	1.07	74	79.2	11.4	7.44	41.4	YES	647
13								
14	1.18	74	87.3	11.4	7.42	41.6	YES	654
15								
16								
17	1.04	74	77.0	11.7	7.33	38.9	YES	674
18								
19	1.15	74	85.1	11.5	7.37	40.5	YES	654
20								
21	1.08	74	79.9	11.9	7.47	40.5	YES	641
22								
23								
24	1.04	74	77.0	11.8	7.42	39.9	YES	657
25								
26	1.19	74	88.1	12.1	7.48	40.6	YES	655
27								
28	1.25	74	92.5	12.3	7.42	39.5	YES	638
29								
30								
31	1.07	74	79.2	12.4	7.44	38.8	YES	655

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018

Return by 10th of following month by email, fax, or mail to:

dpw.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350

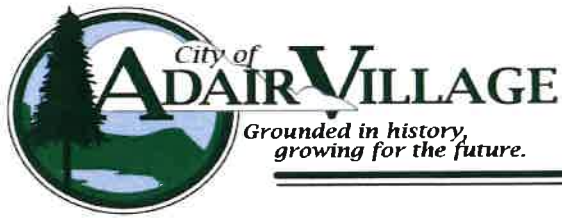

6030 William R. Carr Ave.
Adair Village, OR 97330
541-745-5507
Fax: 541-230-5219

April 17, 2025

RE: Revised April MOR for the City of Adair Village.

To whom it may concern,

Here is the revised and corrected April MOR for the City of Adair Village. The MOR sent on April 9th had a key stroke mistake generating a violation. The day in question on the report is March 7th 2025. The minimum Cl2 for the day was entered as .123 mg/L. The correct entry was 1.23 mg/L. The correction has been made and it is now resubmitted and should correct any violation. If there are any question, please reach out to myself or City administrator Pat Hare.

Sincerely,

Matt Lydon

Assistant City Administrator/ Public Works Supervisor

DRC 8763

Cc:

DWP.DMCE@odhsoha.oregon.gov

SHAWN.P.STEVENSON@oha.oregon.gov

Pat.hare@adairvillage.org