

OHA - Drink Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

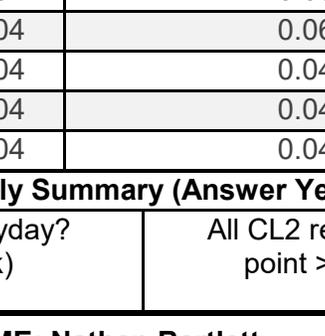
County: CLATSOP
Month/Year: Dec, 2025

System Name: City of Astoria

ID#: 41-00055

WTP: WTP-A

| Day | 12 AM [NTU] | 4 AM [NTU] | 8 AM [NTU] | NOON [NTU] | 4 PM [NTU] | 8 PM [NTU] | Highest Reading of the Day (1) [NTU] |
|-----|-------------|------------|------------|------------|------------|------------|--------------------------------------|
| 01 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 02 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 03 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 05 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 06 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 07 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 08 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 09 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 10 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 11 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 12 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 13 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 14 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 15 | 0.04 | 0.04 | 0.04 | 0.04 | 0.05 | 0.05 | 0.05 |
| 16 | 0.05 | 0.05 | 0.04 | 0.04 | 0.04 | 0.05 | 0.05 |
| 17 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 |
| 18 | 0.05 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.05 |
| 19 | 0.04 | 0.05 | 0.05 | 0.05 | 0.04 | 0.04 | 0.05 |
| 20 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 21 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 22 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.05 |
| 23 | 0.04 | 0.04 | 0.04 | 0.04 | 0.05 | 0.05 | 0.05 |
| 24 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 |
| 25 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 |
| 26 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 |
| 27 | 0.05 | 0.05 | 0.05 | 0.04 | 0.04 | 0.04 | 0.05 |
| 28 | 0.04 | 0.04 | 0.04 | 0.05 | 0.05 | 0.04 | 0.06 |
| 29 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 30 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |
| 31 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 | 0.04 |

| | | |
|--|---|---|
| Slow Sand / Membrane / DE Filtration / Unfiltered | Monthly Summary (Answer Yes or No) | |
| 95% of daily turbidity readings =< 1 NTU? YES | CT's met everyday? (see back) YES | All CL2 residual at entry point >= 0.2 mg/L? YES |
| All daily turbidity readings =< 5 NTU? YES | | |
| Notes: | PRINTED NAME: Nathan Bartlett | |
| | SIGNATURE:  | DATE: 1/6/2026 |
| | PHONE #: (503)325-3524 | CERT: T-08872 |

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP : WTP-A

System Name: City of Astoria ID#: 41-00055 Month/Year: Dec,2025 Disinfection Giardia Log Inactiv: 1.0

| Date / Time | Minimum CL2 Residual at 1st User (C) | Contact Time (T) | Actual CT C X T | Temp [Celsius} | pH | Required CT formula | CT Met Yes / No | Peak Hourly Demand Flow [GPM] |
|-------------|---|---------------------|--------------------|-------------------|------|------------------------|--------------------|----------------------------------|
| 01 / 5:13 | 1.6 | 121 | 193 | 8.7 | 7.12 | 47 | YES | 1557 |
| 02 / 8:53 | 1.49 | 146 | 217 | 8.76 | 7.1 | 46 | YES | 1288 |
| 03 / 19:14 | 1.53 | 146 | 223 | 8.72 | 7.1 | 46 | YES | 1291 |
| 04 / 15:33 | 1.48 | 142 | 210 | 8.56 | 7.1 | 46 | YES | 1324 |
| 05 / 10:29 | 1.51 | 138 | 209 | 8.62 | 7.1 | 46 | YES | 1360 |
| 06 / 6:09 | 1.56 | 184 | 286 | 9.09 | 7.08 | 45 | YES | 1024 |
| 07 / 23:43 | 1.64 | 184 | 301 | 9.41 | 7.07 | 44 | YES | 1024 |
| 08 / 5:42 | 1.61 | 183 | 295 | 9.48 | 7.07 | 44 | YES | 1025 |
| 09 / 9:03 | 1.61 | 137 | 221 | 9.9 | 7.04 | 42 | YES | 1372 |
| 10 / 5:49 | 1.55 | 137 | 212 | 10.1 | 7.04 | 41 | YES | 1376 |
| 11 / 12:32 | 1.61 | 121 | 195 | 10.4 | 7 | 40 | YES | 1550 |
| 12 / 9:48 | 1.72 | 132 | 227 | 10.38 | 7.03 | 41 | YES | 1424 |
| 13 / 8:22 | 1.72 | 132 | 226 | 10.19 | 7.04 | 42 | YES | 1429 |
| 14 / 4:55 | 1.72 | 132 | 226 | 10.08 | 7.02 | 42 | YES | 1429 |
| 15 / 17:59 | 1.69 | 127 | 214 | 10.1 | 7.01 | 42 | YES | 1485 |
| 16 / 0:43 | 1.32 | 127 | 168 | 10.58 | 7.03 | 39 | YES | 1475 |
| 17 / 8:55 | 1.51 | 137 | 207 | 10.3 | 7.07 | 41 | YES | 1371 |
| 18 / 23:41 | 1.55 | 137 | 212 | 9.76 | 7.04 | 42 | YES | 1373 |
| 19 / 2:21 | 1.58 | 136 | 216 | 9.52 | 7.02 | 43 | YES | 1378 |
| 20 / 23:22 | 1.62 | 137 | 222 | 9.07 | 7.04 | 45 | YES | 1374 |
| 21 / 22:14 | 1.61 | 137 | 220 | 8.86 | 7.05 | 45 | YES | 1374 |
| 22 / 9:13 | 1.62 | 137 | 221 | 8.57 | 7.05 | 46 | YES | 1376 |
| 23 / 23:17 | 1.63 | 99 | 161 | 8.36 | 7.07 | 47 | YES | 1900 |
| 24 / 4:17 | 1.57 | 99 | 155 | 8.41 | 7.1 | 47 | YES | 1901 |
| 25 / 22:10 | 1.6 | 97 | 156 | 8.24 | 7.12 | 48 | YES | 1931 |
| 26 / 10:10 | 1.49 | 93 | 138 | 7.97 | 7.17 | 49 | YES | 2024 |
| 27 / 20:46 | 1.81 | 98 | 178 | 7.88 | 7.14 | 51 | YES | 1913 |
| 28 / 2:19 | 1.86 | 99 | 184 | 7.55 | 7.15 | 53 | YES | 1904 |
| 29 / 3:44 | 1.5 | 99 | 148 | 7.51 | 7.21 | 52 | YES | 1900 |
| 30 / 10:14 | 1.5 | 109 | 164 | 7.38 | 7.2 | 52 | YES | 1724 |
| 31 / 7:56 | 0.91 | 109 | 99 | 7.29 | 7.26 | 50 | YES | 1727 |

If CL2 at entry point < 0.2 mg/L or CT not met, notify DWS within 24 hours.