

OHA - Drink Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

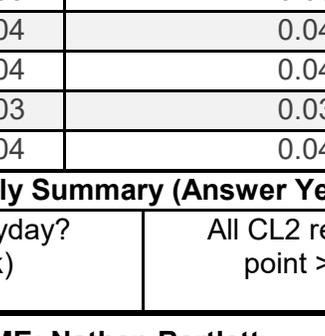
County: CLATSOP
Month/Year: Jan, 2026

System Name: City of Astoria

ID#: 41-00055

WTP: WTP-A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day (1) [NTU]
01	0.04	0.04	0.04	0.04	0.04	0.04	0.05
02	0.04	0.04	0.04	0.04	0.04	0.04	0.04
03	0.04	0.04	0.04	0.04	0.04	0.04	0.04
04	0.04	0.04	0.04	0.04	0.04	0.04	0.04
05	0.04	0.04	0.04	0.04	0.04	0.04	0.04
06	0.04	0.04	0.04	0.04	0.04	0.04	0.04
07	0.04	0.04	0.04	0.04	0.04	0.04	0.04
08	0.04	0.04	0.04	0.04	0.04	0.04	0.04
09	0.04	0.04	0.04	0.04	0.04	0.04	0.04
10	0.04	0.04	0.04	0.04	0.04	0.04	0.04
11	0.04	0.04	0.04	0.04	0.04	0.04	0.04
12	0.04	0.04	0.04	0.04	0.04	0.04	0.04
13	0.04	0.04	0.04	0.04	0.04	0.04	0.06
14	0.04	0.04	0.04	0.04	0.04	0.04	0.04
15	0.04	0.04	0.04	0.04	0.04	0.04	0.04
16	0.04	0.04	0.04	0.04	0.04	0.04	0.04
17	0.04	0.04	0.04	0.04	0.04	0.04	0.04
18	0.04	0.04	0.04	0.04	0.04	0.04	0.04
19	0.04	0.04	0.03	0.03	0.04	0.04	0.04
20	0.04	0.03	0.03	0.03	0.04	0.04	0.04
21	0.04	0.03	0.03	0.03	0.03	0.04	0.04
22	0.03	0.03	0.03	0.03	0.03	0.03	0.03
23	0.03	0.03	0.03	0.03	0.03	0.03	0.03
24	0.03	0.03	0.03	0.03	0.03	0.03	0.03
25	0.03	0.03	0.03	0.03	0.03	0.03	0.03
26	0.03	0.03	0.03	0.03	0.03	0.04	0.05
27	0.04	0.06	0.03	0.03	0.03	0.03	0.08
28	0.03	0.03	0.03	0.03	0.03	0.04	0.04
29	0.03	0.03	0.03	0.03	0.03	0.04	0.04
30	0.03	0.03	0.03	0.03	0.03	0.03	0.03
31	0.03	0.03	0.03	0.03	0.04	0.04	0.04

Slow Sand / Membrane / DE Filtration / Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings =< 1 NTU? YES		CT's met everyday? (see back) YES	All CL2 residual at entry point >= 0.2 mg/L? YES
All daily turbidity readings =< 5 NTU? YES			
Notes:		PRINTED NAME: Nathan Bartlett	
		SIGNATURE: 	DATE: 2/10/2026
		PHONE #: (503)325-3524	CERT: T-08872

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP : WTP-A

System Name: City of Astoria ID#: 41-00055 Month/Year: Jan,2026 Disinfection Giardia Log Inactiv: 1.0

Date / Time	Minimum CL2 Residual at 1st User (C)	Contact Time (T)	Actual CT C X T	Temp [Celsius}	pH	Required CT formula	CT Met Yes / No	Peak Hourly Demand Flow [GPM]
01 / 7:03	0.99	109	108	7.43	7.29	51	YES	1725
02 / 16:48	1.71	109	186	7.71	7.18	52	YES	1727
03 / 22:39	1.76	82	144	8.12	7.17	51	YES	2291
04 / 9:18	1.67	82	137	8.46	7.16	49	YES	2292
05 / 1:00	1.39	81	113	8.08	7.22	49	YES	2308
06 / 2:55	1.4	83	116	7.74	7.2	50	YES	2276
07 / 9:42	1.81	82	149	7.57	7.21	53	YES	2286
08 / 18:23	1.78	89	159	7.23	7.22	55	YES	2107
09 / 1:42	1.74	90	157	7.33	7.24	55	YES	2079
10 / 1:05	1.62	98	159	7.49	7.25	53	YES	1915
11 / 4:59	1.48	121	179	7.67	7.24	52	YES	1553
12 / 23:00	1.47	142	209	7.93	7.23	51	YES	1324
13 / 19:03	1.71	128	218	8.53	7.18	49	YES	1472
14 / 11:07	1.63	125	204	8.4	7.22	50	YES	1503
15 / 9:29	1.63	118	192	8.33	7.25	51	YES	1594
16 / 0:36	1.76	120	212	8.11	7.28	53	YES	1562
17 / 12:36	1.76	121	212	7.93	7.29	53	YES	1558
18 / 10:31	1.77	120	213	7.79	7.29	54	YES	1562
19 / 0:24	1.78	121	215	7.68	7.31	55	YES	1557
20 / 0:48	1.68	121	203	7.58	7.33	55	YES	1559
21 / 9:42	1.69	120	203	7.36	7.35	56	YES	1564
22 / 5:23	1.69	120	202	7.02	7.33	57	YES	1571
23 / 11:15	1.23	121	148	7.12	7.37	55	YES	1560
24 / 7:38	1.8	142	256	6.64	7.33	59	YES	1322
25 / 3:15	1.75	142	249	6.32	7.35	61	YES	1321
26 / 15:04	1.75	142	249	6.41	7.38	61	YES	1323
27 / 3:36	1.73	145	252	6.62	7.37	60	YES	1293
28 / 22:38	1.73	143	247	6.96	7.37	58	YES	1315
29 / 1:28	1.71	149	255	7.39	7.38	57	YES	1260
30 / 23:59	1.71	143	244	8	7.37	54	YES	1318
31 / 18:18	1.66	146	242	8.24	7.37	53	YES	1291

If CL2 at entry point < 0.2 mg/L or CT not met, notify DWS within 24 hours.