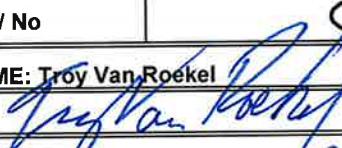


OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

| | |
|-------------|---------------|
| County: | Washington |
| Month/Year: | November/2024 |

| System Name: | Banks Water Department | | ID#: | | 41 | 00076 | WTP : TP - A |
|--------------|------------------------|---------------|---------------|---------------|---------------|---------------|------------------------------------|
| Day | 12 AM [NTU] | 4 AM [NTU] | 8 AM [NTU] | NOON [NTU] | 4 PM [NTU] | 8 PM [NTU] | Highest Reading of the day 1 [NTU] |
| 1 | 0.04 | 0.05 | 0.04 | 0.04 | 0.04 | 0.05 | 0.05 |
| 2 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 3 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 4 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 5 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 6 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.04 | 0.07 |
| 7 | 0.05 | 0.07 | 0.05 | 0.05 | 0.04 | 0.05 | 0.07 |
| 8 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.04 | 0.19 |
| 9 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.09 |
| 10 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.08 |
| 11 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 12 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 13 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 |
| 14 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 15 | 0.07 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 16 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.04 | 0.13 |
| 17 | 0.05 | 0.05 | 0.05 | 0.05 | 0.04 | 0.05 | 0.07 |
| 18 | 0.05 | 0.05 | 0.05 | 0.05 | 0.04 | 0.05 | 0.06 |
| 19 | 0.05 | 0.05 | 0.05 | 0.05 | 0.04 | 0.05 | 0.05 |
| 20 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 21 | 0.07 | 0.07 | 0.07 | 0.07 | 0.07 | 0.05 | 0.07 |
| 22 | 0.07 | 0.07 | 0.07 | 0.05 | 0.05 | 0.05 | 0.07 |
| 23 | 0.05 | 0.07 | 0.07 | 0.07 | 0.07 | 0.05 | 0.12 |
| 24 | 0.07 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.08 |
| 25 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 26 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 27 | 0.05 | 0.07 | 0.05 | 0.05 | 0.05 | 0.05 | 0.07 |
| 28 | 0.05 | 0.05 | 0.05 | 0.05 | 0.05 | 0.04 | 0.07 |
| 29 | 0.05 | 0.05 | 0.05 | 0.04 | 0.05 | 0.04 | 0.06 |
| 30 | 0.05 | 0.05 | 0.05 | 0.04 | 0.04 | 0.04 | 0.09 |
| 31 | | | | | | | |

| | | | | |
|--|---|---|---|--|
| Slow Sand/Membrane/DE Filtration/Unfiltered | | Monthly Summary (Answer Yes or No) | | |
| 95% of daily turbidity readings ≤ 1 NTU? 2 | <input checked="" type="radio"/> Yes <input type="radio"/> No | CT's met everyday? (see back) | All Cl ₂ residual at entry point ≥ 0.2 mg/l? | |
| All daily turbidity readings ≤ 5 NTU? | <input checked="" type="radio"/> Yes <input type="radio"/> No | <input checked="" type="radio"/> Yes / No | <input checked="" type="radio"/> Yes / No | |
| Notes: | | PRINTED NAME: Troy Van Roekel | | |
| | | SIGNATURE:  | DATE: 12-4-24 | |
| | | PHONE #: 503-809-1649 | T-9282 D-3805 | |

1 Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not

correspond to continuous readings' maximum. 2 Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :

A

Disinfection Giardia Log

Inactiv:

1.0

System Name: Banks Water Department ID#: 41 00076 Month/Year:

| Date / Time | Minimum Cl2 Residual at 1st User (C) 3 | Contact Time (T) | Actual CT | Temp | pH | Required CT | CT Met? 3 | Peak Hourly Demand Flow |
|-------------|--|------------------|-----------|-------|------|-------------|-----------|-------------------------|
| | [ppm or mg/L] | [minutes] | C X T | [° C] | | formula | Yes / No | [GPM] |
| 1 | 0.73 | 201 | 146.7 | 10.83 | 7.46 | 41.3 | YES | 104 |
| 2 | 0.69 | 201 | 138.7 | 10.67 | 7.46 | 41.6 | YES | 106 |
| 3 | 0.65 | 201 | 130.7 | 10.72 | 7.44 | 41.0 | YES | 109 |
| 4 | 0.65 | 201 | 130.7 | 10.72 | 7.42 | 40.7 | YES | 111 |
| 5 | 0.67 | 201 | 134.7 | 10.61 | 7.42 | 41.0 | YES | 111 |
| 6 | 0.72 | 201 | 144.7 | 10.00 | 7.43 | 43.1 | YES | 110 |
| 7 | 0.77 | 201 | 154.8 | 9.78 | 7.44 | 44.2 | YES | 106 |
| 8 | 0.81 | 201 | 162.8 | 9.94 | 7.45 | 44.1 | YES | 106 |
| 9 | 0.84 | 201 | 168.8 | 10.17 | 7.45 | 43.6 | YES | 105 |
| 10 | 0.83 | 201 | 166.8 | 10.22 | 7.46 | 43.5 | YES | 104 |
| 11 | 0.86 | 201 | 172.9 | 10.56 | 7.44 | 42.4 | YES | 108 |
| 12 | 0.85 | 201 | 170.9 | 10.39 | 7.43 | 42.7 | YES | 108 |
| 13 | 0.79 | 201 | 158.8 | 10.33 | 7.45 | 42.9 | YES | 113 |
| 14 | 0.71 | 201 | 142.7 | 10.44 | 7.42 | 41.7 | YES | 113 |
| 15 | 0.62 | 201 | 124.6 | 9.61 | 7.43 | 43.8 | YES | 110 |
| 16 | 0.60 | 201 | 120.6 | 8.83 | 7.46 | 46.5 | YES | 114 |
| 17 | 0.79 | 201 | 158.8 | 9.22 | 7.37 | 44.8 | YES | 110 |
| 18 | 0.83 | 201 | 166.8 | 8.44 | 7.28 | 45.8 | YES | 110 |
| 19 | 0.84 | 201 | 168.8 | 7.72 | 7.32 | 48.8 | YES | 106 |
| 20 | 0.85 | 201 | 170.9 | 8.06 | 7.32 | 47.8 | YES | 111 |
| 21 | 0.82 | 201 | 164.8 | 8.39 | 7.41 | 48.2 | YES | 111 |
| 22 | 0.82 | 201 | 164.8 | 8.94 | 7.37 | 45.8 | YES | 112 |
| 23 | 0.91 | 201 | 182.9 | 8.94 | 7.35 | 45.9 | YES | 119 |
| 24 | 0.92 | 201 | 184.9 | 8.72 | 7.34 | 46.5 | YES | 117 |
| 25 | 0.89 | 201 | 178.9 | 8.89 | 7.34 | 45.8 | YES | 113 |
| 26 | 0.89 | 201 | 178.9 | 8.61 | 7.34 | 46.6 | YES | 115 |
| 27 | 0.89 | 201 | 178.9 | 8.56 | 7.34 | 46.8 | YES | 118 |
| 28 | 0.92 | 201 | 184.9 | 8.00 | 7.34 | 48.7 | YES | 99 |
| 29 | 0.99 | 201 | 199.0 | 7.89 | 7.34 | 49.5 | YES | 112 |
| 30 | 1.07 | 201 | 215.1 | 7.72 | 7.34 | 50.5 | YES | 110 |
| 31 | | | | | | | | |

3 If Cl2 at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised November 2022

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@oha.oregon.gov; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350