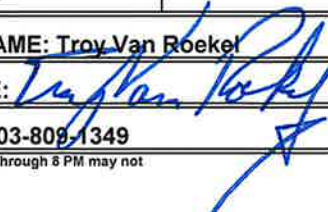


OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: **Washington**
 Month/Year: **February/2025**

System Name: Banks Water Department		ID#: 41 00076		WTP : TP - A			
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day 1 [NTU]
1	0.13	0.13	0.15	0.15	0.13	0.15	0.19
2	0.15	0.16	0.16	0.15	0.15	0.15	0.16
3	0.15	0.16	0.16	0.15	0.13	0.13	0.17
4	0.15	0.16	0.15	0.13	0.13	0.13	0.16
5	0.13	0.16	0.15	0.15	0.13	0.13	0.16
6	0.13	0.14	0.13	0.13	0.13	0.13	0.15
7	0.13	0.16	0.16	0.13	0.13	0.13	0.16
8	0.13	0.15	0.15	0.15	0.13	0.13	0.16
9	0.13	0.15	0.15	0.13	0.13	0.13	0.19
10	0.15	0.15	0.15	0.13	0.13	0.13	0.16
11	0.13	0.15	0.15	0.13	0.13	0.12	0.16
12	0.13	0.15	0.15	0.13	0.13	0.13	0.16
13	0.13	0.15	0.15	0.13	0.13	0.13	0.15
14	0.13	0.13	0.13	0.13	0.12	0.13	0.13
15	0.13	0.15	0.13	0.13	0.13	0.13	0.15
16	0.13	0.13	0.13	0.13	0.13	0.13	0.15
17	0.13	0.15	0.15	0.15	0.15	0.15	0.15
18	0.15	0.16	0.15	0.15	0.15	0.15	0.2
19	0.15	0.16	0.16	0.15	0.15	0.15	0.2
20	0.15	0.16	0.16	0.16	0.15	0.15	0.17
21	0.16	0.16	0.16	0.16	0.16	0.15	0.17
22	0.16	0.16	0.16	0.15	0.15	0.15	0.17
23	0.16	0.16	0.16	0.16	0.16	0.16	0.16
24	0.16	0.16	0.16	0.17	0.17	0.19	0.23
25	0.23	0.32	0.39	0.46	0.54	0.61	0.69
26	0.69	0.73	0.71	0.73	0.74	0.74	0.75
27	0.76	0.68	0.54	0.49	0.46	0.42	0.76
28	0.42	0.4	0.34	0.31	0.28	0.23	0.43
29							
30							
31							

Slow Sand/Membrane/DE Filtration/Unfiltered 95% of daily turbidity readings ≤ 1 NTU? 2 ☒ Yes ☐ No All daily turbidity readings ≤ 5 NTU? ☒ Yes ☐ No		Monthly Summary (Answer Yes or No) CT's met everyday? (see back) ☒ Yes ☐ No All Cl2 residual at entry point ≥ 0.2 mg/l? ☒ Yes ☐ No	
Notes: 		PRINTED NAME: Troy Van Roekel	
		SIGNATURE: 	
		DATE: 3-4-2025	
		PHONE #: 503-809-1349	
		T-9282 D-3805	

1 Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not

correspond to continuous readings' maximum. 2 Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form
WTP- :
A
System Name: Banks Water Department ID#: 41 00076 Month/Year:

Disinfection Giardia Log
Inactiv:
1.0

Date / Time	Minimum Cl ₂ Residual at 1st User (C) 3	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? 3	Peak Hourly Demand Flow
	[ppm or mg/l]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.04	201	209.0	5.89	7.58	62.0	YES	110
2	1.01	201	203.0	5.72	7.58	62.5	YES	109
3	0.99	201	199.0	5.50	7.58	63.2	YES	105
4	0.99	201	199.0	5.39	7.6	64.2	YES	107
5	1.01	201	203.0	4.61	7.58	67.2	YES	108
6	1.03	201	207.0	5.17	7.62	65.9	YES	109
7	1.00	201	201.0	5.06	7.61	65.9	YES	114
8	1.00	201	201.0	5.50	7.6	63.8	YES	103
9	1.00	201	201.0	5.89	7.61	62.4	YES	105
10	1.00	201	201.0	5.39	7.61	64.5	YES	103
11	1.01	201	203.0	4.33	7.62	69.5	YES	104
12	1.01	201	203.0	4.06	7.66	71.8	YES	103
13	1.01	201	203.0	3.89	7.64	72.0	YES	107
14	1.02	201	205.0	3.89	7.68	73.2	YES	105
15	1.04	201	209.0	3.61	7.67	74.4	YES	106
16	1.04	201	209.0	4.06	7.65	71.7	YES	109
17	1.02	201	205.0	5.28	7.62	65.3	YES	110
18	0.99	201	199.0	6.06	7.61	61.6	YES	104
19	1.03	201	207.0	7.06	7.61	58.0	YES	113
20	1.01	201	203.0	7.39	7.61	56.6	YES	103
21	1.01	201	203.0	7.72	7.6	55.2	YES	104
22	1.01	201	203.0	8.17	7.56	52.8	YES	104
23	1.05	201	211.1	9.50	7.57	48.7	YES	103
24	0.98	201	197.0	9.17	7.58	49.6	YES	142
25	0.83	201	166.8	9.11	7.58	49.0	YES	139
26	0.88	201	176.9	8.50	7.55	50.7	YES	141
27	0.88	201	176.9	8.44	7.46	49.2	YES	137
28	0.99	201	199.0	8.61	7.37	47.7	YES	134
29								
30								
31								

 3 If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised November 2022

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@oha.oregon.gov; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350