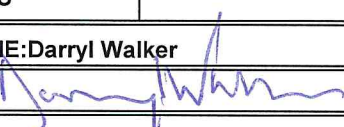


OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: Clatsop
Month/Year: Jul-25

System Name: City of Cannon Beach **ID#:** 41 -00164 **WTP :** TP - A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1			0.09				0.09
2			0.08				0.08
3			0.08				0.08
4			0.08				0.08
5			0.08				0.08
6			0.08				0.08
7			0.08				0.08
8			0.08				0.08
9			0.08				0.08
10			0.10				0.10
11			0.07				0.07
12			0.08				0.08
13			0.08				0.08
14			0.07				0.07
15			0.07				0.07
16			0.08				0.08
17			0.10				0.10
18			0.08				0.08
19			0.08				0.08
20			0.09				0.09
21			0.08				0.08
22			0.09				0.09
23			0.09				0.09
24			0.09				0.09
25			0.09				0.09
26			0.09				0.09
27			0.09				0.09
28			0.10				0.10
29			0.10				0.10
30			0.10				0.10
31			0.13				0.13

		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ²	YES	CT's met everyday? (see back)	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	YES	YES	YES
Notes:		PRINTED NAME: Darryl Walker	
		SIGNATURE: 	8/4/2025
		PHONE #: (503) 436-8082	CERT #: 6936

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :A

System Name: City of Cannon Beach ID#: 41-00164

Month/Year: Jul-25

Disinfection *Giardia* Log

Inactiv:

1.0

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.5	336	168.0	13.0	7.09	30.4	YES	516
2	0.53	312	165.4	13.0	7.08	30.4	YES	636
3	0.51	312	159.1	13.0	7.10	30.6	YES	520
4	0.5	301	150.5	13.0	7.08	30.3	YES	555
5	0.5	312	156.0	13.0	7.09	30.4	YES	558
6	0.52	324	168.5	13.0	7.09	30.5	YES	584
7	0.52	312	162.2	13.0	7.10	30.6	YES	549
8	0.5	324	162.0	13.0	7.10	30.5	YES	500
9	0.48	336	161.3	13.0	7.10	30.4	YES	607
10	0.5	336	168.0	13.0	7.11	30.6	YES	526
11	0.48	324	155.5	13.0	7.10	30.4	YES	513
12	0.48	312	149.8	13.0	7.10	30.4	YES	546
13	0.48	312	149.8	14.0	7.10	28.5	YES	546
14	0.46	301	138.5	14.0	7.10	28.4	YES	562
15	0.48	312	149.8	14.0	7.11	28.6	YES	542
16	0.48	291	139.7	14.0	7.11	28.6	YES	533
17	0.48	312	149.8	14.0	7.10	28.5	YES	562
18	0.5	324	162.0	14.0	7.11	28.7	YES	584
19	0.23	324	74.5	14.0	7.12	27.9	YES	555
20	0.28	324	90.7	14.0	7.15	28.4	YES	581
21	0.34	324	110.2	14.0	7.11	28.1	YES	614
22	0.43	336	144.5	14.0	7.11	28.4	YES	546
23	0.46	336	154.6	13.0	7.07	30.0	YES	571
24	0.48	336	161.3	14.0	7.09	28.4	YES	536
25	0.5	324	162.0	14.0	7.08	28.3	YES	549
26	0.46	336	154.6	14.0	7.09	28.3	YES	584
27	0.5	336	168.0	14.0	7.09	28.4	YES	565
28	0.5	349	174.5	14.0	7.10	28.5	YES	604
29	0.46	364	167.4	14.0	7.07	28.1	YES	546
30	0.48	364	174.7	14.0	7.06	28.1	YES	581
31	0.5	380	190.0	14.0	7.09	28.4	YES	546

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised November 2022

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@oha.oregon.gov; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350

PAGE 2 of 2