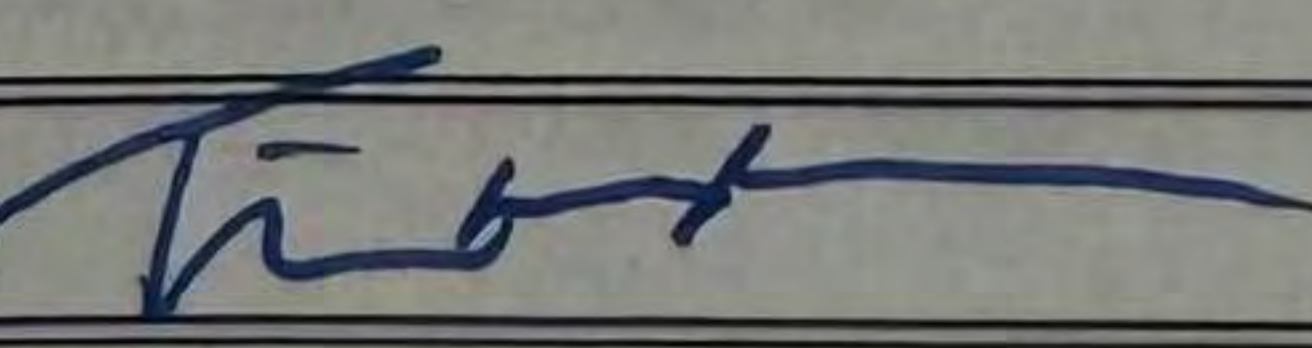


OHA - Drinking Water Services - Surface Water Quality Data Form  
Unfiltered System

County: Grant  
Month/Year: 24-Oct

System Name: Canyon City ID#: 41 00165 WTP : TP - A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1							0.27
2							0.23
3							0.26
4							0.17
5							0.13
6							0.14
7							0.12
8							0.12
9							0.13
10							0.11
11							0.15
12							0.17
13							0.14
14							0.17
15							0.15
16							0.19
17							0.17
18							0.21
19							0.20
20							0.23
21							0.15
22							0.13
23							0.12
24							0.10
25							0.13
26							0.12
27							0.12
28							0.13
29							0.14
30							0.15
31							0.17

Unfiltered		Monthly Summary (Answer Yes or No)	
All daily turbidity readings ≤ 5 NTU? <span style="float: right;">Yes/No</span>		CT's met everyday? (see back) <span style="float: right;">Yes/No</span>	All Cl2 residual at entry point ≥ 0.2 mg/l? <span style="float: right;">Yes/No</span>
Notes:		Tim Madden	
		SIGNATURE: 	
		24-Oct	
		(541)620-0365	D-09145

<sup>1</sup> One reading per day allowed.



OHA - Drinking Water Services - Surface Water Quality Data Form

System Name: Canyon City	ID#: 41	00165	Month/Year: 24-Oct	WTP- :A Disinfection <i>Giardia</i> Log Inactiv: 1.0
--------------------------	---------	-------	--------------------	--

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T) (79 or 106)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	minutes	C X T	[° C]		table/formula	Yes / No	[GPM]
1	0.83	106	88.0	12.9	9.30	71.6	YES	
2	0.78	106	82.7	12.6	9.20	70.0	YES	
3	0.76	106	80.6	12.1	9.30	74.2	YES	
4	0.79	106	83.7	10.7	9.20	79.1	YES	
5	0.77	106	81.6	14.8	9.40	65.1	YES	
6	0.84	106	89.0	12.8	9.40	74.8	YES	
7	0.92	106	97.5	11.6	9.50	84.3	YES	
8	0.93	106	98.6	13.6	9.30	69.1	YES	
9	0.92	106	97.5	15.7	9.40	62.4	YES	
10	0.87	106	92.2	14.6	9.20	62.0	YES	
11	0.92	106	97.5	14.7	9.20	61.9	YES	
12	0.81	106	85.9	13.2	9.40	72.6	YES	
13	0.9	106	95.4	12.7	9.40	75.8	YES	
14	0.89	106	94.3	14.2	9.30	66.2	YES	
15	0.94	106	99.6	14.7	9.20	62.1	YES	
16	0.74	106	78.4	13.7	9.10	62.5	YES	
17	0.82	106	86.9	12.4	9.30	73.2	YES	
18	0.76	106	80.6	13.5	9.30	68.3	YES	
19	0.73	106	77.4	14.8	9.50	67.2	YES	
20	0.68	106	72.1	15.1	9.40	63.2	YES	
21	0.75	106	79.5	12.2	9.30	73.6	YES	
22	0.78	106	82.7	11.7	9.30	76.5	YES	
23	0.8	106	84.8	11.5	9.20	74.9	YES	
24	0.83	106	88.0	12.4	9.40	76.0	YES	
25	0.79	106	83.7	12.7	9.20	69.6	YES	
26	0.76	106	80.6	13.2	9.40	72.2	YES	
27	0.87	106	92.2	12.7	9.20	70.2	YES	
28	0.96	106	101.8	12.4	9.30	74.4	YES	
29	0.84	106	89.0	11.2	9.40	82.7	YES	
30	0.89	106	94.3	12.7	9.20	70.4	YES	
31	0.93	106	98.6	12.2	9.30	75.2	YES	

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised Sep. 14, 2022 W.G.

Return by 10th of following month by email, fax, or mail to:  
 dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350