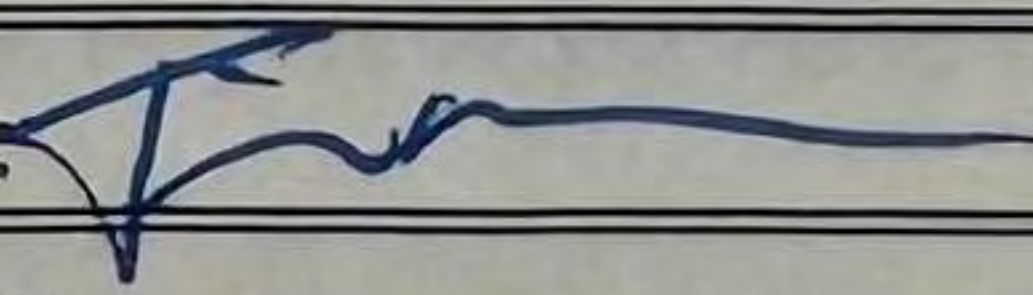


OHA - Drinking Water Services - Surface Water Quality Data Form
Unfiltered System

County: Grant
Month/Year: 25-Feb
WTP : TP - A

System Name:		Canyon City		ID#: 41	00165			
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]	
1							0.12	
2							0.12	
3							0.11	
4							0.10	
5							0.08	
6							0.10	
7							0.09	
8							0.08	
9							0.09	
10							0.10	
11							0.09	
12							0.09	
13							0.08	
14							0.11	
15							0.10	
16							0.10	
17							0.12	
18							0.09	
19							0.11	
20							0.11	
21							0.10	
22							0.12	
23							0.10	
24							0.11	
25							0.10	
26							0.09	
27							0.08	
28							0.09	
29								
30								
31								

Unfiltered		Monthly Summary (Answer Yes or No)	
All daily turbidity readings ≤ 5 NTU?	Yes / No	CT's met everyday? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
		Yes / No	Yes / No
Notes:		Tim Madden	
		SIGNATURE: 	25-Feb
		(541)620-0365	D-09145

¹ One reading per day allowed.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :A

Disinfection *Giardia* Log

Inactiv:

1.0

System Name:

Canyon City

ID#: 41

00165

Month/Year: 25-Feb

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T) (79 or 106)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	minutes	C X T	[° C]		table/formula	Yes / No	[GPM]
1	0.98	106	103.9	6.1	6.80	46.4	YES	
2	0.95	106	100.7	6.4	7.20	52.2	YES	
3	1.03	106	109.2	5.8	7.10	53.0	YES	
4	1.14	106	120.8	6.0	7.10	52.9	YES	
5	1.12	106	118.7	8.5	7.20	46.3	YES	
6	1.16	106	123.0	4.6	6.70	50.5	YES	
7	1	106	106.0	7.2	7.90	64.1	YES	
8	1.04	106	110.2	6.7	7.70	61.9	YES	
9	1.11	106	117.7	4.6	8.80	108.3	YES	
10	1.16	106	123.0	6.4	8.50	85.9	YES	
11	0.87	106	92.2	7.2	8.80	87.8	YES	
12	0.87	106	92.2	5.9	7.20	53.5	YES	
13	0.89	106	94.3	5.7	6.70	45.5	YES	
14	0.95	106	100.7	6.5	7.70	62.1	YES	
15	0.91	106	96.5	6.3	7.20	52.3	YES	
16	0.87	106	92.2	7.2	7.60	56.6	YES	
17	0.77	106	81.6	7.7	7.40	50.4	YES	
18	0.91	106	96.5	8.6	7.20	44.9	YES	
19	0.72	106	76.3	8.0	6.10	31.3	YES	
20	0.79	106	83.7	7.6	6.00	31.3	YES	
21	0.82	106	86.9	7.2	6.70	40.9	YES	
22	0.63	106	66.8	8.2	6.70	37.5	YES	
23	0.67	106	71.0	7.9	6.50	35.9	YES	
24	0.78	106	82.7	8.1	6.40	34.6	YES	
25	0.78	106	82.7	7.2	6.50	38.0	YES	
26	0.82	106	86.9	8.5	6.10	30.6	YES	
27	0.85	106	90.1	7.1	5.60	28.4	YES	
28	0.74	106	78.4	9.1	5.60	24.8	YES	
29		106						
30		106						
31		106						

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised Sep. 14, 2022 W.G.

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350