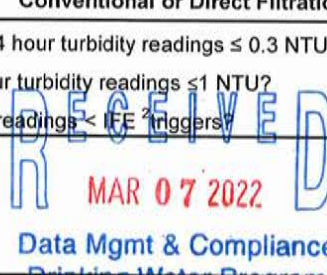


**OHA - Drinking Water Program - Turbidity Monitoring Report Form County:COOS
Conventional or Direct Filtration**

System Name: COQUILLE, CITY OF ID:OR4100213 WTP-:WTP-A Month/Year: Feb-22

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1	NR	NR	0.02	0.03	NR	NR	0.03
2	NR	NR	0.02	0.04	NR	NR	0.04
3	NR	NR	0.02	0.05	NR	NR	0.05
4	NR	NR	0.02	0.03	NR	NR	0.05
5	NR	NR	0.04	0.02	0.02	NR	0.04
6	NR	NR	NR	0.03	NR	NR	0.03
7	NR	NR	0.02	0.02	NR	NR	0.02
8	NR	NR	0.02	0.02	NR	NR	0.02
9	NR	NR	0.02	0.02	0.03	NR	0.03
10	NR	NR	0.03	0.02	NR	NR	0.03
11	NR	NR	0.03	0.04	0.02	NR	0.04
12	NR	NR	0.03	0.03	NR	NR	0.03
13	NR	NR	0.05	0.03	NR	NR	0.05
14	NR	NR	0.02	0.03	NR	NR	0.03
15	NR	NR	0.02	0.03	NR	NR	0.03
16	NR	NR	0.02	0.03	NR	NR	0.03
17	NR	NR	0.02	0.03	0.02	NR	0.03
18	NR	NR	0.03	0.03	0.02	NR	0.03
19	NR	NR	0.02	0.02	NR	NR	0.02
20	NR	NR	0.03	0.03	NR	NR	0.03
21	NR	NR	0.02	0.03	NR	NR	0.03
22	NR	NR	0.02	0.02	NR	NR	0.03
23	NR	NR	0.03	0.03	NR	NR	0.03
24	NR	NR	0.02	0.05	NR	NR	0.05
25	NR	NR	0.04	0.03	NR	NR	0.05
26	NR	NR	0.06	0.02	NR	NR	0.06
27	NR	NR	0.02	0.02	NR	NR	0.02
28	NR	NR	0.03	0.02	NR	NR	0.03
29							
30							
31							
0.03							

Conventional or Direct Filtration		Monthly Summary (Answer Yes or No)	
95% of the 4 hour turbidity readings ≤ 0.3 NTU? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	CT's met everyday? (see back) <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	
All the 4 hour turbidity readings ≤ 1 NTU? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No			
All turbidity readings < IFE ² triggers? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No ²			
Notes:	PRINTED NAME: <i>Raymond S. Doan</i>	DATE: <i>3/1/22</i>	
	SIGNATURE: <i>[Signature]</i>	CERT #: <i>T-2651 fe</i>	
	PHONE #: <i>(541) 396-4614</i>		

¹Including continuous data, if applicable, for optimizing recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²IFE=Individual Filter Effluent (OAR 333-061-0040(1)(e)(B&C))

PAGE 1 of 2


OHA - Drinking Water Program - Surface Water Quality Data Form

COQUILLE, CITY OF ID #: OR4100213 WTP-: WTP-A

Month/Year: Feb-22

Required Log Inactivation: 0.5

Date / Time	Residual At 1 st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/l]	[minutes]	C x T	[° C]	S.U.	Formula	Yes / No	[GPM]
1 / 8:20	0.9	48	43	9.0	7.0	8	Yes	950
2 / 8:15	1.4	48	67	9.0	7.0	22	Yes	970
3 / 8:30	1.4	48	67	9.0	7.0	22	Yes	970
4 / 8:15	1.1	48	53	9.0	7.0	21	Yes	920
5 / 9:55	0.8	48	38	10.0	7.1	20	Yes	980
6 / 9:50	1.0	48	48	10.0	7.1	20	Yes	980
7 / 8:20	1.1	48	53	9.0	7.1	8	Yes	970
8 / 11:00	1.3	48	62	9.0	7.1	22	Yes	925
9 / 8:20	1.4	48	67	9.0	7.1	22	Yes	915
10 / 8:45	0.9	48	43	10.0	7.2	20	Yes	970
11 / 8:30	1.5	48	72	9.0	7.1	23	Yes	980
12 / 10:05	1.4	48	67	10.0	7.0	20	Yes	980
13 / 9:35	0.8	48	38	10.0	7.2	20	Yes	980
14 / 8:30	1.1	48	53	9.0	7.0	21	Yes	960
15 / 8:30	1.7	48	82	10.0	7.0	21	Yes	950
16 / 8:30	1.5	48	72	10.0	7.1	21	Yes	950
17 / 8:40	1.4	48	67	9.0	7.1	22	Yes	950
18 / 8:25	1.0	48	48	9.0	7.0	21	Yes	910
19 / 9:30	1.0	48	48	9.0	7.0	21	Yes	910
20 / 9:55	0.9	48	43	11.0	7.1	19	Yes	940
21 / 9:00	1.2	48	58	10.0	7.1	20	Yes	925
22 / 8:30	1.2	48	58	10.0	7.0	20	Yes	970
23 / 8:25	1.1	48	53	9.0	7.0	21	Yes	960
24 / 8:50	1.5	48	72	9.0	7.1	23	Yes	980
25 / 8:40	1.5	48	48	8.0	7.0	23	Yes	985
26 / 9:45	0.8	48	38	10.0	7.1	20	Yes	960
27 / 9:45	0.8	48	38	10.0	7.1	20	Yes	920
28 / 8:20	0.9	48	43	9.0	7.0	20	Yes	920
29 /								
30 /								
31								


 MAR 07 2022
 Data Mgmt & Compliance
 Drinking Water Program

Month / Year : Feb-22

City of Coquille Daily Chlorine and pH Report

Day	Chlorine				pH				Hours of Operation				CL17 Analyzer Reading	Alkalinity
	2	3	4	5	2	3	4	5	Reading	Plant Hrs	R.C.	River		
1	0.9	0.8	0.9	0.7	7.0	7.1	7.1	7.1	470.9	7.4	x		1.11	
2	1.4	0.7	0.9	0.9	7.0	7.0	7.0	7.1	478.3	8.6	x		1.15	
3	1.4	0.8	1.0	0.9	7.0	7.0	7.0	7.1	486.9	6.5	x		1.15	
4	1.1	0.8	0.9	0.8	7.0	7.0	7.1	7.1	493.4	7.4	x		1.13	
5	0.8	0.8	0.9	0.7	7.1	7.0	7.0	7.0	500.8	10.4	x		1.19	
6	1.0	1.1	1.0	0.9	7.1	7.0	7.0	7.1	511.2	6.5	x		1.15	
7	1.1	0.9	0.9	1.1	7.1	7.0	7.1	7.1	517.7	7.3	x		1.19	15.0
8	1.3	0.5	0.7	0.7	7.1	7.0	7.0	7.1	525.0	7.0	x		1.30	
9	1.4	0.9	0.7	0.8	7.1	7.1	7.1	7.1	532.0	9.4	x		1.13	
10	0.9	1.0	0.8	0.7	7.2	7.1	7.1	7.1	541.4	7.1	x		1.19	
11	1.5	0.9	0.9	0.7	7.1	7.1	7.1	7.2	548.5	11.3	x		1.13	
12	1.4	1.0	0.8	0.8	7.0	7.0	7.0	7.1	559.8	6.1	x		1.17	
13	0.8	0.9	0.8	0.7	7.2	7.1	7.0	7.0	565.9	6.9	x		1.17	
14	1.1	0.9	0.8	0.8	7.0	7.1	7.0	7.1	572.8	7.5	x		1.15	15.0
15	1.7	0.7	0.9	0.4	7.1	7.1	7.1	7.1	580.3	6.7	x		1.17	
16	1.5	0.8	0.9	0.8	7.1	7.1	7.1	7.1	587.0	5.8	x		1.17	
17	1.4	0.8	0.8	0.7	7.0	7.0	7.0	7.1	592.8	8.7	x		1.10	
18	1.0	0.7	0.8	0.9	7.0	7.1	7.1	7.1	601.5	9.6	x		1.11	
19	1.0	0.8	0.8	0.7	7.1	7.0	7.0	7.1	611.1	6.4	x		1.26	
20	0.9	0.9	0.8	0.6	7.1	7.0	7.0	7.0	617.5	5.8	x		1.17	
21	1.2	0.9	0.8	0.7	7.0	7.1	7.0	7.0	623.3	8.2	x		1.13	20.0
22	1.2	0.7	0.9	0.7	7.0	7.0	7.1	7.0	631.5	6.5	x		1.13	
23	1.1	0.8	0.7	0.6	7.1	7.1	7.0	7.1	638.0	6.6	x		1.04	
24	1.5	0.8	0.8	0.5	7.1	7.1	7.0	7.0	644.6	7.8	x		1.12	
25	1.5	0.8	0.7	0.6	7.0	7.1	7.0	7.1	652.4	8.6	x		1.11	
26	0.8	0.7	0.7	0.5	7.1	7.0	7.0	7.0	661.0	7.3	x		1.09	
27	0.8	0.8	0.6	0.7	7.1	7.0	7.0	7.0	668.3	6.7	x		1.19	
28	0.9	1.0	0.8	0.7	7.0	7.0	7.1	7.1	675.0	7.1	x		1.18	15.0

Sample Points _____
 Final Water Tap _____
 MGRES _____
 Sewage Plant _____

211.2 _____
 16.087 Million Gallons _____
 n/a Pounds _____
 n/a Pounds _____
 n/a Pounds _____
 100 Pounds _____
 2.936 Million Pounds _____



