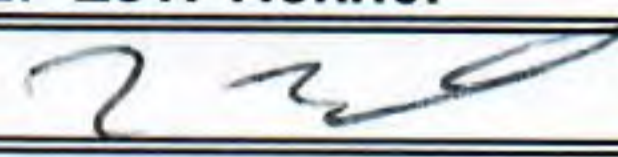


OHA - Drinking Water Services - Surface Water Quality Data Form
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: Wallowa
 Month/Year: May-23

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1			0.08				0.08
2			0.13				0.13
3			0.12				0.12
4			0.10				0.10
5			0.15				0.15
6			0.10				0.10
7			0.15				0.15
8			0.07				0.07
9			0.09				0.09
10			0.11				0.11
11			0.12				0.12
12			0.11				0.11
13			0.12				0.12
14			0.13				0.13
15			0.14				0.14
16			0.13				0.13
17			0.13				0.13
18			0.10				0.10
19			0.10				0.10
20			0.11				0.11
21			0.13				0.13
22			0.07				0.07
23			0.09				0.09
24			0.14				0.14
25			0.08				0.08
26			0.07				0.07
27			0.13				0.13
28			0.10				0.10
29			0.09				0.09
30			0.11				0.11
31			0.11				0.11

Slow Sand/Membrane/DE Filtration/Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ²	Yes	CT's met everyday? (see back)	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	Yes	Yes	Yes
Notes:		PRINTED NAME: Levi Tickner	
		SIGNATURE: 	DATE: 6/10/2023
		PHONE #: (541)760-9362	CERT #: T-008780

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

Slow Sand/Membrane
 95% of daily turbidity re

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :

System Name: City of Joseph ID#: 41 00414 Month/Year: May-23 Disinfection *Giardia* Log Inactiv: 1.0

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.62	1539	954.2	7.3	7.72	57.0	YES	335
2	0.63	1423	896.5	7.3	7.70	56.7	YES	360
3	0.6	1527	916.2	7.9	7.74	55.0	YES	337
4	0.59	1546	912.1	8.2	7.61	51.4	YES	331
5	0.56	1574	881.4	8.0	7.68	53.3	YES	327
6	0.56	1559	873.0	7.8	8.53	73.5	YES	330
7	0.56	1391	779.0	7.9	7.59	51.9	YES	344
8	0.57	1597	910.3	7.7	7.71	55.0	YES	320
9	0.55	1503	826.7	7.8	7.64	53.2	YES	342
10	0.57	1577	898.9	7.8	7.66	53.7	YES	327
11	0.58	1486	861.9	7.9	7.65	53.2	YES	345
12	0.56	1425	798.0	8.5	7.50	48.3	YES	360
13	0.55	1457	801.4	9.2	7.65	48.6	YES	352
14	0.54	1463	790.0	9.2	7.55	46.8	YES	350
15	0.56	1470	823.2	10.3	7.52	43.2	YES	350
16	0.53	1535	813.6	10.1	7.64	45.5	YES	335
17	0.5	1446	723.0	10.1	7.63	45.2	YES	355
18	0.53	1274	675.2	10.6	7.46	41.3	YES	397
19	0.52	1314	683.3	10.9	7.42	39.9	YES	389
20	0.54	1347	727.4	11.3	8.52	57.5	YES	380
21	0.63	1363	858.7	11.6	8.43	55.1	YES	375
22	0.48	1416	679.7	11.7	7.67	41.1	YES	362
23	0.47	1365	641.6	11.6	7.63	40.8	YES	375
24	0.48	1066	511.7	11.3	7.67	42.2	YES	480
25	0.5	1144	572.0	11.4	7.75	43.2	YES	450
26	0.47	1011	475.2	11.4	7.67	41.9	YES	510
27	0.46	1430	657.8	11.4	7.77	43.4	YES	360
28	0.4	1427	570.8	11.6	7.50	38.7	YES	362
29	0.41	1473	603.9	11.9	7.67	40.3	YES	351
30	0.42	1231	517.0	11.7	7.67	40.9	YES	420
31	0.4	1439	575.6	11.9	7.67	40.2	YES	360

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Return by 10th of following month by email, fax, or mail to:
 dwp@dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350

30 0.42
 31 0.4
 entry point < 0.2 mg/l