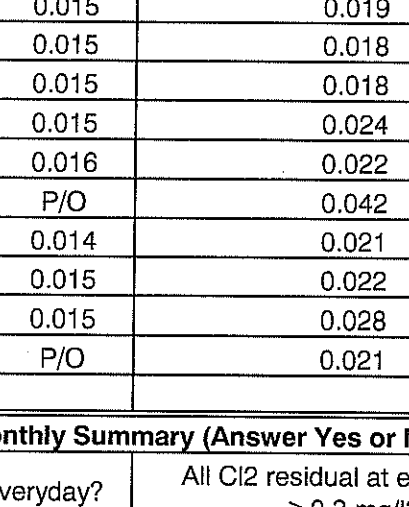


**OHA - Drinking Water Program - Surface Water Quality Data Form**  
**Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems**

County: **Lincoln**  
 Month/Year: **Jun-23**  
 WTP: TP - **Membrane**

System Name: <b>Newport, City of</b>		ID#: <b>41-00566 A</b>					WTP: TP - <b>Membrane</b>	
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]	
1	P/O	P/O	0.015	0.015	P/O	P/O	0.024	
2	0.014	0.015	P/O	P/O	0.015	0.014	0.031	
3	0.015	P/O	P/O	0.014	0.016	0.015	0.021	
4	P/O	P/O	0.018	0.014	0.015	P/O	0.027	
5	P/O	0.015	0.015	P/O	P/O	0.014	0.029	
6	0.015	P/O	P/O	0.015	0.015	0.015	0.026	
7	0.016	P/O	0.020	0.015	0.015	0.015	0.022	
8	0.015	P/O	P/O	0.015	0.014	0.015	0.017	
9	P/O	P/O	0.017	0.015	0.016	0.015	0.021	
10	0.016	0.016	P/O	0.015	0.015	0.016	0.021	
11	0.016	0.015	P/O	0.016	0.015	0.015	0.020	
12	0.015	P/O	P/O	0.015	0.014	0.015	0.029	
13	0.016	P/O	P/O	0.014	0.015	0.015	0.020	
14	0.015	0.015	P/O	0.015	0.015	0.015	0.037	
15	0.016	0.016	P/O	0.014	0.015	0.015	0.019	
16	0.015	0.015	0.015	0.015	P/O	0.015	0.020	
17	0.015	P/O	P/O	0.015	0.015	0.015	0.026	
18	0.015	P/O	P/O	0.014	0.015	0.016	0.020	
19	P/O	P/O	0.015	0.016	0.016	0.016	0.024	
20	0.016	0.016	P/O	0.015	0.015	0.015	0.020	
21	0.015	P/O	P/O	0.015	0.015	0.015	0.019	
22	0.015	0.015	P/O	0.015	0.015	0.015	0.018	
23	0.015	P/O	P/O	0.015	0.015	0.015	0.018	
24	0.016	P/O	0.016	0.015	0.015	0.015	0.024	
25	0.015	0.016	P/O	0.022	0.015	0.016	0.022	
26	0.017	0.017	0.016	0.017	P/O	P/O	0.042	
27	0.016	0.016	0.018	P/O	0.015	0.014	0.021	
28	0.016	P/O	P/O	0.015	0.015	0.015	0.022	
29	0.016	P/O	0.015	0.015	0.015	0.015	0.028	
30	0.016	P/O	0.015	0.015	0.015	P/O	0.021	

<b>Slow Sand/Membrane/DE Filtration/Unfiltered</b>		<b>Monthly Summary (Answer Yes or No)</b>	
95% of daily turbidity readings ≤ 1 NTU? <sup>2</sup>	<input checked="" type="radio"/> Yes / No	CT's met everyday?	All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / No	<input checked="" type="radio"/> Yes / No	<input checked="" type="radio"/> Yes / No
<b>Notes: P/O = PLANT OFF</b>		<b>PRINTED NAME: Steve Stewart</b>	
		<b>SIGNATURE:</b> 	<b>DATE: 7/1/2023</b>
		<b>PHONE #: ( 541 ) 265-7421</b>	<b>CERT #: 2445</b>

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> Filtered systems only.

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: Membrane

System Name: NEWPORT, CITY OF

ID#: 41-00566

Month/Year: Jun-23

Disinfection  
Giardia Log  
Inactive: 0.5

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
6/1/2023 4:35	1.2	86	99	17	8.0	17	Yes	2625
6/2/2023 10:37	0.9	86	80	18	8.0	16	Yes	2636
6/3/2023 8:46	1.2	83	97	17	8.0	17	Yes	2648
6/4/2023 4:55	1.2	89	105	18	8.0	17	Yes	2499
6/5/2023 0:36	1.2	88	103	18	8.0	16	Yes	2635
6/6/2023 10:24	0.9	88	79	18	8.0	16	Yes	2626
6/7/2023 7:43	1.0	85	83	18	8.0	16	Yes	2641
6/8/2023 10:18	0.9	85	78	18	8.0	16	Yes	2628
6/9/2023 7:16	0.9	85	76	18	8.0	16	Yes	2615
6/10/2023 9:54	0.9	89	78	18	8.0	16	Yes	2614
6/11/2023 10:19	1.0	87	89	18	7.9	15	Yes	2611
6/12/2023 9:13	1.0	84	87	18	7.8	15	Yes	2637
6/13/2023 8:19	0.9	88	76	19	7.7	14	Yes	2637
6/14/2023 10:46	1.0	87	90	19	7.8	14	Yes	2626
6/15/2023 10:39	1.1	88	95	19	7.8	14	Yes	2631
6/16/2023 19:21	1.1	88	95	19	7.8	14	Yes	2645
6/17/2023 11:06	1.0	83	86	19	7.7	14	Yes	2642
6/18/2023 10:49	0.9	88	82	19	7.8	14	Yes	2632
6/19/2023 6:12	1.1	87	92	18	7.9	15	Yes	2640
6/20/2023 9:09	0.8	81	65	19	7.9	15	Yes	2858
6/21/2023 7:53	1.0	85	88	18	7.9	15	Yes	2640
6/22/2023 11:07	0.7	91	64	19	7.9	14	Yes	2580
6/23/2023 9:04	1.0	86	85	19	7.9	15	Yes	2626
6/24/2023 6:24	1.1	83	90	19	7.8	14	Yes	2615
6/25/2023 11:32	0.8	89	69	19	7.7	13	Yes	2575
6/26/2023 21:57	1.0	90	94	19	7.7	13	Yes	2572
6/27/2023 14:32	0.7	86	62	20	7.7	12	Yes	2579
6/28/2023 8:26	0.7	84	59	19	7.7	13	Yes	2599
6/29/2023 6:04	1.0	91	94	20	7.7	13	Yes	2590
6/30/2023 12:57	1.1	83	94	20	7.6	12	Yes	2735

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised September 2016

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, P.O. Box 14350, Portland, OR 97293-0350