

OHA - Drinking Water Services - Turbidity Monitoring Report Form

County:	Tillamook
Month/Year:	Apr-22

Membrane

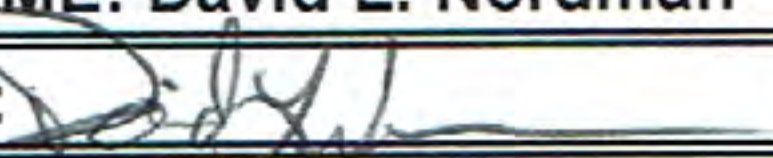
System Name: Oceanside, City of

ID#: 41 00585

WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	OFF	OFF	OFF	OFF	OFF	OFF	0.015
2	OFF	OFF	OFF	OFF	OFF	0.013	0.014
3	0.013	OFF	OFF	0.014	OFF	0.013	0.014
4	0.013	OFF	OFF	0.013	OFF	OFF	0.015
5	OFF	0.013	OFF	OFF	OFF	OFF	0.015
6	OFF	OFF	0.013	OFF	0.013	OFF	0.014
7	OFF	OFF	OFF	OFF	OFF	0.013	0.029
8	OFF	OFF	OFF	OFF	OFF	0.014	0.038
9	OFF	OFF	0.013	0.015	0.017	OFF	0.039
10	OFF	OFF	OFF	0.020	OFF	OFF	0.034
11	OFF	OFF	OFF	OFF	0.013	OFF	0.028
12	OFF	0.014	0.014	OFF	OFF	OFF	0.024
13	0.013	OFF	OFF	OFF	OFF	OFF	0.020
14	OFF	OFF	OFF	OFF	OFF	OFF	0.028
15	OFF	OFF	OFF	OFF	0.014	0.013	0.032
16	0.013	0.013	OFF	OFF	OFF	OFF	0.025
17	OFF	OFF	OFF	OFF	OFF	OFF	0.023
18	0.014	OFF	OFF	OFF	OFF	OFF	0.019
19	OFF	OFF	OFF	0.014	OFF	OFF	0.024
20	0.016	0.014	OFF	OFF	OFF	OFF	0.020
21	OFF	OFF	OFF	OFF	0.016	OFF	0.029
22	OFF	OFF	OFF	OFF	OFF	0.021	0.026
23	OFF	OFF	OFF	OFF	OFF	0.013	0.028
24	0.013	0.013	0.018	OFF	OFF	0.015	0.022
25	0.019	OFF	OFF	OFF	OFF	OFF	0.019
26	OFF	OFF	OFF	0.015	0.018	OFF	0.731
27	OFF	OFF	OFF	0.016	0.014	0.012	0.021
28	OFF	OFF	OFF	OFF	OFF	OFF	0.014
29	0.013	OFF	OFF	OFF	OFF	OFF	0.029
30	OFF	OFF	OFF	0.013	OFF	0.013	0.020

Membrane	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)
All 4-hour turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings < 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:	PRINTED NAME: David L. Nordman	
	SIGNATURE: 	5/2/2022
	PHONE #: (503) 842-6462	CERT #: T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of

ID#: 41 00585

Month/Year: Apr-22

Disinfection Giardia
Log Inactiv:

1.000

Date / Time	Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.940	80.00	75.2	12.5	7.57	39.5	YES	300
2	0.970	80.00	77.6	11.1	7.42	41.4	YES	300
3	0.820	80.00	65.6	12.5	7.53	38.4	YES	300
4	0.880	80.00	70.4	11.0	7.39	40.9	YES	300
5	0.840	80.00	67.2	10.1	7.54	45.5	YES	300
6	0.770	80.00	61.6	10.6	7.55	43.8	YES	300
7	0.770	80.00	61.6	11.0	7.50	41.9	YES	300
8	0.850	80.00	68.0	11.0	7.33	39.9	YES	300
9	0.900	80.00	72.0	11.3	7.30	38.9	YES	300
10	0.920	80.00	73.6	10.2	7.42	43.7	YES	300
11	0.770	80.00	61.6	9.6	7.40	44.4	YES	300
12	0.830	80.00	66.4	10.2	7.53	45.0	YES	300
13	0.700	80.00	56.0	9.4	7.44	45.3	YES	300
14	0.750	80.00	60.0	8.9	7.39	46.2	YES	300
15	0.790	80.00	63.2	9.7	7.52	46.1	YES	300
16	0.870	80.00	69.6	10.0	7.41	43.9	YES	300
17	0.830	80.00	66.4	9.2	7.55	48.4	YES	300
18	0.850	80.00	68.0	9.4	7.46	46.4	YES	300
19	0.850	80.00	68.0	9.1	7.46	47.3	YES	300
20	0.840	80.00	67.2	9.3	7.50	47.3	YES	300
21	0.840	80.00	67.2	9.9	7.77	50.0	YES	300
22	0.870	80.00	69.6	10.1	7.60	46.6	YES	300
23	0.870	80.00	69.6	10.3	7.46	43.8	YES	300
24	0.840	80.00	67.2	10.3	7.54	44.9	YES	300
25	0.900	80.00	72.0	11.0	7.56	43.5	YES	300
26	0.850	80.00	68.0	10.5	7.55	44.5	YES	300
27	0.870	80.00	69.6	10.2	7.73	48.5	YES	300
28	0.880	80.00	70.4	10.8	7.59	44.4	YES	300
29	0.920	80.00	73.6	10.8	7.73	46.9	YES	300
30	0.990	80.00	79.2	10.8	7.58	44.8	YES	300

³ If Cl2 at entry point < 0.2 mg/l or CT not met, DWS to be notified by end of next business day.

Revised October 2013