

OHA - Drinking Water Services - Turbidity Monitoring Report Form

County:	Tillamook
Month/Year:	Aug-22

Membrane

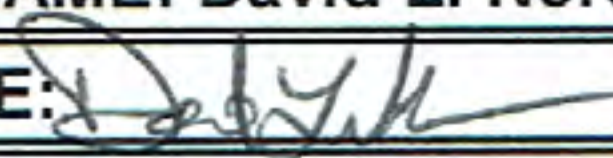
System Name: Oceanside, City of

ID#: 41 00585

WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	OFF	OFF	OFF	0.031	OFF	0.012	0.038
2	0.012	OFF	OFF	OFF	OFF	OFF	0.036
3	OFF	OFF	0.018	0.012	0.014	0.019	0.028
4	0.012	OFF	OFF	OFF	0.012	0.017	0.083
5	0.012	0.013	OFF	0.014	OFF	0.012	0.033
6	0.015	OFF	OFF	0.019	0.012	OFF	0.031
7	0.012	OFF	OFF	OFF	0.016	0.012	0.030
8	OFF	0.012	OFF	OFF	OFF	OFF	0.031
9	OFF	OFF	OFF	0.012	0.012	0.015	0.025
10	OFF	0.012	OFF	OFF	0.024	0.012	0.033
11	0.012	0.012	OFF	OFF	0.012	0.012	0.039
12	OFF	OFF	0.018	0.013	0.015	0.013	0.051
13	0.013	OFF	OFF	OFF	0.012	0.019	0.033
14	0.012	0.013	OFF	OFF	0.013	0.013	0.034
15	0.016	0.014	0.012	OFF	OFF	0.018	0.025
16	OFF	OFF	0.014	0.012	0.014	0.012	0.030
17	0.013	0.012	OFF	OFF	0.014	0.020	0.035
18	0.014	OFF	OFF	OFF	OFF	OFF	0.032
19	OFF	OFF	0.012	OFF	0.012	0.012	0.035
20	0.012	0.014	OFF	OFF	0.012	0.012	0.034
21	0.012	OFF	0.012	OFF	0.013	0.012	0.029
22	0.012	0.014	0.012	0.012	0.012	OFF	0.042
23	OFF	0.014	OFF	0.012	0.013	OFF	0.027
24	0.012	OFF	OFF	OFF	OFF	0.013	0.019
25	0.012	0.012	0.012	0.012	OFF	OFF	0.024
26	OFF	0.013	0.012	OFF	0.012	0.012	0.020
27	0.013	0.013	OFF	OFF	0.013	0.012	0.025
28	0.012	0.012	0.012	OFF	OFF	0.012	0.017
29	OFF	OFF	OFF	0.012	0.012	0.012	0.018
30	0.018	0.012	OFF	0.013	0.012	0.012	0.018
31	0.013	0.012	0.012	0.012	0.012	0.012	0.020

Membrane	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)
All 4-hour turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings < 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:	PRINTED NAME: David L. Nordman	
	SIGNATURE: 	DATE: 9/7/2022
	PHONE #: (503) 842-6462	CERT #: T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² IFE = Individ. Filter Eff. (333-061-0040(1)(e)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of	ID#: 41 00585	Month/Year: Aug-22	Disinfection Giardia Log Inactiv:	1.000
---------------------------------	---------------	--------------------	-----------------------------------	-------

Date / Time	Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.500	142.00	71.0	16.5	7.53	28.3	YES	300
2	0.760	142.00	107.9	15.5	7.66	32.7	YES	300
3	0.750	142.00	106.5	16.5	7.55	29.4	YES	300
4	0.720	142.00	102.2	16.7	7.58	29.2	YES	300
5	1.020	142.00	144.8	14.4	7.49	34.1	YES	300
6	0.760	142.00	107.9	15.7	7.58	31.4	YES	300
7	0.890	142.00	126.4	15.3	7.61	33.1	YES	300
8	0.800	142.00	113.6	15.9	7.65	31.9	YES	300
9	0.690	142.00	98.0	16.3	7.53	29.3	YES	300
10	0.820	142.00	116.4	15.5	7.57	31.9	YES	300
11	0.750	142.00	106.5	15.2	7.46	31.0	YES	300
12	0.750	142.00	106.5	16.4	7.46	28.6	YES	300
13	0.750	142.00	106.5	15.7	7.49	30.3	YES	300
14	0.730	142.00	103.7	15.6	7.49	30.4	YES	300
15	0.760	142.00	107.9	16.2	7.45	28.9	YES	300
16	0.710	142.00	100.8	16.5	7.49	28.6	YES	300
17	0.790	142.00	112.2	16.2	7.58	30.4	YES	300
18	0.830	142.00	117.9	15.9	7.64	31.9	YES	300
19	0.760	142.00	107.9	16.5	7.48	28.7	YES	300
20	0.730	142.00	103.7	16.2	7.58	30.2	YES	300
21	0.760	142.00	107.9	16.5	7.57	29.6	YES	300
22	0.720	142.00	102.2	17.1	7.52	27.8	YES	300
23	0.790	142.00	112.2	16.3	7.57	30.1	YES	300
24	0.650	142.00	92.3	16.2	7.60	30.2	YES	300
25	0.840	142.00	119.3	16.4	7.58	30.2	YES	300
26	0.800	142.00	113.6	16.7	7.60	29.7	YES	300
27	0.770	142.00	109.3	15.8	7.61	31.5	YES	300
28	0.730	142.00	103.7	16.5	7.53	29.1	YES	300
29	0.710	142.00	100.8	16.3	7.56	29.7	YES	300
30	0.690	142.00	98.0	16.1	7.58	30.3	YES	300
31	0.700	142.00	99.4	16.5	7.56	29.3	YES	300

³ If Cl2 at entry point < 0.2 mg/l or CT not met, DWS to be notified by end of next business day.

Revised October 2013