

OHA - Drinking Water Services - Turbidity Monitoring Report Form

County:	Tillamook
Month/Year:	Jan-23

Membrane

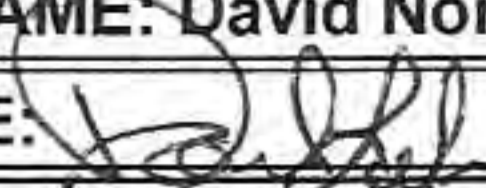
System Name: Oceanside, City of

ID#: 41 00585

WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.014	0.014	0.015	0.015	0.015	0.015	0.015
2	0.014	0.014	0.014	0.014	OFF	0.014	0.015
3	OFF	0.014	0.014	0.015	0.015	OFF	0.015
4	OFF	OFF	OFF	OFF	OFF	0.014	0.018
5	0.014	0.014	OFF	OFF	0.015	OFF	0.024
6	OFF	OFF	OFF	OFF	OFF	0.014	0.018
7	0.014	OFF	OFF	OFF	OFF	OFF	0.017
8	OFF	OFF	OFF	OFF	0.014	OFF	0.020
9	0.014	0.014	OFF	0.015	OFF	OFF	0.015
10	OFF	OFF	OFF	OFF	OFF	OFF	0.019
11	0.014	OFF	OFF	OFF	OFF	OFF	0.016
12	OFF	OFF	OFF	0.015	0.014	OFF	0.019
13	OFF	OFF	OFF	OFF	OFF	0.014	0.019
14	0.014	OFF	0.014	0.014	0.015	0.014	0.015
15	0.015	0.015	OFF	OFF	OFF	0.014	0.016
16	0.014	0.014	0.014	0.015	0.015	OFF	0.015
17	OFF	OFF	OFF	OFF	OFF	0.014	0.018
18	0.014	0.014	OFF	0.016	0.016	OFF	0.020
19	OFF	OFF	OFF	OFF	0.014	OFF	0.022
20	0.014	0.014	0.014	0.014	0.014	OFF	0.014
21	OFF	OFF	OFF	OFF	OFF	OFF	0.015
22	0.014	0.014	0.014	0.014	0.014	0.014	0.014
23	0.014	OFF	0.014	0.014	OFF	OFF	0.015
24	OFF	OFF	OFF	OFF	OFF	OFF	0.015
25	0.015	0.014	0.014	OFF	OFF	OFF	0.016
26	OFF	OFF	OFF	0.015	OFF	0.014	0.016
27	0.014	0.014	OFF	0.014	0.014	0.014	0.014
28	0.014	OFF	OFF	OFF	OFF	0.014	0.016
29	0.014	0.014	0.014	OFF	OFF	OFF	0.016
30	OFF	OFF	OFF	0.015	OFF	0.014	0.016
31	OFF	0.014	OFF	0.015	OFF	OFF	0.015

Membrane	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	Yes / No	CT's met everyday? (see back)
All 4-hour turbidity readings ≤ 1 NTU?	Yes / No	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings < 5 NTU?	Yes / No	Yes / No

Notes:	PRINTED NAME: David Nordman	
	SIGNATURE: 	DATE: 2/6/2023
	PHONE #: (503) 842-6462	CERT #: T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of

ID#: 41 00585

Month/Year: Jan-23

Disinfection Giardia
Log Inactiv:

1.000

Date / Time	Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.700	142.00	99.4	9.8	7.46	44.4	YES	300
2	0.700	142.00	99.4	10.5	7.54	43.6	YES	300
3	0.700	142.00	99.4	10.4	7.68	46.1	YES	300
4	0.760	142.00	107.9	9.6	7.59	47.4	YES	300
5	0.740	142.00	105.1	10.3	7.57	44.8	YES	300
6	0.810	142.00	115.0	11.8	7.76	43.8	YES	300
7	0.750	142.00	106.5	10.0	7.41	43.3	YES	300
8	0.870	142.00	123.5	10.2	7.34	42.3	YES	300
9	0.870	142.00	123.5	10.3	7.33	41.8	YES	300
10	0.750	142.00	106.5	10.2	7.49	43.9	YES	300
11	0.700	142.00	99.4	10.1	7.51	44.3	YES	300
12	0.720	142.00	102.2	11.7	7.49	39.7	YES	300
13	0.740	142.00	105.1	10.7	7.55	43.4	YES	300
14	0.920	142.00	130.6	11.2	7.58	43.3	YES	300
15	0.730	142.00	103.7	11.0	7.48	41.5	YES	300
16	0.830	142.00	117.9	10.6	7.60	44.9	YES	300
17	0.730	142.00	103.7	11.4	7.61	42.3	YES	300
18	0.730	142.00	103.7	10.5	7.43	42.1	YES	300
19	0.810	142.00	115.0	10.2	7.53	44.9	YES	300
20	0.820	142.00	116.4	10.0	7.43	43.9	YES	300
21	0.820	142.00	116.4	9.9	7.44	44.4	YES	300
22	0.800	142.00	113.6	9.7	7.39	44.1	YES	300
23	0.760	142.00	107.9	9.9	7.50	45.0	YES	300
24	0.750	142.00	106.5	9.2	7.50	47.1	YES	300
25	0.760	142.00	107.9	9.6	7.60	47.6	YES	300
26	0.820	142.00	116.4	9.4	7.51	47.0	YES	300
27	0.850	142.00	120.7	11.0	7.73	45.9	YES	300
28	0.950	142.00	134.9	10.8	7.56	44.3	YES	300
29	0.870	142.00	123.5	9.5	7.88	53.6	YES	300
30	0.880	142.00	125.0	8.7	7.82	55.4	YES	300
31	1.000	142.00	142.0	9.2	7.54	49.2	YES	300

Revised October 2013