

OHA - Drinking Water Services - Turbidity Monitoring Report Form

County:	Tillamook
Month/Year:	Oct-22

Membrane

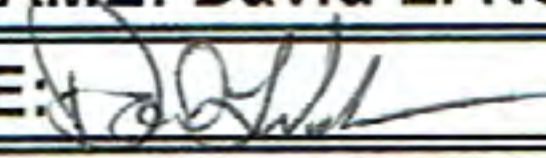
System Name: Oceanside, City of

ID#: 41 00585

WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.012	OFF	OFF	OFF	0.012	0.012	0.014
2	0.012	OFF	0.012	0.012	0.012	OFF	0.012
3	OFF	OFF	OFF	0.013	OFF	0.012	0.015
4	0.012	0.012	0.012	OFF	0.013	0.012	0.017
5	OFF	OFF	OFF	OFF	OFF	OFF	0.015
6	0.012	OFF	OFF	0.012	0.012	0.012	0.013
7	0.012	OFF	OFF	OFF	OFF	OFF	0.014
8	0.012	OFF	OFF	OFF	OFF	OFF	0.015
9	0.012	OFF	OFF	0.012	0.012	0.012	0.012
10	0.012	OFF	OFF	OFF	OFF	OFF	0.017
11	0.012	OFF	OFF	OFF	OFF	OFF	0.013
12	OFF	OFF	OFF	OFF	OFF	OFF	0.016
13	0.012	OFF	OFF	OFF	0.012	0.012	0.014
14	0.012	OFF	OFF	0.012	OFF	0.012	0.014
15	0.012	0.012	0.012	0.012	0.012	0.012	0.013
16	0.012	OFF	OFF	0.013	0.012	0.012	0.015
17	0.012	OFF	0.012	0.012	0.012	0.012	0.013
18	0.012	OFF	OFF	0.012	0.012	0.012	0.014
19	OFF	OFF	OFF	OFF	0.014	0.014	0.245
20	0.014	0.014	0.014	0.014	OFF	OFF	0.015
21	OFF	0.014	OFF	OFF	0.014	0.014	0.015
22	0.014	OFF	OFF	0.014	OFF	0.014	0.015
23	0.014	0.014	0.014	0.014	OFF	0.014	0.015
24	0.014	0.014	OFF	OFF	0.014	0.014	0.015
25	0.014	OFF	OFF	OFF	OFF	OFF	0.023
26	OFF	OFF	0.015	0.015	0.014	0.014	0.015
27	0.014	0.014	OFF	0.014	0.014	OFF	0.015
28	0.014	0.014	0.014	0.015	0.014	0.014	0.015
29	0.014	OFF	0.014	0.014	0.014	0.014	0.015
30	0.014	0.014	OFF	OFF	OFF	OFF	0.015
31	0.014	0.014	OFF	0.015	0.015	0.014	0.015

Membrane	Monthly Summary (Answer Yes or No)
95% of daily turbidity readings ≤ 1 NTU? Yes / No	CT's met everyday? (see back) Yes / No
All 4-hour turbidity readings ≤ 1 NTU? Yes / No	All Cl2 residual at entry point ≥ 0.2 mg/l? Yes / No
All daily turbidity readings < 5 NTU? Yes / No	

Notes:	PRINTED NAME: David L. Nordman	
	SIGNATURE: 	DATE: 11-4-2022
	PHONE #: (503) 842-6462	CERT #: T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of

ID#: 41 00585

Month/Year: Oct-22

Disinfection Giardia
Log Inactiv:

1.000

Date	Residual at 1st User (C) ³ [ppm or mg/L]	Contact Time (T) [minutes]	Actual CT C X T	Temp [° C]	pH	Required CT formula	CT Met? ³ Yes / No	Peak Hourly Demand Flow [GPM]
1	0.350	142.00	49.7	12.5	7.40	34.7	YES	300
2	0.560	142.00	79.5	15.2	7.42	29.9	YES	300
3	0.670	142.00	95.1	14.7	7.44	31.5	YES	300
4	0.490	142.00	69.6	14.9	7.44	30.5	YES	300
5	0.470	142.00	66.7	14.7	7.46	31.0	YES	300
6	0.450	142.00	63.9	14.6	7.51	31.7	YES	300
7	0.530	142.00	75.3	14.5	7.50	32.1	YES	300
8	0.560	142.00	79.5	13.8	7.55	34.4	YES	300
9	0.640	142.00	90.9	14.1	7.52	33.7	YES	300
10	0.690	142.00	98.0	14.2	7.55	34.0	YES	300
11	0.680	142.00	96.6	13.7	7.53	34.9	YES	300
12	0.560	142.00	79.5	13.4	7.59	35.9	YES	300
13	0.690	142.00	98.0	13.5	7.61	36.4	YES	300
14	0.620	142.00	88.0	14.3	7.52	33.1	YES	300
15	0.700	142.00	99.4	14.6	7.56	33.3	YES	300
16	0.500	142.00	71.0	13.9	7.48	33.1	YES	300
17	0.730	142.00	103.7	14.6	7.59	33.8	YES	300
18	0.890	142.00	126.4	14.0	7.57	35.5	YES	300
19	0.620	142.00	88.0	14.5	7.59	33.6	YES	300
20	0.750	142.00	106.5	14.1	7.63	35.5	YES	300
21	0.800	142.00	113.6	15.3	7.64	33.1	YES	300
22	0.820	142.00	116.4	13.6	7.61	36.7	YES	300
23	0.330	142.00	46.9	12.5	7.55	36.6	YES	300
24	0.900	142.00	127.8	12.6	7.61	39.6	YES	300
25	0.700	142.00	99.4	12.6	7.63	39.0	YES	300
26	0.500	142.00	71.0	12.2	7.65	39.6	YES	300
27	0.620	142.00	88.0	11.8	7.57	40.1	YES	300
28	0.710	142.00	100.8	12.5	7.59	38.7	YES	300
29	0.710	142.00	100.8	12.1	7.57	39.7	YES	300
30	0.910	142.00	129.2	11.8	7.57	41.4	YES	300
31	0.780	142.00	110.8	12.1	7.57	40.0	YES	300

³ If Cl2 at entry point < 0.2 mg/l or CT not met, DWS to be notified by end of next business day.

Revised October 2013