

OHA - Drinking Water Services - Turbidity Monitoring Report Form

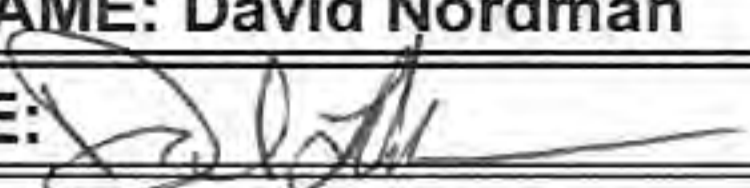
County:	Tillamook
Month/Year:	Dec-22

Membrane

System Name: Oceanside, City of ID#: 41 00585 WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1	0.014	OFF	OFF	OFF	OFF	OFF	0.022
2	OFF	OFF	OFF	OFF	0.015	0.014	0.025
3	0.014	0.014	0.014	OFF	OFF	OFF	0.015
4	OFF	OFF	OFF	OFF	OFF	0.014	0.026
5	0.014	0.014	OFF	0.015	0.015	0.014	0.015
6	0.014	OFF	OFF	OFF	OFF	OFF	0.025
7	OFF	OFF	OFF	0.015	0.015	OFF	0.029
8	OFF	0.014	0.015	0.014	0.015	0.014	0.015
9	0.014	OFF	OFF	OFF	OFF	OFF	0.019
10	OFF	OFF	OFF	0.014	0.014	OFF	0.025
11	OFF	OFF	OFF	0.015	0.014	0.014	0.017
12	OFF	OFF	0.014	0.015	OFF	0.014	0.015
13	0.014	OFF	OFF	OFF	OFF	OFF	0.019
14	OFF	OFF	OFF	0.018	0.015	OFF	0.020
15	OFF	OFF	OFF	OFF	0.015	0.014	0.036
16	0.014	0.014	OFF	0.014	0.014	OFF	0.015
17	OFF	OFF	OFF	OFF	0.014	0.014	0.018
18	OFF	OFF	OFF	OFF	OFF	OFF	0.018
19	0.014	0.014	OFF	OFF	OFF	0.014	0.015
20	0.014	0.014	OFF	0.015	0.015	OFF	0.015
21	OFF	OFF	OFF	OFF	OFF	OFF	0.020
22	0.014	0.014	0.014	OFF	OFF	OFF	0.016
23	OFF	0.014	0.014	0.015	0.015	OFF	0.017
24	OFF	OFF	OFF	0.014	OFF	OFF	0.020
25	0.014	0.014	0.014	OFF	0.014	OFF	0.015
26	0.014	0.014	0.015	OFF	0.014	OFF	0.016
27	OFF	OFF	OFF	OFF	OFF	OFF	0.019
28	OFF	OFF	OFF	OFF	OFF	OFF	0.024
29	OFF	OFF	0.015	0.014	OFF	0.014	0.028
30	0.014	0.014	OFF	0.021	OFF	OFF	0.021
31	OFF	OFF	OFF	OFF	0.014	0.014	0.015

Membrane	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	Yes / No	CT's met everyday? (see back)
All 4-hour turbidity readings ≤ 1 NTU?	Yes / No	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings < 5 NTU?	Yes / No	Yes / No

Notes: PRINTED NAME: David Nordman  
 SIGNATURE:  DATE: 1/9/2023  
 PHONE #: (503) 842-6462 CERT #: T08918

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of

ID#: 41 00585

Month/Year: Dec-22

Disinfection Giardia  
Log Inactiv:

1.000

Date / Time	Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.770	142.00	109.3	8.5	7.40	47.8	YES	300
2	0.800	142.00	113.6	8.7	7.36	46.6	YES	300
3	0.960	142.00	136.3	9.3	7.57	49.1	YES	300
4	0.720	142.00	102.2	8.4	7.42	48.1	YES	300
5	0.870	142.00	123.5	9.3	7.54	48.1	YES	300
6	0.730	142.00	103.7	8.7	7.50	48.6	YES	300
7	0.720	142.00	102.2	8.4	7.66	52.4	YES	300
8	0.690	142.00	98.0	8.9	7.54	48.4	YES	300
9	0.800	142.00	113.6	8.8	7.46	48.0	YES	300
10	0.860	142.00	122.1	8.9	7.42	47.3	YES	300
11	0.740	142.00	105.1	8.4	7.49	49.5	YES	300
12	0.720	142.00	102.2	8.9	7.55	48.8	YES	300
13	0.770	142.00	109.3	9.2	7.60	48.9	YES	300
14	0.800	142.00	113.6	8.4	7.47	49.4	YES	300
15	0.760	142.00	107.9	7.9	7.30	47.9	YES	300
16	1.000	142.00	142.0	8.7	7.37	47.9	YES	300
17	0.830	142.00	117.9	8.6	7.47	49.0	YES	300
18	0.780	142.00	110.8	8.2	7.36	48.1	YES	300
19	0.800	142.00	113.6	8.1	7.43	49.7	YES	300
20	0.840	142.00	119.3	8.4	7.40	48.5	YES	300
21	0.860	142.00	122.1	8.1	7.32	48.2	YES	300
22	0.710	142.00	100.8	8.1	7.61	52.5	YES	300
23	0.820	142.00	116.4	7.8	7.61	54.2	YES	300
24	0.920	142.00	130.6	8.9	7.67	52.1	YES	300
25	0.900	142.00	127.8	8.7	7.62	51.7	YES	300
26	0.700	142.00	99.4	10.2	7.56	44.8	YES	300
27	0.810	142.00	115.0	9.5	7.51	46.7	YES	300
28	0.720	142.00	102.2	9.9	7.41	43.4	YES	300
29	0.660	142.00	93.7	8.4	7.77	54.2	YES	300
30	0.740	142.00	105.1	10.3	7.54	44.4	YES	300
31	0.790	142.00	112.2	10.7	7.48	42.6	YES	300

<sup>3</sup> If Cl2 at entry point < 0.2 mg/l or CT not met, DWS to be notified by end of next business day.

Revised October 2013