

OHA - Drinking Water Services - Turbidity Monitoring Report Form

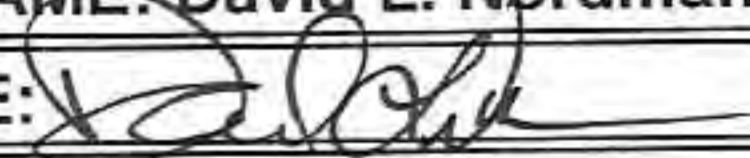
County:	Tillamook
Month/Year:	Apr-23

Membrane

System Name: Oceanside, City of ID#: 41 00585 WTP : A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1	OFF	OFF	OFF	OFF	0.015	0.014	0.015
2	OFF	OFF	OFF	OFF	0.014	0.014	0.016
3	0.014	0.014	0.014	OFF	0.015	OFF	0.017
4	OFF	OFF	OFF	OFF	0.016	0.015	0.024
5	0.015	OFF	OFF	OFF	OFF	0.015	0.015
6	0.015	OFF	OFF	OFF	0.009	OFF	0.016
7	0.015	0.015	0.015	OFF	OFF	OFF	0.016
8	0.017	0.014	OFF	OFF	OFF	OFF	0.017
9	0.015	0.014	OFF	0.015	OFF	0.014	0.015
10	0.015	OFF	0.015	0.015	0.015	OFF	0.015
11	0.014	0.014	0.014	OFF	OFF	OFF	0.017
12	OFF	OFF	OFF	OFF	0.015	0.014	0.026
13	OFF	OFF	OFF	OFF	OFF	OFF	0.017
14	OFF	OFF	0.014	0.015	OFF	OFF	0.018
15	0.014	0.014	0.014	0.015	0.014	0.014	0.015
16	OFF	OFF	OFF	OFF	OFF	0.014	0.016
17	0.014	OFF	OFF	OFF	OFF	OFF	0.016
18	OFF	OFF	0.014	0.015	0.015	0.014	0.017
19	0.014	0.014	0.014	0.015	OFF	OFF	0.015
20	OFF	OFF	OFF	OFF	0.014	OFF	0.017
21	OFF	OFF	OFF	OFF	0.015	0.014	0.018
22	0.014	OFF	OFF	OFF	OFF	OFF	0.016
23	0.014	0.014	0.015	0.015	0.015	0.014	0.015
24	0.014	OFF	OFF	OFF	OFF	OFF	0.018
25	0.014	OFF	OFF	OFF	OFF	OFF	0.016
26	0.014	OFF	OFF	OFF	OFF	0.014	0.022
27	OFF	OFF	OFF	0.014	0.014	0.014	0.016
28	0.014	0.014	0.014	OFF	OFF	OFF	0.015
29	OFF	OFF	OFF	0.014	OFF	OFF	0.016
30	OFF	OFF	0.016	0.015	0.014	OFF	0.016
31							

Membrane	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? <b>Yes / No</b>	CT's met everyday? (see back) <b>Yes / No</b>	All Cl2 residual at entry point ≥ 0.2 mg/l? <b>Yes / No</b>
All 4-hour turbidity readings ≤ 1 NTU? <b>Yes / No</b>		
All daily turbidity readings < 5 NTU? <b>Yes / No</b>		

Notes:	PRINTED NAME: David L. Nordman	
	SIGNATURE: 	DATE: 5/9/2023
	PHONE #: (503) 842-6462	CERT #: T08918

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))



OHA - Drinking Water Program - Surface Water Quality Data Form

WTP: A

System Name: Oceanside, City of      ID#: 41 00585      Month/Year: Apr-23      Disinfection Giardia Log Inactiv: 1.000

Date / Time	Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.800	142.00	113.6	9.6	7.58	47.5	YES	300
2	0.800	142.00	113.6	8.6	7.69	52.8	YES	300
3	0.830	142.00	117.9	9.0	7.76	52.9	YES	300
4	0.830	142.00	117.9	8.2	7.64	53.4	YES	300
5	0.830	142.00	117.9	8.4	7.50	50.2	YES	300
6	0.800	142.00	113.6	8.9	7.62	50.4	YES	300
7	0.800	142.00	113.6	9.2	7.56	48.4	YES	300
8	0.820	142.00	116.4	9.4	7.58	48.2	YES	300
9	0.730	142.00	103.7	10.0	7.39	42.9	YES	300
10	0.690	142.00	98.0	10.1	7.52	44.4	YES	300
11	0.730	142.00	103.7	9.2	7.38	45.1	YES	300
12	0.670	142.00	95.1	9.6	7.34	43.0	YES	300
13	0.660	142.00	93.7	9.2	7.57	47.8	YES	300
14	0.670	142.00	95.1	9.2	7.42	45.4	YES	300
15	0.800	142.00	113.6	10.0	7.31	42.0	YES	300
16	0.790	142.00	112.2	9.8	7.32	42.7	YES	300
17	0.790	142.00	112.2	10.1	7.38	42.8	YES	300
18	0.720	142.00	102.2	10.3	7.75	47.7	YES	300
19	0.850	142.00	120.7	9.6	7.51	46.6	YES	300
20	0.870	142.00	123.5	9.2	7.50	47.8	YES	300
21	0.910	142.00	129.2	9.9	7.64	48.1	YES	300
22	0.880	142.00	125.0	10.8	7.67	45.7	YES	300
23	0.820	142.00	116.4	10.2	7.53	44.9	YES	300
24	0.870	142.00	123.5	9.8	7.55	46.7	YES	300
25	0.820	142.00	116.4	9.8	7.48	45.3	YES	300
26	0.820	142.00	116.4	10.2	7.55	45.2	YES	300
27	0.770	142.00	109.3	10.6	7.49	42.9	YES	300
28	0.930	142.00	132.1	11.2	7.57	43.2	YES	300
29	1.060	142.00	150.5	11.1	7.68	45.9	YES	300
30	0.810	142.00	115.0	11.9	7.74	43.2	YES	300

<sup>3</sup> If Cl2 at entry point < 0.2 mg/l or CT not met, DWS to be notified by end of next business day.

Revised October 2013