

OHA - Drinking Water Services - Surface Water Quality Data Form
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: Baker
 Month/Year: Aug-24

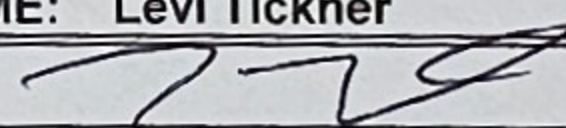
System Name: City of Sumpter ID#: 41 00815 WTP: TP -

| Day | 12 AM [NTU] | 4 AM [NTU] | 8 AM [NTU] | NOON [NTU] | 4 PM [NTU] | 8 PM [NTU] | Highest Reading of the day ¹ [NTU] |
|-----|-------------|------------|------------|------------|------------|------------|---|
| 1 | | | 0.06 | | | | 0.06 |
| 2 | | | 0.06 | | | | 0.06 |
| 3 | | | 0.06 | | | | 0.06 |
| 4 | | | 0.06 | | | | 0.06 |
| 5 | | | 0.06 | | | | 0.06 |
| 6 | | | 0.06 | | | | 0.06 |
| 7 | | | 0.06 | | | | 0.06 |
| 8 | | | 0.06 | | | | 0.06 |
| 9 | | | 0.06 | | | | 0.06 |
| 10 | | | 0.06 | | | | 0.06 |
| 11 | | | 0.08 | | | | 0.08 |
| 12 | | | 0.06 | | | | 0.06 |
| 13 | | | 0.06 | | | | 0.06 |
| 14 | | | 0.06 | | | | 0.06 |
| 15 | | | 0.06 | | | | 0.06 |
| 16 | | | 0.06 | | | | 0.06 |
| 17 | | | 0.06 | | | | 0.06 |
| 18 | | | 0.34 | | | | 0.34 |
| 19 | | | 0.34 | | | | 0.34 |
| 20 | | | 0.34 | | | | 0.34 |
| 21 | | | 0.34 | | | | 0.34 |
| 22 | | | 0.34 | | | | 0.34 |
| 23 | | | 0.34 | | | | 0.34 |
| 24 | | | 0.16 | | | | 0.16 |
| 25 | | | 0.37 | | | | 0.37 |
| 26 | | | 0.38 | | | | 0.38 |
| 27 | | | 0.37 | | | | 0.37 |
| 28 | | | 0.37 | | | | 0.37 |
| 29 | | | 0.38 | | | | 0.38 |
| 30 | | | 0.37 | | | | 0.37 |
| 31 | | | 0.38 | | | | 0.38 |

| | | | |
|---|-----|-------------------------------|-----|
| Slow Sand/Membrane/DE Filtration/Unfiltered | | | |
| 95% of daily turbidity readings ≤ 1 NTU? ² | Yes | CT's met everyday? (see back) | |
| All daily turbidity readings ≤ 5 NTU? | Yes | Yes | Yes |

Notes:

PRINTED NAME: Levi Tickner

SIGNATURE: 

DATE: 9/10/2024

PHONE #: (541)760-9362

CERT #: T-008780

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :

Disinfection *Giardia* Log

System Name: City of Sumpter

ID#: 41

~~00389~~ 00815

Month/Year: Aug-24

Inactiv:

1.0

| Date / Time | Cl ₂ Residual at 1st User (C) ³ | Contact Time (T) | Actual CT | Temp | pH | Required CT | CT Met? ³ | Peak Hourly Demand Flow |
|-------------|---|------------------|-----------|-------|------|-------------|----------------------|-------------------------|
| | [ppm or mg/L] | [minutes] | C X T | [° C] | | formula | Yes / No | [GPM] |
| 1 | 0.5 | 150 | 75.0 | 16.9 | 6.90 | 21.8 | YES | 389 |
| 2 | 0.5 | 150 | 75.0 | 17.1 | 6.90 | 21.5 | YES | 389 |
| 3 | 0.5 | 150 | 75.0 | 17.1 | 6.90 | 21.5 | YES | 389 |
| 4 | 0.5 | 150 | 75.0 | 17.2 | 6.90 | 21.4 | YES | 389 |
| 5 | 0.5 | 150 | 75.0 | 17.4 | 7.00 | 21.9 | YES | 389 |
| 6 | 0.5 | 150 | 75.0 | 18.4 | 7.00 | 20.5 | YES | 389 |
| 7 | 0.5 | 150 | 75.0 | 18.5 | 7.00 | 20.3 | YES | 389 |
| 8 | 0.6 | 150 | 90.0 | 18.2 | 7.10 | 21.8 | YES | 389 |
| 9 | 0.7 | 150 | 105.0 | 18.3 | 7.00 | 21.1 | YES | 389 |
| 10 | 0.5 | 150 | 75.0 | 18.1 | 7.00 | 20.9 | YES | 389 |
| 11 | 0.5 | 150 | 75.0 | 18.4 | 7.10 | 21.2 | YES | 389 |
| 12 | 0.5 | 150 | 75.0 | 17.8 | 7.10 | 22.1 | YES | 389 |
| 13 | 0.75 | 150 | 112.5 | 17.6 | 7.10 | 23.1 | YES | 389 |
| 14 | 0.6 | 150 | 90.0 | 17.1 | 7.10 | 23.5 | YES | 389 |
| 15 | 0.6 | 150 | 90.0 | 17.2 | 7.10 | 23.3 | YES | 389 |
| 16 | 0.6 | 150 | 90.0 | 17.0 | 7.10 | 23.6 | YES | 389 |
| 17 | 0.6 | 150 | 90.0 | 17.0 | 7.10 | 23.6 | YES | 389 |
| 18 | 0.5 | 150 | 75.0 | 17.3 | 7.10 | 22.9 | YES | 389 |
| 19 | 0.5 | 150 | 75.0 | 17.4 | 7.10 | 22.7 | YES | 389 |
| 20 | 0.5 | 150 | 75.0 | 17.4 | 7.10 | 22.7 | YES | 389 |
| 21 | 0.6 | 150 | 90.0 | 17.4 | 7.10 | 23.0 | YES | 389 |
| 22 | 0.5 | 150 | 75.0 | 16.4 | 7.20 | 25.2 | YES | 389 |
| 23 | 0.6 | 150 | 90.0 | 16.5 | 7.20 | 25.3 | YES | 389 |
| 24 | 0.5 | 150 | 75.0 | 16.2 | 7.10 | 24.6 | YES | 389 |
| 25 | 0.6 | 150 | 90.0 | 14.9 | 7.10 | 27.2 | YES | 389 |
| 26 | 0.5 | 150 | 75.0 | 14.1 | 7.10 | 28.4 | YES | 389 |
| 27 | 0.5 | 150 | 75.0 | 14.0 | 7.10 | 28.5 | YES | 389 |
| 28 | 0.6 | 150 | 90.0 | 14.1 | 7.10 | 28.7 | YES | 389 |
| 29 | 0.7 | 150 | 105.0 | 14.2 | 7.10 | 28.8 | YES | 389 |
| 30 | 0.7 | 150 | 105.0 | 14.1 | 7.10 | 29.0 | YES | 389 |
| 31 | 0.6 | 150 | 90.0 | 14.0 | 7.10 | 28.9 | YES | 389 |

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018

Return by 10th of following month by email, fax, or mail to:

dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350