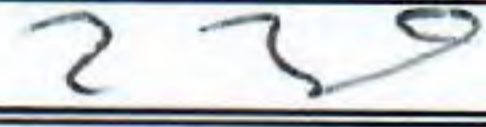


OHA - Drinking Water Services - Surface Water Quality Data Form
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: Baker
 Month/Year: January

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1			0.29				0.29
2			0.33				0.33
3			0.34				0.34
4			0.34				0.34
5			0.36				0.36
6			0.35				0.35
7			0.27				0.27
8			0.29				0.29
9			0.29				0.29
10			0.26				0.26
11			0.20				0.20
12			0.08				0.08
13			0.17				0.17
14			0.14				0.14
15			0.14				0.14
16			0.15				0.15
17			0.15				0.15
18			0.14				0.14
19			0.15				0.15
20			0.17				0.17
21			0.19				0.19
22			0.16				0.16
23			0.22				0.22
24			0.32				0.32
25			0.20				0.20
26			0.19				0.19
27			0.16				0.16
28			0.13				0.13
29			0.12				0.12
30			0.12				0.12
31			0.10				0.10

Slow Sand/Membrane/DE Filtration/Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ²	Yes	CT's met everyday? (see back)	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	Yes	Yes	Yes
Notes:		PRINTED NAME: Levi Tickner	
		SIGNATURE: 	6/10/2023
		PHONE #: (541) 760-9362	CERT #: T-008780

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :
 Disinfection *Giardia* Log
 Inactiv: 1.0

System Name: City of Sumpter ID#: 41 00845 Month/Year: Jan-23

Date / Time	Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.6	120	72.0	10.4	7.20	38.5	YES	389
2	0.6	120	72.0	10.4	7.20	38.5	YES	389
3	0.6	120	72.0	10.4	7.20	38.5	YES	389
4	0.4	120	48.0	11.9	7.50	37.9	YES	389
5	0.6	120	72.0	12.9	7.40	34.7	YES	389
6	0.4	120	48.0	13.4	7.60	35.3	YES	389
7	0.4	120	48.0	13.7	7.50	33.4	YES	389
8	0.5	120	60.0	12.9	7.40	34.3	YES	389
9	0.5	120	60.0	12.2	7.40	36.3	YES	389
10	0.5	120	60.0	11.7	7.30	36.3	YES	389
11	0.5	120	60.0	12.2	7.30	35.1	YES	389
12	0.5	120	60.0	12.3	7.30	34.9	YES	389
13	0.4	120	48.0	10.9	6.90	32.9	YES	389
14	0.4	120	48.0	10.9	6.90	32.9	YES	389
15	0.3	120	36.0	10.4	6.80	32.5	YES	389
16	0.4	120	48.0	10.4	6.70	31.8	YES	389
17	0.4	120	48.0	10.0	6.80	33.7	YES	389
18	0.5	120	60.0	10.4	6.90	34.4	YES	389
19	0.5	120	60.0	10.6	7.00	35.1	YES	389
20	0.4	120	48.0	10.8	7.00	34.3	YES	389
21	0.4	120	48.0	10.9	7.00	34.1	YES	389
22	0.5	120	60.0	10.9	7.00	34.5	YES	389
23	0.5	120	60.0	11.0	7.10	35.4	YES	389
24	0.4	120	48.0	12.5	7.00	30.1	YES	389
25	0.4	120	48.0	12.3	7.00	31.2	YES	389
26	0.4	120	48.0	12.3	7.00	31.2	YES	389
27	0.4	120	48.0	12.4	7.10	32.0	YES	389
28	0.4	120	48.0	12.6	7.20	32.2	YES	389
29	0.4	120	48.0	12.4	7.20	33.2	YES	389
30	0.4	120	48.0	13.3	7.00	28.5	YES	389
31	0.4	120	48.0	13.5	7.00	28.1	YES	389

³ If Cl2 at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018

Return by 10th of following month by email, fax, or mail to:
 dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350

30
 31
 point < 0.2 mg/l