

OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: **TILLAMOOK**
 Month/Year: **May-22**

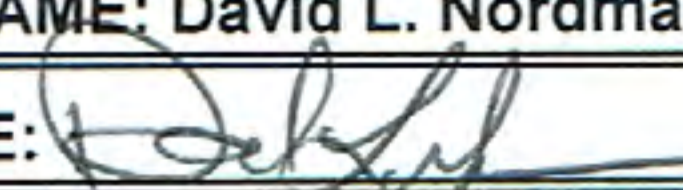
System Name: **OCEANSIDE WD - CAPE MEARES ID#: 41 00882** WTP: TP - **A**

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.008	0.008	OFF	OFF	OFF	OFF	0.01
2	0.008	0.008	OFF	OFF	OFF	OFF	0.01
3	OFF	OFF	OFF	OFF	OFF	OFF	OFF
4	OFF	OFF	OFF	OFF	OFF	0.008	0.01
5	0.008	OFF	OFF	OFF	OFF	OFF	0.01
6	OFF	OFF	OFF	0.008	0.008	OFF	0.01
7	OFF	OFF	OFF	OFF	OFF	0.008	0.01
8	0.008	OFF	OFF	OFF	OFF	OFF	0.01
9	0.008	0.008	OFF	OFF	OFF	OFF	0.01
10	OFF	OFF	0.009	0.008	0.008	OFF	0.01
11	OFF	OFF	OFF	OFF	OFF	OFF	OFF
12	0.008	0.008	OFF	OFF	OFF	OFF	0.01
13	OFF	OFF	0.008	0.008	0.008	OFF	0.01
14	OFF	OFF	OFF	OFF	OFF	OFF	OFF
15	OFF	OFF	OFF	0.008	0.008	0.008	0.01
16	OFF	0.008	OFF	OFF	OFF	OFF	0.01
17	OFF	OFF	0.008	0.008	0.008	OFF	0.01
18	OFF	OFF	OFF	OFF	OFF	OFF	OFF
19	0.008	0.008	OFF	OFF	OFF	OFF	0.01
20	OFF	OFF	0.008	0.008	0.008	OFF	0.01
21	OFF	OFF	OFF	OFF	OFF	OFF	OFF
22	0.008	OFF	OFF	OFF	OFF	0.008	0.01
23	0.008	OFF	OFF	OFF	OFF	OFF	0.01
24	OFF	0.008	0.008	OFF	OFF	OFF	0.01
25	OFF	OFF	OFF	OFF	0.008	0.008	0.01
26	0.008	OFF	OFF	OFF	OFF	OFF	0.01
27	OFF	0.008	OFF	0.008	OFF	OFF	0.01
28	OFF	OFF	OFF	OFF	0.008	0.008	0.01
29	OFF	OFF	OFF	OFF	0.008	0.008	0.01
30	0.008	OFF	OFF	OFF	OFF	0.008	0.01
31	0.008	OFF	OFF	OFF	OFF	OFF	0.01

Monthly Summary (Answer Yes or No)		
95% of daily turbidity readings \leq 1 NTU? ²	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)
All daily turbidity readings \leq 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl ₂ residual at entry point \geq 0.2 mg/l?
		<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:

PRINTED NAME: David L. Nordman

SIGNATURE: 

PHONE #: (503) 842- 6462

6/5/2022
CERT #: T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

System Name: Oceanside WD - Cape Meares ID#: 41 00882 Month/Year: May-22

Disinfection *Giardia* Log

Inactiv: 0.5

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.910	170	154.7	11.5	7.30	19.2	YES	100
2	0.950	170	161.5	10.8	7.43	21.2	YES	100
3	0.860	170	146.2	10.9	7.38	20.4	YES	100
4	0.780	170	132.6	11.2	7.52	20.9	YES	100
5	0.800	170	136.0	11.0	7.52	21.2	YES	100
6	1.330	170	226.1	11.2	7.48	21.9	YES	100
7	0.880	170	149.6	10.9	7.48	21.2	YES	100
8	0.940	170	159.8	10.6	7.52	22.1	YES	100
9	0.470	170	79.9	10.9	7.51	20.5	YES	100
10	0.420	170	71.4	10.8	7.49	20.4	YES	100
11	0.490	170	83.3	11.0	7.45	20.0	YES	100
12	1.010	170	171.7	10.7	7.54	22.3	YES	100
13	0.640	170	108.8	11.0	7.44	20.2	YES	100
14	0.740	170	125.8	11.0	7.45	20.5	YES	100
15	0.670	170	113.9	11.4	7.59	20.8	YES	100
16	0.960	170	163.2	11.2	7.47	20.9	YES	100
17	0.680	170	115.6	11.1	7.65	21.7	YES	100
18	0.710	170	120.7	11.4	7.53	20.5	YES	100
19	0.810	170	137.7	11.7	7.44	19.7	YES	100
20	0.770	170	130.9	11.6	7.58	20.7	YES	100
21	0.880	170	149.6	11.7	7.51	20.3	YES	100
22	0.940	170	159.8	11.9	7.64	21.2	YES	100
23	1.030	170	175.1	12.5	7.61	20.2	YES	100
24	0.920	170	156.4	12.3	7.64	20.6	YES	100
25	0.940	170	159.8	12.7	7.58	19.5	YES	100
26	1.010	170	171.7	12.9	7.51	18.9	YES	100
27	0.970	170	164.9	12.6	7.46	18.9	YES	100
28	1.010	170	171.7	12.6	7.52	19.4	YES	100
29	0.710	170	120.7	12.4	7.54	19.3	YES	100
30	0.660	170	112.2	12.3	7.46	18.8	YES	100
31	0.870	170	147.9	12.7	7.33	17.7	YES	100

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 h 0.00

Revised October 2013