

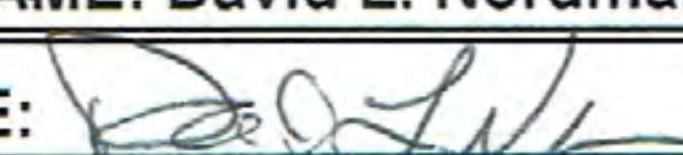
**OHA - Drinking Water Services - Turbidity Monitoring Report Form  
Membrane**

County:	Tillamook
Month/Year:	Sep-22

**System Name: Oceanside, City of**      **ID#: 41 00882**      **WTP : A**

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1	0.013	OFF	OFF	OFF	OFF	0.013	0.013
2	0.013	OFF	OFF	OFF	OFF	0.013	0.013
3	0.014	OFF	OFF	OFF	0.012	0.011	0.014
4	0.011	OFF	OFF	OFF	0.012	0.012	0.012
5	0.012	OFF	OFF	OFF	0.013	0.012	0.013
6	0.012	OFF	OFF	OFF	0.013	0.012	0.013
7	0.012	OFF	OFF	OFF	OFF	0.012	0.012
8	0.012	OFF	OFF	OFF	0.012	0.012	0.012
9	0.013	OFF	OFF	OFF	OFF	OFF	0.013
10	OFF	OFF	OFF	0.012	0.010	0.012	0.012
11	0.013	OFF	OFF	0.012	0.012	0.012	0.013
12	0.012	0.012	OFF	OFF	OFF	0.012	0.012
13	0.011	OFF	OFF	OFF	OFF	0.013	0.013
14	0.012	OFF	OFF	OFF	OFF	OFF	0.012
15	0.012	OFF	OFF	OFF	OFF	0.013	0.013
16	0.012	OFF	OFF	OFF	0.014	0.013	0.014
17	0.013	OFF	OFF	OFF	0.013	OFF	0.013
18	0.012	OFF	OFF	OFF	0.013	0.013	0.013
19	0.013	OFF	OFF	OFF	0.013	0.013	0.013
20	0.013	OFF	OFF	OFF	OFF	0.014	0.014
21	0.012	OFF	OFF	OFF	OFF	0.013	0.013
22	0.013	OFF	OFF	OFF	OFF	OFF	0.013
23	OFF	OFF	OFF	OFF	OFF	0.013	0.013
24	0.013	OFF	OFF	OFF	0.010	0.013	0.013
25	0.013	OFF	OFF	OFF	0.011	OFF	0.013
26	OFF	OFF	OFF	OFF	OFF	0.013	0.013
27	0.013	0.013	OFF	OFF	OFF	OFF	0.013
28	0.013	0.011	0.013	OFF	OFF	OFF	0.013
29	OFF	OFF	OFF	OFF	OFF	OFF	OFF
30	OFF	OFF	OFF	OFF	OFF	OFF	OFF

Membrane		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	Yes / No	CT's met everyday? (see back)	All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l?
All 4-hour turbidity readings ≤ 1 NTU?	Yes / No	Yes / No	Yes / No
All daily turbidity readings < 5 NTU?	Yes / No		

<b>Notes:</b>	<b>PRINTED NAME: David L. Nordman</b>	
	<b>SIGNATURE:</b> 	<b>DATE: 10/4/2022</b>
	<b>PHONE #: (503) 842-6462</b>	<b>CERT #: T08918</b>

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> IFE = Individ. Filter Effl. (333-061-0040(1)(e)(B&C))



OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

Disinfection *Giardia* Log

System Name: Oceanside Water District ID#: 41 00882 Month/Year: Sep-22

Inactiv: 0.5

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.7	80	56.0	16.8	7.50	14.0	YES	300
2	0.65	80	52.0	16.3	7.50	14.4	YES	300
3	0.68	80	54.4	16.6	7.54	14.4	YES	300
4	0.72	80	57.6	15.6	7.54	15.5	YES	300
5	0.75	80	60.0	15.9	7.53	15.2	YES	300
6	0.58	80	46.4	16.3	7.55	14.6	YES	300
7	0.67	80	53.6	16.5	7.52	14.4	YES	300
8	0.55	80	44.0	15.7	7.47	14.7	YES	300
9	0.64	80	51.2	16.0	7.54	14.9	YES	300
10	0.66	80	52.8	16.6	7.49	14.1	YES	300
11	0.25	80	20.0	16.9	7.51	13.3	YES	300
12	0.4	80	32.0	16.5	7.54	14.1	YES	300
13	0.48	80	38.4	16.5	7.51	14.0	YES	300
14	0.47	80	37.6	16.6	7.46	13.7	YES	300
15	0.5	80	40.0	16.4	7.47	13.9	YES	300
16	0.53	80	42.4	16.5	7.47	13.9	YES	300
17	0.62	80	49.6	15.5	7.49	15.1	YES	300
18	0.9	80	72.0	15.1	7.50	16.1	YES	300
19	0.65	80	52.0	15.8	7.53	15.1	YES	300
20	0.56	80	44.8	15.2	7.50	15.4	YES	300
21	0.43	80	34.4	15.3	7.42	14.6	YES	300
22	0.69	80	55.2	15.4	7.46	15.2	YES	300
23	0.63	80	50.4	15.7	7.46	14.8	YES	300
24	0.6	80	48.0	15.4	7.47	15.1	YES	300
25	0.88	80	70.4	14.9	7.58	16.8	YES	300
26	0.6	80	48.0	15.2	7.51	15.5	YES	300
27	0.59	80	47.2	15.1	7.50	15.5	YES	300
28	0.45	80	36.0	14.9	7.43	15.1	YES	300
29	0.41	80	32.8	15.1	7.37	14.5	YES	300
30	0.4	80	32.0	15.3	7.45	14.7	YES	300

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised October 2013