

**OHA - Drinking Water Services - Surface Water Quality Data Form**  
**Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems**

County: **TILLAMOOK**  
 Month/Year: **Dec-22**

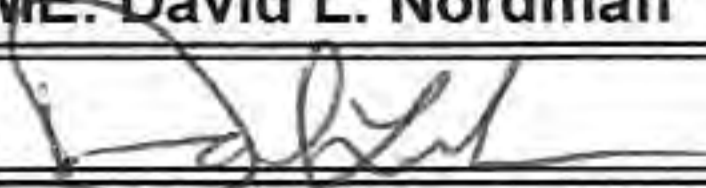
System Name: **OCEANSIDE WD - CAPE MEARES ID#: 41 00882** WTP : TP - **A**

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1	0.019	0.018	OFF	OFF	OFF	OFF	0.02
2	OFF	OFF	OFF	OFF	OFF	0.020	0.02
3	0.019	0.019	OFF	OFF	OFF	OFF	0.02
4	0.017	0.018	0.019	0.018	OFF	OFF	0.02
5	OFF	OFF	OFF	OFF	OFF	OFF	OFF
6	OFF	OFF	OFF	OFF	OFF	OFF	OFF
7	OFF	OFF	OFF	OFF	OFF	OFF	OFF
8	OFF	0.018	0.018	0.018	0.020	OFF	0.02
9	OFF	OFF	OFF	OFF	OFF	OFF	OFF
10	OFF	OFF	OFF	OFF	0.019	0.020	0.02
11	0.019	OFF	OFF	OFF	OFF	OFF	0.02
12	OFF	OFF	OFF	OFF	OFF	OFF	OFF
13	OFF	OFF	OFF	0.019	0.020	0.020	0.02
14	0.020	0.019	OFF	0.020	0.020	0.019	0.02
15	0.019	0.018	0.018	OFF	0.022	OFF	0.02
16	OFF	OFF	OFF	OFF	0.022	0.020	0.02
17	0.020	OFF	OFF	OFF	OFF	0.020	0.02
18	0.020	0.020	OFF	OFF	OFF	OFF	0.02
19	OFF	OFF	0.020	OFF	OFF	OFF	0.02
20	OFF	0.020	0.020	0.018	OFF	OFF	0.02
21	OFF	OFF	OFF	OFF	0.019	0.022	0.02
22	0.019	0.019	OFF	OFF	OFF	OFF	0.02
23	OFF	OFF	OFF	0.018	0.019	0.019	0.02
24	0.020	0.020	0.019	OFF	OFF	OFF	0.02
25	OFF	OFF	OFF	OFF	OFF	OFF	OFF
26	OFF	OFF	OFF	OFF	OFF	OFF	OFF
27	OFF	OFF	OFF	OFF	0.020	0.020	0.02
28	0.020	0.020	0.020	0.020	OFF	OFF	0.02
29	OFF	OFF	OFF	OFF	0.021	0.020	0.02
30	0.018	0.018	0.021	0.020	0.022	0.020	0.02
31	0.018	0.021	0.018	0.021	0.023	0.020	0.02

Monthly Summary (Answer Yes or No)			
95% of daily turbidity readings ≤ 1 NTU? <sup>2</sup>	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:

PRINTED NAME: **David L. Nordman**

SIGNATURE:  **1-9-2023**

PHONE #: **( 503 ) 842- 6462** CERT #: **T08918**

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

System Name: Oceanside WD - Cape Meares ID#: 41 00882 Month/Year: Dec-22

Disinfection *Giardia* Log Inactiv: 0.5

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	<b>C X T</b>	[° C]		formula	Yes / No	[GPM]
1	0.800	170	136.0	8.7	7.32	23.0	YES	100
2	0.730	170	124.1	7.4	7.46	26.1	YES	100
3	0.770	170	130.9	7.6	7.52	26.5	YES	100
4	0.820	170	139.4	7.6	7.59	27.3	YES	100
5	0.730	170	124.1	7.8	7.63	27.0	YES	100
6	0.710	170	120.7	7.7	7.65	27.3	YES	100
7	0.800	170	136.0	7.9	7.66	27.4	YES	100
8	0.840	170	142.8	7.9	7.50	26.0	YES	100
9	0.760	170	129.2	9.8	7.87	25.8	YES	100
10	0.730	170	124.1	7.9	7.74	27.9	YES	100
11	0.820	170	139.4	7.9	7.50	25.9	YES	100
12	0.830	170	141.1	8.0	7.67	27.4	YES	100
13	0.630	170	107.1	7.7	7.65	27.1	YES	100
14	0.770	170	130.9	7.9	7.60	26.7	YES	100
15	0.930	170	158.1	8.1	7.74	28.2	YES	100
16	0.910	170	154.7	7.6	7.72	28.9	YES	100
17	0.930	170	158.1	7.5	7.76	29.6	YES	100
18	0.690	170	117.3	7.6	7.78	28.8	YES	100
19	0.700	170	119.0	7.4	7.84	29.9	YES	100
20	0.850	170	144.5	8.0	7.40	24.9	YES	100
21	0.970	170	164.9	6.9	7.64	29.6	YES	100
22	0.790	170	134.3	6.5	7.46	28.0	YES	100
23	0.910	170	154.7	7.5	7.38	25.8	YES	100
24	1.030	170	175.1	7.5	7.40	26.3	YES	100
25	0.800	170	136.0	8.0	7.45	25.2	YES	100
26	0.800	170	136.0	8.7	7.40	23.6	YES	100
27	0.800	170	136.0	8.9	7.58	24.9	YES	100
28	0.930	170	158.1	9.7	7.47	23.0	YES	100
29	0.850	170	144.5	9.0	7.55	24.6	YES	100
30	0.950	170	161.5	9.7	7.52	23.5	YES	100
31	0.960	170	163.2	9.8	7.41	22.5	YES	100

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 h

0.00

Revised October 2013