

OHA - Drinking Water Services - Surface Water Quality Data Form  
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: TILLAMOOK  
 Month/Year: Jan-23

System Name: OCEANSIDE WD - CAPE MEARES ID#: 41 00882 WTP : TP - A

| Day | 12 AM [NTU] | 4 AM [NTU] | 8 AM [NTU] | NOON [NTU] | 4 PM [NTU] | 8 PM [NTU] | Highest Reading of the day <sup>1</sup> [NTU] |
|-----|-------------|------------|------------|------------|------------|------------|---|
| 1   | 0.019       | 0.018      | 0.020      | 0.017      | 0.019      | 0.020      | 0.02  |
| 2   | 0.020       | 0.020      | 0.020      | 0.020      | OFF        | OFF        | 0.02  |
| 3   | OFF         | OFF        | 0.020      | 0.021      | 0.021      | 0.021      | 0.02  |
| 4   | OFF         | OFF        | OFF        | OFF        | OFF        | OFF        | OFF   |
| 5   | OFF         | OFF        | 0.027      | 0.019      | 0.019      | 0.019      | 0.03  |
| 6   | 0.021       | 0.021      | 0.021      | OFF        | OFF        | OFF        | 0.02  |
| 7   | 0.023       | OFF        | OFF        | OFF        | OFF        | OFF        | 0.02  |
| 8   | OFF         | 0.023      | OFF        | OFF        | OFF        | 0.024      | 0.02  |
| 9   | 0.023       | OFF        | OFF        | OFF        | OFF        | OFF        | 0.02  |
| 10  | OFF         | OFF        | OFF        | 0.022      | 0.024      | 0.024      | 0.02  |
| 11  | 0.024       | 0.021      | 0.024      | 0.020      | OFF        | OFF        | 0.02  |
| 12  | OFF         | OFF        | 0.025      | 0.023      | 0.024      | OFF        | 0.03  |
| 13  | OFF         | OFF        | OFF        | OFF        | 0.026      | 0.024      | 0.03  |
| 14  | 0.023       | 0.019      | OFF        | OFF        | OFF        | 0.025      | 0.03  |
| 15  | 0.024       | 0.024      | 0.024      | OFF        | OFF        | 0.024      | 0.02  |
| 16  | 0.023       | 0.023      | 0.024      | OFF        | OFF        | OFF        | 0.02  |
| 17  | OFF         | 0.020      | 0.022      | 0.021      | 0.024      | OFF        | 0.02  |
| 18  | OFF         | OFF        | OFF        | OFF        | OFF        | 0.024      | 0.02  |
| 19  | 0.024       | OFF        | OFF        | OFF        | OFF        | 0.023      | 0.02  |
| 20  | 0.023       | 0.023      | 0.023      | 0.019      | OFF        | OFF        | 0.02  |
| 21  | OFF         | OFF        | 0.017      | 0.018      | 0.018      | 0.018      | 0.02  |
| 22  | 0.018       | OFF        | OFF        | OFF        | OFF        | 0.018      | 0.02  |
| 23  | 0.018       | 0.018      | OFF        | OFF        | OFF        | 0.018      | 0.02  |
| 24  | 0.018       | 0.018      | 0.017      | OFF        | OFF        | OFF        | 0.02  |
| 25  | 0.020       | 0.021      | 0.018      | 0.019      | OFF        | OFF        | 0.02  |
| 26  | OFF         | OFF        | OFF        | 0.019      | 0.019      | 0.019      | 0.02  |
| 27  | 0.019       | OFF        | OFF        | OFF        | 0.020      | 0.019      | 0.02  |
| 28  | OFF         | 0.018      | OFF        | OFF        | OFF        | OFF        | 0.02  |
| 29  | 0.021       | OFF        | 0.018      | 0.015      | OFF        | OFF        | 0.02  |
| 30  | OFF         | OFF        | 0.020      | 0.015      | 0.020      | 0.019      | 0.02  |
| 31  | 0.019       | OFF        | OFF        | OFF        | 0.020      | 0.019      | 0.02  |

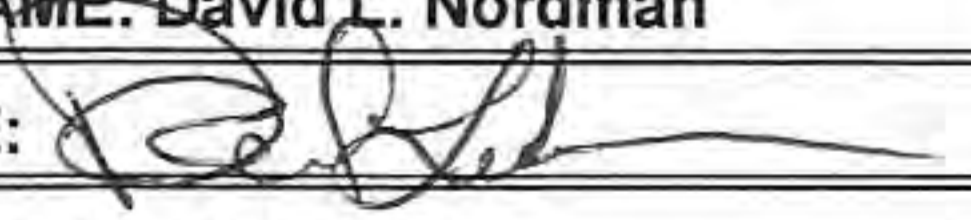
Monthly Summary (Answer Yes or No)

95% of daily turbidity readings  $\leq$  1 NTU? <sup>2</sup>  Yes /  No  
 All daily turbidity readings  $\leq$  5 NTU?  Yes /  No

CT's met everyday? (see back)  Yes /  No

All Cl<sub>2</sub> residual at entry point  $\geq$  0.2 mg/l?  Yes /  No

Notes:

PRINTED NAME: David L. Nordman  
 SIGNATURE:  2/6/2023  
 PHONE #: ( 503 ) 842- 6462 CERT #: T08918

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

System Name: Oceanside WD - Cape Meares ID#: 41 00882 Month/Year: Jan-23

Disinfection *Giardia* Log Inactiv: 0.5

| Date / Time | Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup> | Contact Time (T) | Actual CT | Temp  | pH   | Required CT | CT Met? <sup>3</sup> | Peak Hourly Demand Flow |
|-------------|---|------------------|-----------|-------|------|-------------|----------------------|-------------------------|
|             | [ppm or mg/L]   | [minutes]        | C X T     | [° C] |      | formula     | Yes / No             | [GPM]                   |
| 1           | 1.080   | 170              | 183.6     | 9.4   | 7.44 | 23.6        | YES                  | 100                     |
| 2           | 0.900   | 170              | 153.0     | 9.0   | 7.48 | 24.1        | YES                  | 100                     |
| 3           | 0.740   | 170              | 125.8     | 9.2   | 7.49 | 23.4        | YES                  | 100                     |
| 4           | 0.850   | 170              | 144.5     | 8.5   | 7.42 | 24.3        | YES                  | 100                     |
| 5           | 0.690   | 170              | 117.3     | 9.2   | 7.33 | 22.0        | YES                  | 100                     |
| 6           | 0.860   | 170              | 146.2     | 9.7   | 7.43 | 22.5        | YES                  | 100                     |
| 7           | 0.900   | 170              | 153.0     | 9.1   | 7.31 | 22.6        | YES                  | 100                     |
| 8           | 0.580   | 170              | 98.6      | 9.1   | 7.38 | 22.3        | YES                  | 100                     |
| 9           | 0.700   | 170              | 119.0     | 9.1   | 7.46 | 23.2        | YES                  | 100                     |
| 10          | 1.030   | 170              | 175.1     | 9.0   | 7.69 | 26.4        | YES                  | 100                     |
| 11          | 0.780   | 170              | 132.6     | 9.8   | 7.44 | 22.2        | YES                  | 100                     |
| 12          | 0.860   | 170              | 146.2     | 9.9   | 7.36 | 21.7        | YES                  | 100                     |
| 13          | 0.860   | 170              | 146.2     | 9.6   | 7.51 | 23.3        | YES                  | 100                     |
| 14          | 0.820   | 170              | 139.4     | 9.7   | 7.64 | 24.1        | YES                  | 100                     |
| 15          | 0.750   | 170              | 127.5     | 9.6   | 7.57 | 23.5        | YES                  | 100                     |
| 16          | 0.850   | 170              | 144.5     | 9.6   | 7.67 | 24.6        | YES                  | 100                     |
| 17          | 0.890   | 170              | 151.3     | 9.5   | 7.60 | 24.3        | YES                  | 100                     |
| 18          | 0.860   | 170              | 146.2     | 9.2   | 7.72 | 25.8        | YES                  | 100                     |
| 19          | 0.690   | 170              | 117.3     | 9.2   | 7.27 | 21.6        | YES                  | 100                     |
| 20          | 0.810   | 170              | 137.7     | 9.1   | 7.42 | 23.2        | YES                  | 100                     |
| 21          | 0.800   | 170              | 136.0     | 8.7   | 7.55 | 24.9        | YES                  | 100                     |
| 22          | 0.850   | 170              | 144.5     | 8.7   | 7.61 | 25.6        | YES                  | 100                     |
| 23          | 0.810   | 170              | 137.7     | 8.5   | 7.58 | 25.6        | YES                  | 100                     |
| 24          | 0.820   | 170              | 139.4     | 8.4   | 7.41 | 24.3        | YES                  | 100                     |
| 25          | 0.820   | 170              | 139.4     | 8.4   | 7.58 | 25.8        | YES                  | 100                     |
| 26          | 0.960   | 170              | 163.2     | 9.8   | 7.57 | 23.8        | YES                  | 100                     |
| 27          | 0.890   | 170              | 151.3     | 8.6   | 7.88 | 28.5        | YES                  | 100                     |
| 28          | 0.870   | 170              | 147.9     | 8.4   | 8.11 | 31.4        | YES                  | 100                     |
| 29          | 0.760   | 170              | 129.2     | 7.8   | 7.99 | 30.9        | YES                  | 100                     |
| 30          | 0.760   | 170              | 129.2     | 8.1   | 7.58 | 26.1        | YES                  | 100                     |
| 31          | 0.880   | 170              | 149.6     | 7.7   | 7.91 | 30.6        | YES                  | 100                     |

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 h

0.00

Revised October 2013