

OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: **TILLAMOOK**
 Month/Year: **Jul-23**
 WTP : TP - **1.0**

System Name: **OCEANSIDE WD - CAPE MEARES ID#: 41 00882**

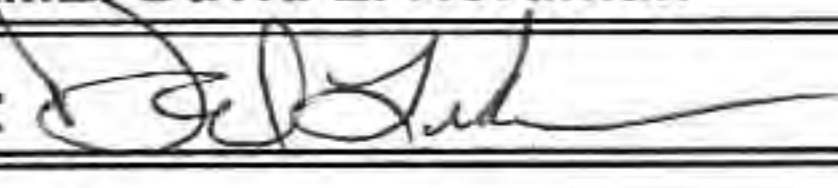
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	7/1/2023
1	0.018	OFF	OFF	OFF	0.016	0.016	0.02
2	0.016	OFF	OFF	OFF	0.016	0.016	0.02
3	0.016	OFF	OFF	0.016	0.017	0.016	0.02
4	0.016	OFF	OFF	0.018	0.018	0.018	0.02
5	0.018	0.018	0.016	0.015	0.014	0.014	0.02
6	OFF	OFF	OFF	0.014	0.014	OFF	0.01
7	OFF	OFF	OFF	0.014	0.014	0.014	0.01
8	OFF	OFF	OFF	OFF	0.014	0.014	0.01
9	0.014	OFF	OFF	OFF	0.014	0.014	0.01
10	0.014	OFF	OFF	OFF	0.014	0.014	0.01
11	0.014	OFF	OFF	OFF	0.013	0.013	0.01
12	0.014	OFF	OFF	OFF	0.015	0.014	0.02
13	0.013	OFF	OFF	OFF	0.015	0.013	0.02
14	0.014	OFF	OFF	OFF	0.013	0.013	0.01
15	0.013	OFF	OFF	OFF	0.014	0.014	0.01
16	0.014	OFF	OFF	OFF	0.014	0.013	0.01
17	0.014	OFF	OFF	OFF	OFF	OFF	0.01
18	OFF	OFF	0.014	0.014	0.014	0.014	0.01
19	0.014	OFF	OFF	OFF	OFF	OFF	0.01
20	OFF	OFF	OFF	OFF	0.013	0.013	0.01
21	0.013	OFF	OFF	OFF	0.013	0.013	0.01
22	0.013	OFF	OFF	OFF	0.013	0.013	0.01
23	0.013	OFF	OFF	OFF	0.013	0.013	0.01
24	0.014	OFF	OFF	OFF	OFF	0.014	0.01
25	OFF	OFF	OFF	OFF	OFF	OFF	OFF
26	OFF	OFF	OFF	0.016	0.016	0.017	0.02
27	0.016	0.016	0.016	0.016	0.016	0.016	0.02
28	OFF	OFF	OFF	OFF	0.016	0.016	0.02
29	0.017	OFF	OFF	OFF	0.016	0.016	0.02
30	0.016	OFF	OFF	OFF	0.016	0.016	0.02
31	0.016	OFF	OFF	OFF	0.018	0.017	0.02

Monthly Summary (Answer Yes or No)

95% of daily turbidity readings \leq 1 NTU? ²	Yes / No	CT's met everyday? (see back)	All Cl ₂ residual at entry point \geq 0.2 mg/l?
All daily turbidity readings \leq 5 NTU?	Yes / No	Yes / No	Yes / No

Notes:

PRINTED NAME: David L. Nordman

SIGNATURE:  **8/9/2023**

PHONE #: (503) 842- 6462 **CERT #:** T08918

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A
 Disinfection *Giardia* Log Inactiv: 0.5

System Name: Oceanside WD - Cape Meares ID#: 41 00882 Month/Year: Jul-23

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.630	170	107.1	16.5	7.55	14.5	YES	100
2	0.530	170	90.1	15.5	7.61	15.7	YES	100
3	0.400	170	68.0	15.1	7.66	16.1	YES	100
4	0.620	170	105.4	15.5	7.71	16.4	YES	100
5	0.580	170	98.6	15.4	7.71	16.4	YES	100
6	0.460	170	78.2	15.2	7.64	16.0	YES	100
7	0.530	170	90.1	15.0	7.70	16.7	YES	100
8	7.490	170	1273.3	15.2	7.49	33.6	YES	100
9	0.570	170	96.9	15.4	7.55	15.5	YES	100
10	0.570	170	96.9	15.9	7.56	15.0	YES	100
11	0.610	170	103.7	16.0	7.50	14.7	YES	100
12	0.580	170	98.6	16.2	7.50	14.4	YES	100
13	0.550	170	93.5	16.2	7.54	14.6	YES	100
14	0.590	170	100.3	16.5	7.52	14.3	YES	100
15	0.580	170	98.6	16.0	7.44	14.3	YES	100
16	0.660	170	112.2	15.9	7.54	15.1	YES	100
17	0.670	170	113.9	16.3	7.45	14.2	YES	100
18	0.630	170	107.1	16.1	7.46	14.4	YES	100
19	0.680	170	115.6	16.0	7.50	14.8	YES	100
20	0.650	170	110.5	16.7	7.51	14.1	YES	100
21	0.680	170	115.6	16.4	7.48	14.3	YES	100
22	0.610	170	103.7	17.4	7.40	12.9	YES	100
23	0.730	170	124.1	16.2	7.48	14.6	YES	100
24	0.700	170	119.0	16.5	7.49	14.3	YES	100
25	0.660	170	112.2	16.9	7.55	14.2	YES	100
26	0.660	170	112.2	17.1	7.48	13.6	YES	100
27	0.730	170	124.1	16.2	7.56	15.0	YES	100
28	0.680	170	115.6	17.1	7.50	13.7	YES	100
29	0.710	170	120.7	16.7	7.48	14.1	YES	100
30	0.690	170	117.3	16.3	7.50	14.5	YES	100
31	0.750	170	127.5	16.2	7.44	14.4	YES	100

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 h 0.00