

OHA - Drinking Water Services - Surface Water Quality Data Form  
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: TILLAMOOK  
 Month/Year: Oct-23

System Name: OCEANSIDE WD - CAPE MEARES ID#: 41 00882 WTP : TP - 1.0

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	4/1/2023
1	OFF	OFF	OFF	OFF	OFF	0.016	0.02
2	0.017	OFF	OFF	OFF	OFF	OFF	0.02
3	0.017	OFF	OFF	OFF	OFF	OFF	0.02
4	OFF	OFF	OFF	0.016	0.016	OFF	0.02
5	OFF	OFF	OFF	OFF	0.017	0.016	0.02
6	0.016	OFF	OFF	OFF	OFF	OFF	0.02
7	0.016	0.016	OFF	OFF	OFF	OFF	0.02
8	OFF	0.017	0.016	OFF	OFF	OFF	0.02
9	OFF	OFF	0.016	0.016	OFF	OFF	0.02
10	OFF	OFF	0.017	0.017	OFF	OFF	0.02
11	OFF	OFF	OFF	OFF	OFF	OFF	OFF
12	OFF	OFF	OFF	0.016	0.016	0.016	0.02
13	0.016	0.016	OFF	OFF	OFF	OFF	0.02
14	0.022	0.022	OFF	OFF	OFF	OFF	0.02
15	0.022	0.022	OFF	OFF	OFF	OFF	0.02
16	OFF	OFF	OFF	OFF	OFF	OFF	OFF
17	OFF	OFF	OFF	OFF	0.021	0.022	0.02
18	OFF	OFF	OFF	OFF	OFF	OFF	OFF
19	0.023	0.023	OFF	OFF	OFF	OFF	0.02
20	OFF	OFF	OFF	OFF	OFF	OFF	OFF
21	OFF	OFF	OFF	OFF	OFF	OFF	OFF
22	OFF	OFF	OFF	0.024	OFF	OFF	0.02
23	OFF	OFF	OFF	OFF	OFF	OFF	OFF
24	OFF	OFF	OFF	OFF	OFF	OFF	OFF
25	OFF	OFF	0.022	0.022	0.022	0.021	0.02
26	0.021	0.021	0.021	OFF	OFF	OFF	0.02
27	OFF	OFF	OFF	OFF	OFF	OFF	OFF
28	OFF	OFF	OFF	0.022	0.012	0.021	0.02
29	0.021	0.021	OFF	OFF	OFF	OFF	0.02
30	OFF	OFF	OFF	OFF	OFF	OFF	OFF
31	OFF	OFF	0.023	0.022	0.022	0.022	0.02

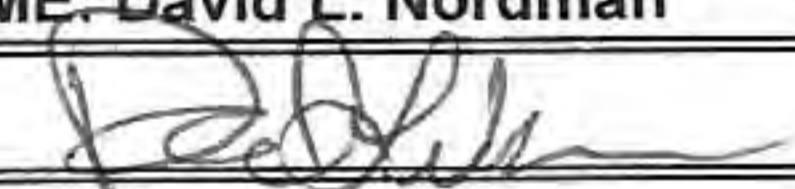
Monthly Summary (Answer Yes or No)

95% of daily turbidity readings  $\leq$  1 NTU? <sup>2</sup>  Yes /  No  
 All daily turbidity readings  $\leq$  5 NTU?  Yes /  No

CT's met everyday? (see back)  Yes /  No

All Cl2 residual at entry point  $\geq$  0.2 mg/l?  Yes /  No

Notes:

PRINTED NAME: David L. Nordman  
 SIGNATURE:   
 PHONE #: ( 503 ) 842- 6462  
 CERT #: T08918  
 11/10/2023

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> Filtered systems only.



OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

System Name: Oceanside WD - Cape Meares ID#: 41 00882 Month/Year: Oct-23

Disinfection *Giardia* Log Inactiv: 0.5

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.930	170	158.1	13.9	7.72	19.0	YES	100
2	0.510	170	86.7	14.1	7.72	17.9	YES	100
3	0.400	170	68.0	15.5	7.66	15.7	YES	100
4	0.310	170	52.7	14.7	7.68	16.5	YES	100
5	0.460	170	78.2	16.6	7.64	14.6	YES	100
6	0.420	170	71.4	15.7	7.59	15.1	YES	100
7	0.430	170	73.1	17.5	7.62	13.6	YES	100
8	0.560	170	95.2	15.3	7.64	16.1	YES	100
9	0.580	170	98.6	16.1	7.66	15.4	YES	100
10	0.580	170	98.6	15.4	7.68	16.3	YES	100
11	0.500	170	85.0	14.8	7.77	17.3	YES	100
12	0.470	170	79.9	14.5	7.63	16.7	YES	100
13	0.840	170	142.8	15.0	7.56	16.5	YES	100
14	0.680	170	115.6	15.3	7.53	15.7	YES	100
15	0.980	170	166.6	14.6	7.51	16.9	YES	100
16	0.630	170	107.1	15.1	7.62	16.3	YES	100
17	0.710	170	120.7	14.3	7.59	17.2	YES	100
18	0.560	170	95.2	15.0	7.51	15.7	YES	100
19	0.650	170	110.5	15.1	7.54	15.9	YES	100
20	0.620	170	105.4	14.9	7.62	16.5	YES	100
21	0.770	170	130.9	15.0	7.54	16.2	YES	100
22	0.900	170	153.0	14.8	7.63	17.2	YES	100
23	0.790	170	134.3	14.9	7.64	17.0	YES	100
24	0.800	170	136.0	14.0	7.61	17.8	YES	100
25	0.890	170	151.3	13.7	7.68	18.9	YES	100
26	0.900	170	153.0	12.8	7.55	19.1	YES	100
27	0.790	170	134.3	13.5	7.65	18.7	YES	100
28	0.770	170	130.9	12.6	7.77	20.7	YES	100
29	0.700	170	119.0	11.4	7.84	22.8	YES	100
30	0.620	170	105.4	12.5	7.76	20.4	YES	100
31	0.560	170	95.2	13.1	7.62	18.5	YES	100

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 h 0.00

Revised October 2013