

OHA - Drinking Water Services - Surface Water Quality Data Form
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

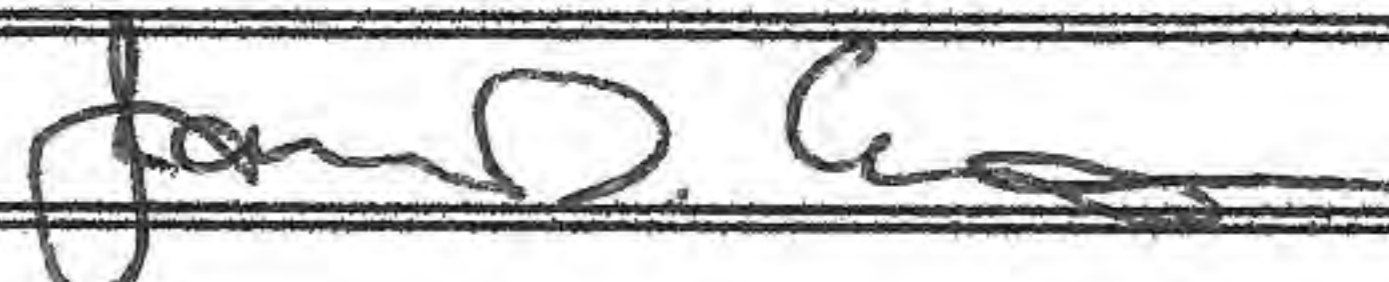
County: Lane
 Month/Year: 24-Mar

System Name: Row River Valley Water District ID#: 41 01515 WTP: TP - A

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.03	0.03	0.03	0.03	0.03	0.03	0.03
2	0.03	0.03	0.03	0.03	0.03	0.03	0.03
3	0.04	0.03	0.03	0.03	0.03	0.03	0.03
4	0.03	0.03	0.03	0.03	0.03	0.03	0.03
5	0.03	0.03	0.03	0.03	0.03	0.03	0.03
6	0.03	0.03	0.03	0.03	0.03	0.03	0.03
7	0.03	0.03	0.03	0.03	0.03	0.03	0.03
8	0.03	0.03	0.03	0.03	0.03	0.03	0.03
9	0.03	0.03	0.03	0.03	0.03	0.03	0.03
10	0.03	0.03	0.03	0.03	0.03	0.03	0.03
11	0.03	0.03	0.03	0.03	0.03	0.03	0.03
12	0.03	0.03	0.03	0.03	0.03	0.03	0.03
13	0.03	0.03	0.03	0.03	0.03	0.03	0.03
14	0.03	0.03	0.03	0.03	0.03	0.30	0.03
15	0.03	0.03	0.03	0.03	0.03	0.03	0.03
16	0.03	0.03	0.03	0.03	0.03	0.03	0.03
17	0.03	0.03	0.03	0.03	0.03	0.03	0.03
18	0.03	0.03	0.03	0.03	0.03	0.03	0.03
19	0.03	0.03	0.03	0.03	0.03	0.03	0.03
20	0.03	0.03	0.03	0.03	0.03	0.03	0.03
21	0.03	0.03	0.03	0.03	0.03	0.03	0.03
22	0.03	0.03	0.03	0.03	0.03	0.03	0.03
23	0.03	0.03	0.03	0.03	0.03	0.03	0.03
24	0.03	0.03	0.03	0.03	0.03	0.03	0.03
25	0.03	0.03	0.03	0.03	0.03	0.03	0.03
26	0.03	0.03	0.03	0.03	0.03	0.03	0.03
27	0.03	0.03	0.03	0.03	0.03	0.03	0.03
28	0.03	0.03	0.03	0.03	0.03	0.03	0.03
29	0.03	0.03	0.03	0.03	0.03	0.03	0.03
30	0.03	0.03	0.03	0.03	0.03	0.03	0.03
31	0.03	0.03	0.03	0.03	0.03	0.03	0.03

Slow Sand/Membrane/DE Filtration/Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ²	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:

James D Eckstine
 SIGNATURE: 
 541-946-1655

Apr-24

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A
 Disinfection *Giardia* Log Inactiv: 1.0

System Name: Row River Vally Water Dis ID#: 41 01515 Month/Year: 24-Mar

	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/l]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.16	1185	1374.6	6.0	7.36	58.2	YES	290
2	1.15	1185	1362.8	6.0	7.39	58.8	YES	290
3	1.52	1185	1801.2	7.0	7.20	53.6	YES	290
4	1.61	1185	1907.9	7.0	7.40	58.2	YES	290
5	1.69	1185	2002.7	6.0	7.37	62.1	YES	290
6	1.59	1185	1884.2	6.0	7.32	60.3	YES	290
7	1.61	1185	1907.9	6.0	7.33	60.7	YES	200
8	1.75	1185	2073.8	6.0	0.33	8.0	YES	200
9	1.8	1185	2133.0	6.0	7.37	63.0	YES	200
10	1.75	1185	2073.8	7.0	7.35	58.1	YES	200
11	1.7	1185	2014.5	7.0	7.38	58.3	YES	200
12	1.73	1185	2050.1	7.0	7.39	58.8	YES	200
13	1.65	1185	1955.3	8.0	7.36	53.8	YES	200
14	1.68	1185	1990.8	7.0	7.34	57.4	YES	200
15	1.72	1185	2038.2	8.0	7.35	54.1	YES	200
16	1.73	1185	2050.1	8.0	7.37	54.5	YES	200
17	1.58	1185	1872.3	7.0	7.35	56.9	YES	200
18	1.28	1185	1516.8	9.0	7.29	47.1	YES	200
19	1.25	1185	1481.3	8.0	7.36	51.4	YES	200
20	1.23	1185	1457.6	9.0	7.32	47.3	YES	200
21	1.39	1185	1647.2	9.0	7.30	47.8	YES	200
22	1.47	1185	1742.0	8.0	7.30	51.6	YES	200
23	1.5	1185	1777.5	9.0	7.33	49.0	YES	200
24	1.48	1185	1753.8	7.0	7.30	55.3	YES	200
25	1.49	1185	1765.7	8.0	7.27	51.2	YES	200
26	1.45	1185	1718.3	8.0	7.30	51.5	YES	200
27	1.25	1185	1481.3	8.0	7.34	51.1	YES	200
28	1.27	1185	1505.0	8.0	7.35	51.4	YES	280
29	1.27	1185	1505.0	8.0	7.30	50.4	YES	280
30	1.32	1185	1564.2	8.0	7.32	51.1	YES	280
31	1.35	1185	1599.8	7.0	7.35	55.4	YES	280

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018