

OHA - Drinking Water Services - Surface Water Quality Data Form  
 Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

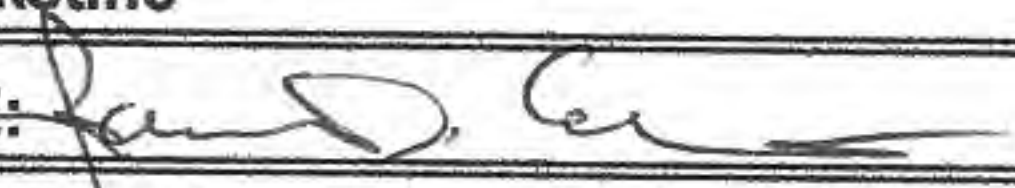
County: Lane  
 Month/Year: 24-Oct  
 WTP: TP - A

System Name: Row River Valley Water District ID#: 41 01515

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1	0.03	0.03	0.03	0.03	0.03	0.03	0.03
2	0.03	0.03	0.03	0.03	0.03	0.03	0.03
3	0.03	0.03	0.03	0.03	0.03	0.03	0.03
4	0.03	0.03	0.03	0.03	0.03	0.03	0.03
5	0.03	0.03	0.03	0.03	0.03	0.03	0.03
6	0.03	0.03	0.03	0.03	0.03	0.03	0.03
7	0.03	0.03	0.03	0.03	0.03	0.03	0.03
8	0.03	0.03	0.03	0.03	0.03	0.03	0.03
9	0.03	0.03	0.03	0.03	0.03	0.03	0.03
10	0.03	0.03	0.03	0.03	0.03	0.03	0.03
11	0.03	0.03	0.03	0.03	0.03	0.03	0.03
12	0.03	0.03	0.03	0.03	0.03	0.03	0.03
13	0.03	0.03	0.03	0.03	0.03	0.03	0.03
14	0.03	0.03	0.03	0.03	0.03	0.30	0.03
15	0.03	0.03	0.03	0.03	0.03	0.03	0.03
16	0.03	0.03	0.03	0.03	0.03	0.03	0.03
17	0.03	0.03	0.03	0.03	0.03	0.03	0.03
18	0.03	0.03	0.03	0.03	0.03	0.03	0.03
19	0.03	0.03	0.03	0.03	0.03	0.03	0.03
20	0.03	0.03	0.03	0.03	0.03	0.03	0.03
21	0.03	0.03	0.03	0.03	0.03	0.03	0.03
22	0.03	0.03	0.03	0.03	0.03	0.03	0.03
23	0.03	0.03	0.03	0.03	0.03	0.03	0.03
24	0.03	0.03	0.03	0.03	0.03	0.03	0.03
25	0.03	0.03	0.03	0.03	0.03	0.03	0.03
26	0.03	0.03	0.03	0.03	0.03	0.03	0.03
27	0.03	0.03	0.03	0.03	0.03	0.03	0.03
28	0.03	0.03	0.03	0.03	0.03	0.03	0.03
29	0.03	0.03	0.03	0.03	0.03	0.03	0.03
30	0.03	0.03	0.03	0.03	0.03	0.03	0.03
30	0.03	0.03	0.03	0.03	0.03	0.03	0.03

<b>Slow Sand/Membrane/DE Filtration/Unfiltered</b>		<b>Monthly Summary (Answer Yes or No)</b>	
95% of daily turbidity readings ≤ 1 NTU? <sup>2</sup>	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:

James D Eckstine  
 SIGNATURE:   
 541-946-1655  
 Nov-24

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> Filtered systems only.



OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A  
 Disinfection *Giardia* Log Inactiv: 1.0

System Name: Row River Vally Water Dis ID#: 41 01515 Month/Year: 24-Oct

	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.34	1185	1587.9	12.0	7.16	37.2	YES	230
2	1.36	1185	1611.6	12.0	7.17	37.4	YES	230
3	1.4	1185	1659.0	12.0	7.18	37.7	YES	230
4	1.43	1185	1694.6	11.0	7.20	40.7	YES	230
5	1.45	1185	1718.3	11.0	7.20	40.8	YES	230
6	1.48	1185	1753.8	11.0	7.19	40.7	YES	230
7	1.4	1185	1659.0	12.0	7.20	38.0	YES	230
8	1.46	1185	1730.1	12.0	7.18	38.0	YES	230
9	1.5	1185	1777.5	13.0	7.18	35.2	YES	230
10	1.51	1185	1789.4	13.0	7.20	35.5	YES	230
11	1.55	1185	1836.8	13.0	7.23	36.1	YES	230
12	1.55	1185	1836.8	13.0	7.18	35.4	YES	230
13	1.56	1185	1848.6	13.0	7.16	35.2	YES	230
14	1.56	1185	1848.6	13.0	7.14	34.9	YES	230
15	1.4	1185	1659.0	13.0	7.15	34.4	YES	230
16	1.35	1185	1599.8	13.0	7.18	34.6	YES	230
17	1.28	1185	1516.8	13.0	7.15	34.0	YES	230
18	1.2	1185	1422.0	11.0	7.13	38.7	YES	230
19	1.22	1185	1445.7	11.0	7.18	39.4	YES	230
20	1.29	1185	1528.7	12.0	7.14	36.7	YES	230
21	1.03	1185	1220.6	12.0	7.13	35.6	YES	230
22	1.07	1185	1268.0	14.0	7.15	31.0	YES	230
23	1.02	1185	1208.7	11.0	7.15	38.2	YES	230
24	1.15	1185	1362.8	10.0	7.16	41.5	YES	230
25	1.41	1185	1670.9	8.0	7.17	48.9	YES	230
26	1.63	1185	1931.6	10.0	7.18	44.1	YES	230
27	1.75	1185	2073.8	11.0	7.20	42.1	YES	230
28	1.26	1185	1493.1	11.0	7.23	40.3	YES	230
29	1.03	1185	1220.6	10.0	7.23	41.9	YES	230
30	1.09	1185	1291.7	9.0	7.20	44.6	YES	230
31	1.27	1185	1505.0	9.0	7.21	45.7	YES	230

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not me

Revised July 2018