

OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

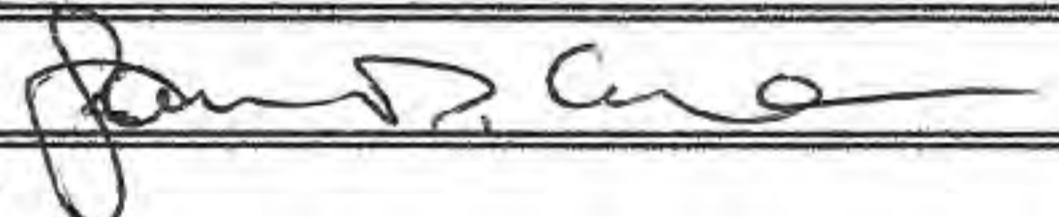
County: **Lane**
 Month/Year: **24-Dec**
 WTP: TP - **A**

System Name: **Row River Valley Water District ID#: 41 01515**

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.03	0.03	0.03	0.03	0.03	0.03	0.03
2	0.03	0.03	0.03	0.03	0.03	0.03	0.03
3	0.03	0.03	0.03	0.03	0.03	0.03	0.03
4	0.03	0.03	0.03	0.03	0.03	0.03	0.03
5	0.03	0.03	0.03	0.03	0.03	0.03	0.03
6	0.03	0.03	0.03	0.03	0.03	0.03	0.03
7	0.04	0.04	0.04	0.04	0.04	0.04	0.04
8	0.04	0.04	0.04	0.04	0.04	0.03	0.04
9	0.03	0.03	0.03	0.03	0.03	0.03	0.03
10	0.03	0.03	0.03	0.03	0.03	0.03	0.03
11	0.03	0.03	0.03	0.03	0.03	0.03	0.03
12	0.03	0.04	0.04	0.04	0.04	0.04	0.04
13	0.03	0.03	0.03	0.03	0.03	0.03	0.03
14	0.03	0.03	0.03	0.03	0.03	0.30	0.03
15	0.03	0.03	0.03	0.03	0.03	0.03	0.03
16	0.03	0.03	0.03	0.03	0.03	0.03	0.03
17	0.03	0.03	0.04	0.04	0.04	0.04	0.04
18	0.04	0.04	0.04	0.04	0.04	0.04	0.04
19	0.04	0.04	0.04	0.04	0.03	0.03	0.04
20	0.03	0.03	0.03	0.03	0.03	0.03	0.03
21	0.03	0.03	0.03	0.03	0.03	0.03	0.03
22	0.03	0.03	0.03	0.03	0.03	0.03	0.03
23	0.03	0.03	0.04	0.04	0.04	0.04	0.04
24	0.04	0.04	0.04	0.04	0.04	0.04	0.04
25	0.04	0.04	0.04	0.04	0.04	0.04	0.04
26	0.04	0.04	0.04	0.04	0.04	0.04	0.04
27	0.04	0.04	0.04	0.04	0.04	0.04	0.04
28	0.04	0.04	0.04	0.04	0.04	0.04	0.04
29	0.04	0.04	0.04	0.04	0.04	0.04	0.04
30	0.04	0.04	0.04	0.04	0.04	0.04	0.04
31	0.04	0.04	0.04	0.04	0.04	0.04	0.04

Slow Sand/Membrane/DE Filtration/Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ²	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl ₂ residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes:

James D Eckstine
 SIGNATURE: 
 541-946-1655

Jan-25

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A
 Disinfection *Giardia* Log Inactiv: 1.0

System Name: Row River Vally Water Dis ID#: 41 01515 Month/Year: 24-Dec

	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/l]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.23	1185	1457.6	5.0	7.18	58.9	YES	230
2	1.19	1185	1410.2	5.0	7.16	58.2	YES	230
3	1.15	1185	1362.8	5.0	7.14	57.5	YES	230
4	1.37	1185	1623.5	5.0	7.17	59.6	YES	230
5	1.69	1185	2002.7	6.0	7.18	58.0	YES	230
6	1.71	1185	2026.4	6.0	7.18	58.2	YES	230
7	1.83	1185	2168.6	6.0	7.19	59.2	YES	230
8	1.62	1185	1919.7	8.0	7.24	51.4	YES	230
9	1.47	1185	1742.0	6.0	7.18	56.6	YES	230
10	1.58	1185	1872.3	5.0	7.10	59.6	YES	230
11	1.61	1185	1907.9	5.0	7.18	61.5	YES	230
12	1.73	1185	2050.1	6.0	7.20	58.7	YES	230
13	1.68	1185	1990.8	7.0	7.18	54.2	YES	230
14	1.71	1185	2026.4	7.0	7.22	55.1	YES	230
15	1.65	1185	1955.3	7.0	7.20	54.4	YES	230
16	1.52	1185	1801.2	9.0	7.22	47.2	YES	230
17	1.6	1185	1896.0	9.0	7.28	48.7	YES	230
18	1.46	1185	1730.1	8.0	7.25	50.6	YES	230
19	1.58	1185	1872.3	7.0	7.24	54.7	YES	230
20	1.61	1185	1907.9	9.0	7.24	48.0	YES	230
21	1.47	1185	1742.0	9.0	7.21	46.8	YES	230
22	1.2	1185	1422.0	9.0	7.18	44.9	YES	230
23	1.1	1185	1303.5	9.0	7.23	45.2	YES	230
24	1.43	1185	1694.6	9.0	7.30	48.1	YES	230
25	1.51	1185	1789.4	9.0	7.31	48.7	YES	230
26	1.65	1185	1955.3	9.0	7.32	49.6	YES	230
27	1.54	1185	1824.9	9.0	7.30	48.7	YES	230
28	1.54	1185	1824.9	9.0	7.34	49.4	YES	230
29	1.31	1185	1552.4	9.0	7.34	48.1	YES	230
30	1.35	1185	1599.8	8.0	7.30	50.9	YES	230
31	1.39	1185	1647.2	8.0	7.29	51.0	YES	230

³ If Cl₂ at entry point < 0.2 mg/l or CT not me

Revised July 2018