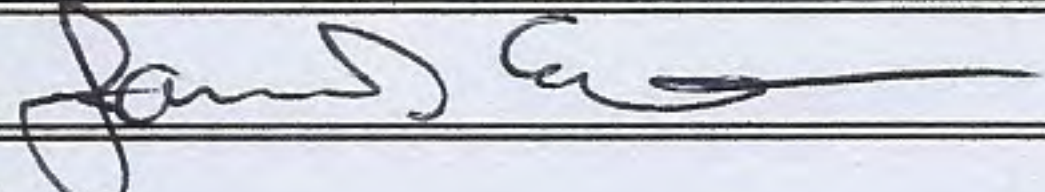


OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: **Lane**
 Month/Year: **23-Jun**

System Name: **Row River Valley Water District** ID#: **41 01515** WTP: **TP - A**

Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the day ¹ [NTU]
1	0.03	0.03	0.03	0.03	0.03	0.03	0.03
2	0.03	0.03	0.03	0.03	0.03	0.03	0.03
3	0.03	0.03	0.03	0.03	0.03	0.03	0.03
4	0.03	0.03	0.03	0.03	0.03	0.03	0.03
5	0.03	0.03	0.03	0.03	0.03	0.03	0.03
6	0.03	0.03	0.03	0.03	0.03	0.03	0.03
7	0.03	0.03	0.03	0.03	0.03	0.03	0.03
8	0.03	0.03	0.03	0.03	0.03	0.03	0.03
9	0.03	0.03	0.03	0.03	0.03	0.03	0.03
10	0.03	0.03	0.03	0.03	0.03	0.03	0.03
11	0.03	0.03	0.03	0.03	0.03	0.03	0.03
12	0.03	0.03	0.03	0.03	0.03	0.03	0.03
13	0.03	0.03	0.03	0.03	0.03	0.03	0.03
14	0.03	0.03	0.03	0.03	0.03	0.03	0.03
15	0.03	0.03	0.03	0.03	0.03	0.03	0.03
16	0.03	0.03	0.03	0.03	0.03	0.03	0.03
17	0.03	0.03	0.03	0.03	0.03	0.03	0.03
18	0.03	0.03	0.03	0.03	0.03	0.03	0.03
19	0.03	0.03	0.03	0.03	0.03	0.03	0.03
20	0.03	0.03	0.03	0.03	0.03	0.03	0.03
21	0.03	0.03	0.03	0.03	0.03	0.03	0.03
22	0.03	0.03	0.03	0.03	0.03	0.03	0.03
23	0.03	0.03	0.03	0.03	0.03	0.03	0.03
24	0.03	0.03	0.03	0.03	0.03	0.03	0.03
25	0.03	0.03	0.03	0.03	0.03	0.03	0.03
26	0.03	0.03	0.03	0.03	0.03	0.03	0.03
27	0.03	0.03	0.03	0.03	0.03	0.03	0.03
28	0.03	0.03	0.03	0.03	0.03	0.03	0.03
29	0.03	0.03	0.03	0.03	0.03	0.03	0.03
30	0.03	0.03	0.03	0.03	0.03	0.03	0.03

Slow Sand/Membrane/DE Filtration/Unfiltered		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings \leq 1 NTU? ²	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl ₂ residual at entry point \geq 0.2 mg/l?
All daily turbidity readings \leq 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No
Notes:	James D Eckstine		
	SIGNATURE: 		Jul-23
	541-946-1655		

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP-: A
 Disinfection *Giardia* Log Inactiv: 1.0

System Name: Row River Vally Water Dis ID#: 41 01515 Month/Year: 23-Jun

	Minimum Cl ₂ Residual at 1st User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/l]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.21	1185	1433.9	14.0	7.14	31.4	YES	300
2	1.23	1185	1457.6	12.0	7.15	36.6	YES	300
3	1.24	1185	1469.4	14.0	7.14	31.5	YES	300
4	1.2	1185	1422.0	15.0	7.14	29.4	YES	300
5	1.15	1185	1362.8	14.0	7.12	31.0	YES	300
6	1.21	1185	1433.9	15.0	7.17	29.7	YES	300
7	1.25	1185	1481.3	15.0	7.25	30.8	YES	300
8	1.24	1185	1469.4	15.0	7.16	29.7	YES	300
9	1.21	1185	1433.9	15.0	7.15	29.5	YES	300
10	1.24	1185	1469.4	15.0	7.14	29.5	YES	300
11	1.22	1185	1445.7	16.0	7.12	27.3	YES	300
12	1.26	1185	1493.1	16.0	7.15	27.7	YES	300
13	1.25	1185	1481.3	16.0	7.18	28.0	YES	300
14	1.24	1185	1469.4	16.0	7.14	27.6	YES	300
15	1.22	1185	1445.7	15.0	7.15	29.5	YES	300
16	1.2	1185	1422.0	17.0	7.12	25.5	YES	300
17	1.19	1185	1410.2	16.0	7.14	27.4	YES	300
18	1.17	1185	1386.5	15.0	7.18	29.7	YES	300
19	1.15	1185	1362.8	13.0	7.21	34.2	YES	300
20	1.34	1185	1587.9	11.0	7.22	40.5	YES	300
21	1.37	1185	1623.5	12.0	7.16	37.3	YES	300
22	1.48	1185	1753.8	14.0	7.22	33.4	YES	300
23	1.49	1185	1765.7	15.0	7.20	31.0	YES	300
24	1.46	1185	1730.1	16.0	7.17	28.6	YES	300
25	1.42	1185	1682.7	16.0	7.18	28.6	YES	300
26	1.4	1185	1659.0	16.0	7.19	28.6	YES	300
27	1.4	1185	1659.0	16.0	7.20	28.7	YES	300
28	1.41	1185	1670.9	16.0	7.18	28.5	YES	300
29	1.39	1185	1647.2	17.0	7.17	26.5	YES	300
30	1.43	1185	1694.6	19.0	7.20	23.6	YES	300

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018