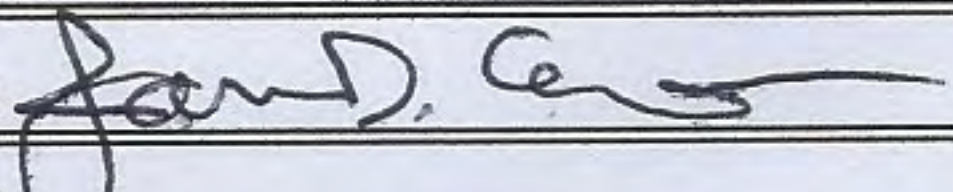


OHA - Drinking Water Services - Surface Water Quality Data Form
Slow Sand, Membrane, Diatomaceous Earth Filtration, or Unfiltered Systems

County: **Lane**
 Month/Year: **23-Sep**
 WTP: TP - **A**

System Name: **Row River Valley Water District ID#: 41 01515**

| Day | 12 AM [NTU] | 4 AM [NTU] | 8 AM [NTU] | NOON [NTU] | 4 PM [NTU] | 8 PM [NTU] | Highest Reading of the day ¹ [NTU] |
|-----|-------------|------------|------------|------------|------------|------------|---|
| 1 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 2 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 3 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 4 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 5 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 6 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 7 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 8 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 9 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 10 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 11 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 12 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 13 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 14 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 15 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 16 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 17 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 18 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 19 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 20 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 21 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 22 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 23 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 24 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 25 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 26 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 27 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 28 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 29 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |
| 30 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 | 0.03 |

| | | | |
|---|--|---|---|
| Slow Sand/Membrane/DE Filtration/Unfiltered | | Monthly Summary (Answer Yes or No) | |
| 95% of daily turbidity readings ≤ 1 NTU? ² | <input checked="" type="radio"/> Yes / <input type="radio"/> No | CT's met everyday? (see back) | All Cl ₂ residual at entry point ≥ 0.2 mg/l? |
| All daily turbidity readings ≤ 5 NTU? | <input checked="" type="radio"/> Yes / <input type="radio"/> No | <input checked="" type="radio"/> Yes / <input type="radio"/> No | <input checked="" type="radio"/> Yes / <input type="radio"/> No |
| Notes: | James D Eckstine | | |
| | SIGNATURE:  | | Oct-23 |
| | 541-946-1655 | | |

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. ² Filtered systems only.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- : A

System Name: Row River Vally Water Dis ID#: 41 01515 Month/Year: 23-Sep

Disinfection *Giardia* Log
Inactiv: 1.0

| | Minimum Cl ₂ Residual at 1st User (C) ³ | Contact Time (T) | Actual CT | Temp | pH | Required CT | CT Met? ³ | Peak Hourly Demand Flow |
|----|---|------------------|-----------|-------|------|-------------|----------------------|-------------------------|
| | [ppm or mg/l] | [minutes] | C X T | [° C] | | formula | Yes / No | [GPM] |
| 1 | 0.85 | 1185 | 1007.3 | 18.0 | 7.15 | 23.1 | YES | 300 |
| 2 | 0.95 | 1185 | 1125.8 | 17.0 | 7.16 | 25.1 | YES | 300 |
| 3 | 0.97 | 1185 | 1149.5 | 18.0 | 7.18 | 23.7 | YES | 300 |
| 4 | 0.98 | 1185 | 1161.3 | 17.0 | 7.17 | 25.3 | YES | 300 |
| 5 | 1.05 | 1185 | 1244.3 | 16.0 | 7.14 | 27.0 | YES | 300 |
| 6 | 1.22 | 1185 | 1445.7 | 16.0 | 7.16 | 27.7 | YES | 300 |
| 7 | 1.29 | 1185 | 1528.7 | 16.0 | 7.18 | 28.2 | YES | 300 |
| 8 | 1.35 | 1185 | 1599.8 | 16.0 | 7.18 | 28.3 | YES | 300 |
| 9 | 1.36 | 1185 | 1611.6 | 16.0 | 7.20 | 28.6 | YES | 300 |
| 10 | 1.4 | 1185 | 1659.0 | 16.0 | 7.21 | 28.8 | YES | 300 |
| 11 | 1.49 | 1185 | 1765.7 | 17.0 | 7.23 | 27.4 | YES | 300 |
| 12 | 1.5 | 1185 | 1777.5 | 16.0 | 7.21 | 29.2 | YES | 300 |
| 13 | 1.51 | 1185 | 1789.4 | 16.0 | 7.21 | 29.2 | YES | 300 |
| 14 | 1.52 | 1185 | 1801.2 | 16.0 | 7.20 | 29.1 | YES | 290 |
| 15 | 1.39 | 1185 | 1647.2 | 13.0 | 7.13 | 34.1 | YES | 290 |
| 16 | 1.37 | 1185 | 1623.5 | 12.0 | 7.14 | 37.1 | YES | 290 |
| 17 | 1.38 | 1185 | 1635.3 | 11.0 | 7.13 | 39.5 | YES | 290 |
| 18 | 1.4 | 1185 | 1659.0 | 13.0 | 7.14 | 34.4 | YES | 290 |
| 19 | 1.35 | 1185 | 1599.8 | 14.0 | 7.15 | 32.0 | YES | 290 |
| 20 | 1.38 | 1185 | 1635.3 | 15.0 | 7.15 | 30.1 | YES | 290 |
| 21 | 1.33 | 1185 | 1576.1 | 15.0 | 7.16 | 30.0 | YES | 290 |
| 22 | 1.38 | 1185 | 1635.3 | 13.0 | 7.16 | 34.5 | YES | 290 |
| 23 | 1.39 | 1185 | 1647.2 | 13.0 | 7.17 | 34.7 | YES | 290 |
| 24 | 1.37 | 1185 | 1623.5 | 13.0 | 7.20 | 35.0 | YES | 290 |
| 25 | 1.33 | 1185 | 1576.1 | 14.0 | 7.18 | 32.3 | YES | 290 |
| 26 | 1.27 | 1185 | 1505.0 | 14.0 | 7.20 | 32.3 | YES | 290 |
| 27 | 1.17 | 1185 | 1386.5 | 14.0 | 7.12 | 31.0 | YES | 290 |
| 28 | 1.25 | 1185 | 1481.3 | 14.0 | 7.19 | 32.1 | YES | 290 |
| 29 | 1.2 | 1185 | 1422.0 | 14.0 | 7.19 | 32.0 | YES | 290 |
| 30 | 1.18 | 1185 | 1398.3 | 14.0 | 7.19 | 31.9 | YES | 290 |

³ If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018