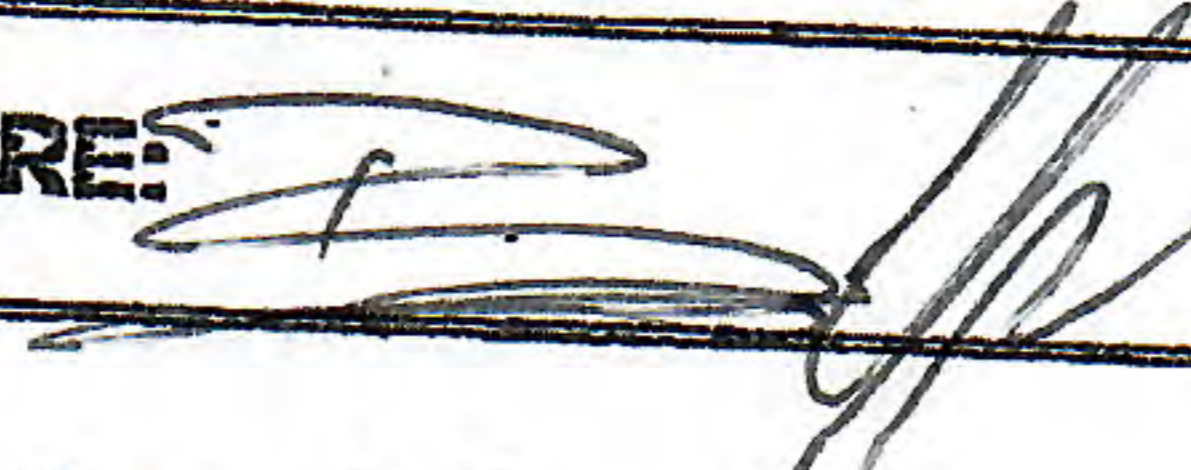


OHA - Drinking Water Services - Turbidity Monitoring Report Form  
 Cartridge or Bag Filtration

County: Tillamook  
 Month/Year: JULY 2022

System Name: Kelly's Brighton Marina ID# 41 90922 WTP ID: B

DAY	PSI Before Filter	PSI After Filter	PSID	PSID When to Change Filter	Daily Turbidity Reading [NTU]	Highest Reading of the Day <sup>1</sup> [NTU]
1	20	12	8			
2	20	12	8	15		.61
3	20	12	8			.59
4	20	12	8			.61
5	20	12	8			.60
6	20	12	8			.59
7	20	12	8			.61
8	20	12	8			.60
9	20	12	8			.60
10	20	12	8			.62
11	20	12	8			.59
12	20	12	8			.61
13	20	12	8			.59
14	20	12	8			.61
15	20	12	8			.59
16	20	12	8			.60
17	20	12	8			.60
18	20	12	8			.62
19	20	12	8			.63
20	20	12	8			.61
21	20	12	8			.62
22	20	12	8			.61
23	20	12	8			.60
24	20	12	8			.59
25	20	12	8			.60
26	20	12	8			.59
27	20	12	8			.61
28	20	12	8			.62
29	20	12	8			.61
30	20	12	8			.60
31	20	12	8			.62

<b>Cartridge Filtration Monthly Summary</b>		<b>Monthly Summary (Answer Yes or No)</b>	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No
Notes: PSI = pounds per square inch PSID = pounds per square inch difference (before filter - after filter) PSID When to Change Filter = Manufacturer's recommendation; may need to look in manual for manufacturer's specifications when to change the filter, at what PSID. <u>9716730694</u>		PRINTED NAME: <u>BRIAN YELLE</u>	DATE: <u>8/3/22</u>
		SIGNATURE: 	CERT #:
		PHONE #: <u>(503) 368-5745</u>	

<sup>1</sup> Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in "Daily Turbidity Reading" Column may not correspond to continuous readings' maximum.  
 PAGE 1 of 2

OHA - Drinking Water Services - Surface Water Quality Data Form

System Name: Kelly's Brighton Marina ID# 41 90922 Tillamook Month/Year: July 2022 WTP - B

Date / Time	Minimum Cl <sub>2</sub> Residual at 1 <sup>st</sup> User (C) <sup>2</sup> [ppm or mg/L]	Contact Time (T) [minutes]	Actual CT CXT	Temp [° C]	pH	Required CT Use tables	CT Met? <sup>2</sup> Yes / No	Peak Hourly Demand Flow [GPM]
1/	1.6							
2/	1.6							2350
3/	1.4							2360
4/	1.6							2930
5/	1.4							3010
6/	1.2							2200
7/	1.2							2290
8/	1.8							2690
9/	1.8							2120
10/	1.8							2325
11/	2.0							2345
12/	1.6							2985
13/	1.4							3045
14/	1.6							2680
15/	1.6							2540
16/	1.6							1840
17/	1.6							1890
18/	1.4							3240
19/	1.4							2200
20/	1.2							1890
21/	1.6							1920
22/	1.2							1920
23/	1.6							2010
24/	1.6							2210
25/	1.6							2640
26/	1.6							1890
27/	1.4							1870
28/	1.6							1880
29/	1.8							1520
30/	2.0							2180
31/	1.6							2630
								2540

*Handwritten note:* Per hand samples

<sup>2</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l, OR CT not met, notify DWS within 24 hours.

Download form at: [public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-cartridge.pdf](http://public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-cartridge.pdf) Revised August 2016

Return by 10<sup>th</sup> of following month by email, fax or mail to:  
[dwp.dmce@state.or.us](mailto:dwp.dmce@state.or.us); Fax 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350