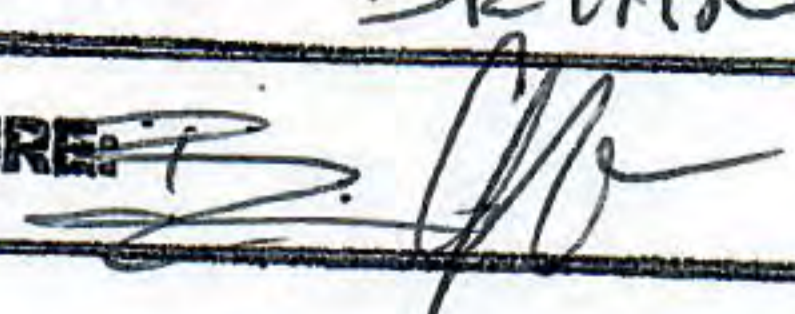


OHA - Drinking Water Services - Turbidity Monitoring Report Form  
 Cartridge or Bag Filtration

County: Tillamook  
 Month/Year: MARCH '23

System Name: Kelly's Brighton Marina ID# 41 90922 WTP ID: B

| DAY | PSI Before Filter | PSI After Filter | PSID | PSID When to Change Filter | Daily Turbidity Reading [NTU] | Highest Reading of the Day <sup>1</sup> [NTU] |
|-----|-------------------|------------------|------|----------------------------|-------------------------------|---|
| 1   | 12                | 10               | 2    |                            |                               | .81   |
| 2   | 12                | 10               | 2    | 15                         |                               | .82   |
| 3   | 12                | 10               | 2    |                            |                               | .82   |
| 4   | 12                | 10               | 2    |                            |                               | .82   |
| 5   | 12                | 10               | 2    |                            |                               | .82   |
| 6   | 12                | 10               | 2    |                            |                               | .81   |
| 7   | 12                | 10               | 2    |                            |                               | .81   |
| 8   | 12                | 10               | 2    |                            |                               | .80   |
| 9   | 12                | 10               | 2    |                            |                               | .81   |
| 10  | 12                | 10               | 2    |                            |                               | .80   |
| 11  | 12                | 10               | 2    |                            |                               | .80   |
| 12  | 12                | 10               | 2    |                            |                               | .81   |
| 13  | 12                | 10               | 2    |                            |                               | .82   |
| 14  | 12                | 10               | 2    |                            |                               | .84   |
| 15  | 12                | 10               | 2    |                            |                               | .84   |
| 16  | 12                | 10               | 2    |                            |                               | .82   |
| 17  | 12                | 10               | 2    |                            |                               | .83   |
| 18  | 12                | 10               | 2    |                            |                               | .81   |
| 19  | 12                | 10               | 2    |                            |                               | .82   |
| 20  | 12                | 10               | 2    |                            |                               | .82   |
| 21  | 12                | 10               | 2    |                            |                               | .81   |
| 22  | 12                | 10               | 2    |                            |                               | .80   |
| 23  | 12                | 10               | 2    |                            |                               | .80   |
| 24  | 12                | 10               | 2    |                            |                               | .81   |
| 25  | 12                | 10               | 2    |                            |                               | .83   |
| 26  | 12                | 10               | 2    |                            |                               | .82   |
| 27  | 12                | 10               | 2    |                            |                               | .82   |
| 28  | 12                | 10               | 2    |                            |                               | .82   |
| 29  | 12                | 10               | 2    |                            |                               | .81   |
| 30  | 12                | 10               | 2    |                            |                               | .81   |
| 31  | 12                | 10               | 2    |                            |                               | .82   |

|   |          |  |   |
|---|----------|--|---|
| <b>Cartridge Filtration Monthly Summary</b>   |          | <b>Monthly Summary (Answer Yes or No)</b>  |   |
| 95% of daily turbidity readings ≤ 1 NTU?  | Yes / No | CT's met everyday? (see back)  | All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l? |
| All daily turbidity readings ≤ 5 NTU?   | Yes / No | Yes / No   | Yes / No  |
| Notes: PSI = pounds per square inch<br>PSID = pounds per square inch difference (before filter - after filter)<br>PSID When to Change Filter = Manufacturer's recommendation; may need to look in manual for manufacturer's specifications when to change the filter, at what PSID. <u>9716730694</u> |          | PRINTED NAME: <u>BRYAN VELLE</u>   | DATE: <u>4-5-23</u>                                     |
|   |          | SIGNATURE:  | CERT #:   |
|   |          | PHONE #: <u>(503) 368-5745</u>   |   |

<sup>1</sup> Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in "Daily Turbidity Reading" Column may not correspond to continuous readings' maximum.  
 PAGE 1 of 2

OHA - Drinking Water Services - Surface Water Quality Data Form

System Name: Kelly's Brighton Marina ID# 41 90922 Tillamook Month/Year: MARCH 23 WTP - B

| Date / Time | Minimum Cl <sub>2</sub> Residual at 1 <sup>st</sup> User (C) <sup>2</sup><br>[ppm or mg/L] | Contact Time (T)<br>[minutes] | Actual CT<br>CXT | Temp<br>[°C] | pH | Required CT<br>Use tables | CT Met? <sup>2</sup><br>Yes/No | Peak Hourly Demand Flow<br>[GPM] |
|-------------|--|-------------------------------|------------------|--------------|----|---------------------------|--------------------------------|----------------------------------|
| 1/          | 2.0  |                               |                  |              |    |                           | Yes                            |                                  |
| 2/          | 2.0  |                               |                  |              |    |                           | Yes                            | 320                              |
| 3/          | 2.0  |                               |                  |              |    |                           | Yes                            | 280                              |
| 4/          | 1.8  |                               |                  |              |    |                           | Yes                            | 180                              |
| 5/          | 1.8  |                               |                  |              |    |                           | Yes                            | 250                              |
| 6/          | 2.0  |                               |                  |              |    |                           | Yes                            | 1230                             |
| 7/          | 2.0  |                               |                  |              |    |                           | Yes                            | 320                              |
| 8/          | 2.0  |                               |                  |              |    |                           | Yes                            | 240                              |
| 9/          | 1.8  |                               |                  |              |    |                           | Yes                            | 320                              |
| 10/         | 1.8  |                               |                  |              |    |                           | Yes                            | 360                              |
| 11/         | 2.0  |                               |                  |              |    |                           | Yes                            | 290                              |
| 12/         | 2.0  |                               |                  |              |    |                           | Yes                            | 790                              |
| 13/         | 1.8  |                               |                  |              |    |                           | Yes                            | 310                              |
| 14/         | 1.6  |                               |                  |              |    |                           | Yes                            | 230                              |
| 15/         | 1.6  |                               |                  |              |    |                           | Yes                            | 240                              |
| 16/         | 1.4  |                               |                  |              |    |                           | Yes                            | 110                              |
| 17/         | 1.6  |                               |                  |              |    |                           | Yes                            | 740                              |
| 18/         | 1.6  |                               |                  |              |    |                           | Yes                            | 560                              |
| 19/         | 1.8  |                               |                  |              |    |                           | Yes                            | 940                              |
| 20/         | 1.8  |                               |                  |              |    |                           | Yes                            | 660                              |
| 21/         | 2.0  |                               |                  |              |    |                           | Yes                            | 340                              |
| 22/         | 2.0  |                               |                  |              |    |                           | Yes                            | 280                              |
| 23/         | 2.1  |                               |                  |              |    |                           | Yes                            | 400                              |
| 24/         | 2.1  |                               |                  |              |    |                           | Yes                            | 380                              |
| 25/         | 2.0  |                               |                  |              |    |                           | Yes                            | 880                              |
| 26/         | 1.8  |                               |                  |              |    |                           | Yes                            | 1190                             |
| 27/         | 1.6  |                               |                  |              |    |                           | Yes                            | 1200                             |
| 28/         | 1.8  |                               |                  |              |    |                           | Yes                            | 990                              |
| 29/         | 2.0  |                               |                  |              |    |                           | Yes                            | 700                              |
| 30/         | 2.1  |                               |                  |              |    |                           | Yes                            | 470                              |
| 31/         | 2.1  |                               |                  |              |    |                           | Yes                            | 1100                             |
|             |  |                               |                  |              |    |                           |                                | 2000                             |

*Handwritten note:* New Van Sensors

<sup>2</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l, OR CT not met, notify DWS within 24 hours. Revised August 2016  
 Download form at: [public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-cartridge.pdf](http://public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-cartridge.pdf)

Return by 10<sup>th</sup> of following month by email, fax or mail to:  
[dwp.dmce@state.or.us](mailto:dwp.dmce@state.or.us); Fax 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350