

OHA - Drinking Water Services - Turbidity Monitoring Report Form

County: Lane

Conventional or Direct Filtration

Month/Year: 9/23

System Name:	OPRD JM Honeyman Memorial State Park	ID#: 41	91044	WTP: TP -	WTP-A		
Day	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day <sup>1</sup> [NTU]
1	-	0.02	-	0.02	0.02	-	0.02
2	-	0.02	-	0.01	0.01	-	0.02
3	0.01	-	-	0.01	0.01	-	0.01
4	0.02	0.01	-	0.03	<del>0.01</del>	<del>0.01</del>	0.03
5	-	-	0.03	0.01	-	-	0.03
6	-	0.02	-	-	0.03	-	0.03
7	-	-	0.02	0.01	-	-	0.02
8	0.01	-	-	-	0.02	0.02	0.02
9	0.01	-	0.04	0.02	0.02	0.02	0.04
10	0.03	0.03	0.04	0.02	0.02	0.02	0.04
11	-	-	0.04	0.03	-	-	0.04
12	0.02	-	-	0.04	-	-	0.04
13	-	0.04	-	-	0.02	-	0.04
14	-	-	0.03	-	-	0.02	0.03
15	-	-	-	0.02	-	-	0.02
16	-	0.02	-	0.01	0.01	-	0.02
17	-	0.01	-	-	0.01	0.02	0.02
18	-	-	0.03	0.02	0.02	-	0.03
19	-	0.02	-	0.02	0.02	-	0.02
20	-	0.02	-	0.02	0.02	-	0.02
21	-	0.02	-	0.02	0.02	-	0.02
22	-	0.02	-	0.02	0.02	-	0.02
23	-	0.02	-	-	0.03	0.03	0.03
24	-	-	0.03	0.02	-	-	0.03
25	-	-	0.02	-	-	0.02	0.02
26	-	-	-	0.03	-	-	0.03
27	0.02	0.02	-	-	0.01	-	0.02
28	-	-	0.01	0.01	-	-	0.01
29	-	-	0.01	-	0.01	0.01	0.01
30	-	-	0.02	0.02	-	-	0.02
31							

Conventional or Direct Filtration		Monthly Summary (Answer Yes or No)	
95% of 4-hour turbidity readings ≤ 0.3 NTU?	Yes / No	CT's met everyday? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
All 4-hour turbidity readings ≤ 1 NTU?	Yes / No	Yes / No	Yes / No
All turbidity readings < IFE <sup>2</sup> triggers	Yes / No		
Notes:		PRINTED NAME: Kati Baker	DATE: 10/1/2023
		SIGNATURE: <i>[Signature]</i>	CERT #:
		PHONE #: ( )	

<sup>1</sup> Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in columns 12 AM through 8 PM may not correspond to continuous readings' maximum. <sup>2</sup> IFE = Individ. Filter Eff. (333-061-0040(1)(d)(B&C))

OHA - Drinking Water Program - Surface Water Quality Data Form

WTP - :

System Name: OPRD JM Honeyman Memorial State Park

ID#: 41

91044

Month/Year: 9/23

Disinfection Giardia Log Inactive:

0.5

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
MM 1 11:50	0.47	480	225.6	18.3	6.26	20	yes	98
MM 2 9:30	0.51		244.8	18.9	6.25	20	yes	
LB 3 2100	0.51		244.8	20	6.30	15	yes	
HE 4 1130	0.51		244.8	19.4	6.17	20	yes	
RW 5 945	.50		240	19.4	6.48	20	yes	
HE 6 1100	0.50		240	18.3	6.39	20	yes	
HE 7 1007	0.49		235.2	19.4	6.19	20	yes	
LB 8 1725	0.46		220.8	20	6.17	15	yes	
MM 9 825	0.45		216	18.9	6.27	20	yes	
10								
RW 11 1630	.55		264	19.4	6.39	20	yes	
RW 12 945	.54		259.2	19.4	6.49	20	yes	
HE 13 1031	0.38		182.4	18.3	6.34	20	yes	
HE 14 1500	0.54		259.2	18.9	6.19	20	yes	
HE 15 1200	0.51		244.8	19.4	6.37	20	yes	
MM 16 9:40	0.49		235.2	18.3	6.25	20	yes	
LB 17 1315	0.37		177.6	19.4	6.11	20	yes	
RW 18 1620	.46		220.8	18.9	6.54	23	yes	
MM 19 9:45	0.39		187.2	17.2	6.43	20	yes	
MM 20 1020	0.45		216	18.3	6.38	20	yes	
MM 21 9:55	0.52		249.6	16.1	6.48	20	yes	
DC 22 1033	0.38		182.4	17.2	6.29	20	yes	
MM 23 1350	0.55		264	17.2	6.16	20	yes	
KB 24 1004	0.57		273.6	18.3	6.30	20	yes	
KB 25 1440	0.65		312	16.7	6.38	20	yes	
AD 26 1519	0.62		292.6	17.8	6.11	20	yes	
MM 27 9:35	0.55		264	16.7	6.63	23	yes	
MM 28 9:25	0.54		259.2	16.7	5.99	20	yes	
HE 29 1020	0.66		316.8	16.7	6.28	20	yes	
MM 30 9:34	0.71		340.8	17.2	6.26	20	yes	
31								

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised July 2018

Return by 10th of following month by email, fax, or mail to:

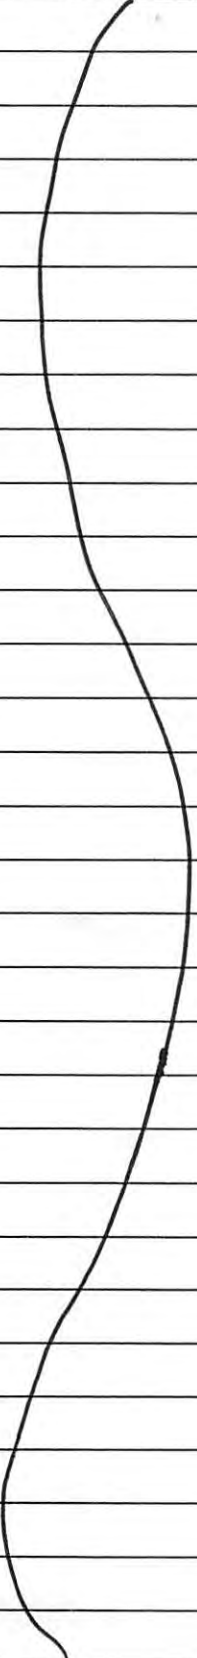
dwp.dmce@state.or.us; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350





Month/Year: September 2023

## Turbidity - Raw and Filter

Date	Filter	Raw	On	Off	
1		0.73		✓	
2		0.71		✓	
3		0.60		✓	
4		0.69		✓	
5		.65		✓	
6		0.54			✓
7		0.59		✓	
8		0.66		✓	
9		0.55		✓	
10					
11		.58		✓	
12		.74			✓
13		0.58			✓
14		0.55			✓
15		0.59		✓	✓
16		0.63			✓
17		0.72		✓	
18		.64		✓	
19		.68			✓
20		0.74		✓	
21		0.56			✓
22		.64			✓
23		.56			✓
24		0.66		✓	
25		0.54			✓
26		0.62			✓
27		0.83			✓
28		1.30		✓	
29		0.61			✓
30		0.70		✓	
31					

## Heceta Head State Park Monthly Turbidity Report, Public Water Supplies

PWS ID # 4191048A  
SYSTEM NAME: Heceta Head State Park  
SOURCE NAME: Well

ADDRESS: 93111 Highway 101 N  
Florence, OR 97439 MONTH/YEAR *Sept*  
PHONE: 541-547-3416 **2023**

DATE/TIME	INITIALS	C/2 RESIDUAL	COMMENTS	METER READING
8:15	1 KE	0.8 cxt	1.7 gal	38017
7:45	2 KE	0.7 cxt	1.7 gal	38018
	3			
	4			
	5 BE	0.5 cxt	mix ch 2.4g	38055
8:00	6 KE	0.4 cxt		38061
7:50	7 KE	0.1 cxt		38065
14:00	8 KE	0.1 cxt		38065
12:00	9 KE	0.4 cxt		<del>38067</del> 38067
	10			
	11			
	12			
	13			
	14 BE	0.3 cxt	2g ch	38104
	15			
11:00	16 KE	0.1 cxt	1.9 cl <sub>2</sub>	38127
9:00	17 KE	0.5 cxt	1.9 cl <sub>2</sub>	38141
	18 BE	0.4 cxt	1.9 ch	38146
	19 BE	0.4 cxt	1.9	38147
8:30 am	20 JS	0.3 cxt	3g mix ch	38153
8:45 am	21 BM	0.5	3g mix cl <sub>2</sub>	38180
	22			
	23			
	24			
	25			
9	26 Deba	1.5 cxt		38185
	27			
	28			
	29			
730	30 Deba	1.5 cxt	1.5 pump house	38189
	31			

Total: \_\_\_\_\_  
Write off when not producing water.

Total -- # days=monthly average

\_\_\_\_\_ = \_\_\_\_\_

**WELL LOG: MONTHLY WATER REPORT**

MONTH:

Sept

YEAR:

2023

DATE	INT.	TIME	CL2	SITE	MIX	Meter	NOTES	Full to empty	Bar length	
1	Deb	936				132951	12.09	20 <sup>2+</sup>	19 1/2 hr	1 @ 3 1/2
2	Deb	944				133025	12.01	10 <sup>1-</sup>	19 1/2 hr	2 @ 3
3	Deb	1057	1	sp		133134	12.48	5 <sup>3</sup> Run	19 1/2	3
4	Deb	116				133233	12.83	5 <sup>1 1/2</sup> Run	19 1/2	3
5	Deb	1535	1	sp		133269	12.04	5 <sup>1</sup>	19 1/2	3 1/2
6	Be	930	1	shop	5	133342	12.13	5 mix clz		
7								10 <sup>2+</sup>		
8									19	
9	Deb	915	1	sp		133562	12.18	40 <sup>2+</sup>		3 hr
10	Deb	8	1	sp		133632	12.23	41 <sup>+</sup>		
11	Deb	1026	1	sp		133725	12.03	40 <sup>-</sup>	19	3
12	Deb	1 pm				133844	12.94	35 <sup>2</sup> Run	19	3
13	Be	1000	1	35		133885	12.27	35 <sup>+</sup>		
14	Be	900	1	shop		133946	12.06	35	19	3
15	Deb	119				134054	12.60	30 <sup>3-</sup> Run	19 1/2	3
16	Deb	851				134097	12.18	30 <sup>2-</sup>	19	3 1/2
17	Deb	931	1	sp		134099	12.14	30 <sup>1+</sup>	19	2 1/2
18	Deb	9				134249	12.37	30 <sup>2+</sup>	19	3 1/2
19	Deb	210	1	sp		134322	12.30	25 <sup>2+</sup>		3 1/2
20	Be					134396	12.24	25 <sup>+</sup>		
21	Be	800	02	1		134469	12.21	25		
22	Deb	238				134625	13.40	20 <sup>1+</sup>	Alarm Light on	Stopped before Pull
23	Deb	738	1	sp		134625	12.12	20 <sup>1+</sup>		Power out 5 pm on at 335 AM
24	Deb	930				134702	12.01	20 <sup>+</sup> Run		camp fuel 2 blamps runs
25	Deb	1010	1	2		134787	12.19		20	2 1/2 " "
26	Be	850	1	3		134850	12.19	15 <sup>12</sup>		
27	Be	1000				134900	12.20	15		
28	Be		1	2		134992	12.28	10 <sup>13</sup>		
29	Deb	938				135063	12.07	10 <sup>2</sup>	19	2 1/2 twice 10710
30	Deb	822				135135	12.12	10 <sup>1-</sup>	19	2 1/2 7200
31						063 72				