

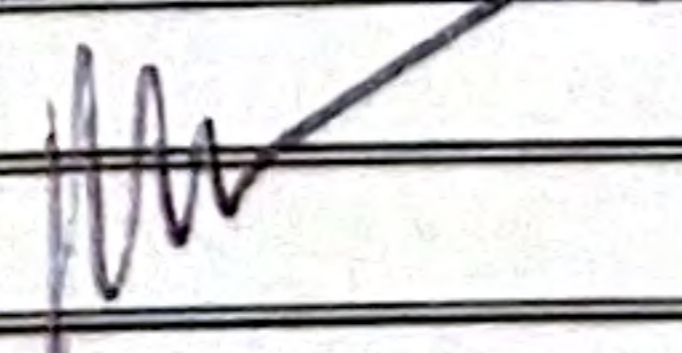
OHA - Drinking Water Services - Surface Water Quality Data Form

County: jackson

Cartridge or Bag Filtration

Month/Year: Jan-25

| Day | PSI Before Filter | PSI After Filter | PSID | PSID When to Change Filter | Daily Turbidity Reading [NTU] | Highest Reading of the day ¹ [NTU] |
|-----|-------------------|------------------|------|----------------------------|-------------------------------|---|
| 1 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 2 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 3 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 4 | 10.00 | 10.00 | 0.00 | 30.00 | 0.14 | 0.14 |
| 5 | 10.00 | 10.00 | 0.00 | 30.00 | 0.11 | 0.11 |
| 6 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 7 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 8 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 9 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 10 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 11 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 12 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 13 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 14 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 15 | 10.00 | 10.00 | 0.00 | 30.00 | 0.11 | 0.11 |
| 16 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 17 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 18 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 19 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 20 | 10.00 | 10.00 | 0.00 | 30.00 | 0.11 | 0.11 |
| 21 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 22 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 23 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 24 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 25 | 10.00 | 10.00 | 0.00 | 30.00 | 0.11 | 0.11 |
| 26 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 27 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 28 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |
| 29 | 10.00 | 10.00 | 0.00 | 30.00 | 0.13 | 0.13 |
| 30 | 10.00 | 10.00 | 0.00 | 30.00 | 0.11 | 0.11 |
| 31 | 10.00 | 10.00 | 0.00 | 30.00 | 0.12 | 0.12 |

| | | | | | |
|---|--|----------------------------|--|--|----------------------------|
| <p>0.13</p> <p>95% of daily turbidity readings ≤ 1 NTU?</p> <p>All daily turbidity readings ≤ 5 NTU?</p> | | <p>Yes / No</p> <p>Yes</p> | <p>Monthly Summary (Answer Yes or No)</p> <p>CT's met everyday? (see back)</p> <p>All Cl2 residual at entry point ≥ 0.2 mg/l?</p> | | <p>Yes / No</p> <p>Yes</p> |
| <p>Notes: PSI = pounds per square inch</p> <p>PSID = pounds per square inch difference (before filter - after filter)</p> <p>PSID When to Change Filter = look in manual for manufacturer's specifications when to change the filter, at what PSID.</p> | | | <p>Mark Cleaner</p> <p>SIGNATURE: </p> <p>530383.4088</p> | | |
| | | | <p>2/10/2025</p> <p>CERT #:</p> | | |

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in Daily Turbidity Reading column may not correspond to continuous readings' maximum.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP- :

| | | | |
|------------------------|---------------|--------------------|-------------------------------------|
| System Name: Callahans | ID#: 41 91551 | Month/Year: Jan-25 | Disinfection Giardia Log Inactiv: 1 |
|------------------------|---------------|--------------------|-------------------------------------|

| Date / Time | Minimum Cl ₂ Residual at 1st User (C) ² [ppm or mg/L] | Contact Time (T) [minutes] | Actual CT C X T | Temp [° C] | pH | Required CT formula | CT Met? ² Yes / No | Peak Hourly Demand Flow [GPM] |
|-------------|--|-------------------------------|--------------------|---------------|------|------------------------|----------------------------------|----------------------------------|
| 1 | 2.1 | 25.2 | 52.9 | 7.9 | 7.00 | 50.2 | YES | |
| 2 | 2.2 | 25.2 | 55.4 | 7.5 | 7.00 | 52.1 | YES | |
| 3 | 2.2 | 25.2 | 55.4 | 7.9 | 7.10 | 52.6 | YES | |
| 4 | 2.4 | 25.2 | 60.5 | 7.9 | 7.20 | 55.8 | YES | |
| 5 | 2.5 | 25.2 | 63.0 | 8.0 | 7.50 | 62.5 | YES | |
| 6 | 2.5 | 25.2 | 63.0 | 8.0 | 7.50 | 62.5 | YES | |
| 7 | 2.5 | 25.2 | 63.0 | 7.6 | 7.00 | 53.6 | YES | |
| 8 | 2.6 | 25.2 | 65.5 | 7.6 | 6.90 | 52.3 | YES | |
| 9 | 2.5 | 25.2 | 63.0 | 7.8 | 7.00 | 52.9 | YES | |
| 10 | 2.6 | 25.2 | 65.5 | 7.8 | 7.20 | 57.5 | YES | |
| 11 | 2.7 | 25.2 | 68.0 | 7.8 | 7.20 | 58.2 | YES | |
| 12 | 2.6 | 25.2 | 65.5 | 7.8 | 7.00 | 53.5 | YES | |
| 13 | 2.7 | 25.2 | 68.0 | 7.9 | 7.10 | 55.7 | YES | |
| 14 | 2.8 | 25.2 | 70.6 | 8.0 | 6.90 | 52.1 | YES | |
| 15 | 2.5 | 25.2 | 63.0 | 7.9 | 6.90 | 50.7 | YES | |
| 16 | 2.6 | 25.2 | 65.5 | 7.9 | 6.90 | 51.3 | YES | |
| 17 | 2.5 | 25.2 | 63.0 | 7.9 | 6.80 | 48.9 | YES | |
| 18 | 2.5 | 25.2 | 63.0 | 8.0 | 6.90 | 50.4 | YES | |
| 19 | 2.6 | 25.2 | 65.5 | 7.9 | 7.00 | 53.1 | YES | |
| 20 | 2.4 | 25.2 | 60.5 | 7.9 | 6.90 | 50.1 | YES | |
| 21 | 2.5 | 25.2 | 63.0 | 7.8 | 7.00 | 52.9 | YES | |
| 22 | 2.6 | 25.2 | 65.5 | 8.0 | 7.10 | 54.7 | YES | |
| 23 | 2.5 | 25.2 | 63.0 | 8.1 | 7.20 | 55.7 | YES | |
| 24 | 2.7 | 25.2 | 68.0 | 7.9 | 7.00 | 53.8 | YES | |
| 25 | 2.6 | 25.2 | 65.5 | 7.8 | 6.90 | 51.6 | YES | |
| 26 | 2.5 | 25.2 | 63.0 | 7.9 | 7.00 | 52.5 | YES | |
| 27 | 2.6 | 25.2 | 65.5 | 7.8 | 7.10 | 55.5 | YES | |
| 28 | 2.5 | 25.2 | 63.0 | 7.9 | 6.90 | 50.7 | YES | |
| 29 | 2.6 | 25.2 | 65.5 | 8.0 | 7.00 | 52.8 | YES | |
| 30 | 2.5 | 25.2 | 63.0 | 7.9 | 7.10 | 54.5 | YES | |
| 31 | 2.6 | 25.2 | 65.5 | 7.8 | 6.90 | 51.6 | YES | |

² If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Revised November 2022

Return by 10th of following month by email, fax, or mail to:

dwp_dmce@oha.oregon.gov; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350