

OHA - Drinking Water Services - Surface Water Quality Data Form

County: Lincoln

Month/Year: Nov-23

Cartridge or Bag Filtration

System Name: Alsea River Rv Park		ID#: 41	92043	WTP ID:	TP-	A
Day	PSI Before Filter	PSI After Filter	PSID	PSID When to Change Filter	Daily Turbidity Reading [NTU]	Highest Reading of the day ¹ [NTU]
1					0.00	
2					0.00	
3					0.00	
4					0.00	
5					0.00	
6					0.00	
7					0.00	
8					0.00	
9					0.00	
10					0.00	
11					0.00	
12					0.00	
13					0.00	
14					0.00	
15					0.00	
16					0.00	
17					0.00	
18					0.00	
19					0.00	
20					0.00	
21					0.00	
22					0.00	
23					0.00	
24					0.00	
25					0.00	
26						
27					0.00	
28					0.00	
29					0.00	
30					0.00	
31						

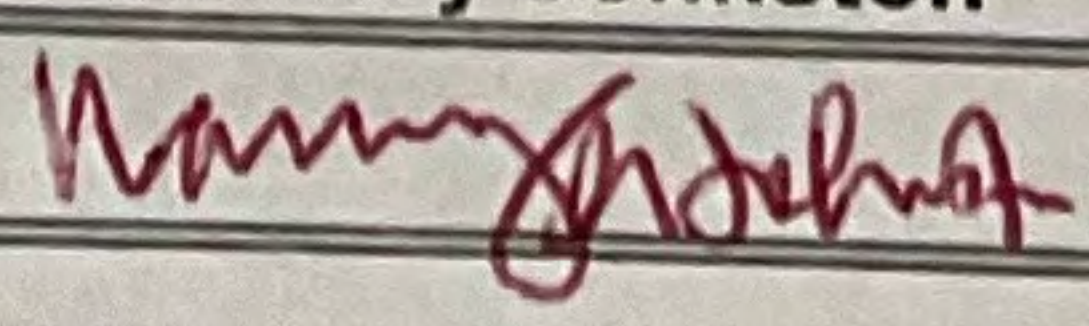
Cartridge & Bag Filtration		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	Yes	CT's met everyday? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	Yes	Yes	Yes

Notes: PSI = pounds per square inch

PSID = pounds per square inch difference (before filter - after filter)

PSID When to Change Filter = look in manual for manufacturer's specifications when to change the filter, at what PSID.

PRINTED NAME: Nancy Johnston

SIGNATURE: 

DATE: 12/10/23

phone - 541-563-3401

CERT #:

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in Daily Turbidity Reading column may not correspond to continuous readings' maximum.

OHA - Drinking Water Services - Surface Water Quality Data Form

WTP - : A

System Name:	Alsea River Rv Park	ID#: 41	92043	Month/Year:	Nov-23	Disinfection Giardia Log Inactiv:	1
--------------	---------------------	---------	-------	-------------	--------	---	---

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ²	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ²	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	0.74	104	77.0	15.4	6.00	17.7	YES	
2	0.74	104	77.0	15.4	6.10	18.4	YES	
3	0.75	104	78.0	15.3	6.10	18.5	YES	
4	0.74	104	77.0	15.3	6.10	18.5	YES	
5	0.76	104	79.0	15.2	6.00	18.0	YES	
6	0.76	104	79.0	15.2	6.00	18.0	YES	
7	0.76	104	79.0	15.1	6.10	18.8	YES	
8	0.77	104	80.1	15.0	6.00	18.2	YES	
9	0.78	104	81.1	15.0	6.00	18.3	YES	
10	0.78	104	81.1	14.9	6.00	18.4	YES	
11	0.78	104	81.1	14.9	6.00	18.4	YES	
12	0.79	104	82.2	14.9	6.00	18.4	YES	
13	0.78	104	81.1	15.0	6.10	19.0	YES	
14	0.78	104	81.1	14.9	6.10	19.1	YES	
15	0.79	104	82.2	14.8	6.10	19.2	YES	
16	0.79	104	82.2	14.9	6.10	19.1	YES	
17	0.8	104	83.2	15.0	6.20	19.7	YES	
18	0.81	104	84.2	15.0	6.10	19.0	YES	
19	0.8	104	83.2	14.9	6.10	19.1	YES	
20	0.82	104	85.3	14.9	6.10	19.2	YES	
21	0.79	104	82.2	14.9	6.10	19.1	YES	
22	0.79	104	82.2	14.8	6.00	18.5	YES	
23	0.78	104	81.1	14.9	6.10	19.1	YES	
24	0.8	104	83.2	14.9	6.10	19.1	YES	
25	0.81	104	84.2	14.8	6.10	19.3	YES	
26	0.82	104	85.3	14.9	6.10	19.2	YES	
27	0.84	104	87.4	15.0	6.10	19.1	YES	
28	0.82	104	85.3	15.0	6.10	19.1	YES	
29	0.84	104	87.4	14.9	6.10	19.2	YES	
30	0.82	104	85.3	14.9	6.10	19.2	YES	
31								

² If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.

Return by 10th of following month by email, fax, or mail to:

Revised November 2022

dwp.dmce@oha.oregon.gov; 971-673-0694; or Drinking Water Services, PO Box 14350, Portland, OR 97293-0350