

OHA - Drinking Water Services - Surface Water Quality Data Form

County: Lincoln

Cartridge or Bag Filtration

Month/Year: 2-2021


System Name:	Mad Dog Country Tavern			ID#:	41 92052	WTP ID:	TP- A
Day	PSI Before Filter	PSI After Filter	PSID	PSID When to Change Filter	Daily Turbidity Reading [NTU]	Highest Reading of the day ¹ [NTU]	
1					20		
2					21		
3					23		
4					20		
5					21		
6					22		
7					23		
8					26		
9					23		
10					21		
11					21		
12					23		
13					25		
14					22		
15					21		
16					24		
17					25		
18					22		
19					21		
20					22		
21					24		
22					24		
23					22		
24					23		
25					29		
26					25		
27					27		
28					30		
29							
30							
31							

Cartridge & Bag Filtration		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	CT's met everyday? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	<input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No

Notes: PSI = pounds per square inch
 PSID = pounds per square inch difference (before filter - after filter)
 PSID When to Change Filter = look in manual for manufacturer's specifications when to change the filter, at what PSID.

PRINTED NAME: T.J. WISKY
 SIGNATURE: *T.J. Wisky*
 PHONE #: (541) 265-5761
 DATE: 2-28-21
 CERT #:

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in Daily Turbidity Reading column may not correspond to continuous readings' maximum.

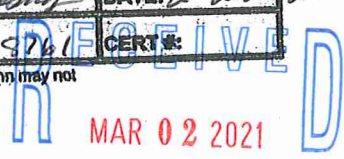

COPY

OHA - Drinking Water Services - Surface Water Quality Data Form

System Name: Mad Dog Country Tavern	ID#: 41	92052	Month/Year: February 2021	A	Disinfection Giardia Log Inactiv:	1
--	----------------	--------------	----------------------------------	----------	--	---

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ²	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ²	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[°C]		formula	Yes / No	[GPM]
1	2.20	71	220	12.7	72	40	yes	5
2	2.20	71	220	12.4	72	40	yes	5
3	2.20	71	220	11.6	72	43	yes	5
4	2.20	71	220	11.4	72	43	yes	5
5	2.20	71	220	11.6	72	43	yes	5
6	2.20	71	220	12.0	72	40	yes	5
7	2.20	71	220	11.4	72	43	yes	5
8	2.20	71	220	11.0	72	43	yes	5
9	2.20	71	220	11.1	72	43	yes	5
10	2.20	71	220	10.1	72	46	yes	5
11	2.20	71	220	11.8	72	43	yes	5
12	2.20	71	220	11.1	72	43	yes	5
13	2.20	71	220	11.0	72	43	yes	5
14	2.20	71	220	11.5	72	43	yes	5
15	2.20	71	220	12.0	72	40	yes	5
16	2.20	71	220	12.2	72	40	yes	5
17	2.20	71	220	12.2	72	40	yes	5
18	2.20	71	220	12.2	72	40	yes	5
19	2.20	71	220	12.3	72	40	yes	5
20	2.20	71	220	12.1	72	40	yes	5
21	2.20	71	220	11.9	72	43	yes	5
22	2.20	71	220	11.6	72	43	yes	5
23	2.10	71	210	11.9	72	43	yes	5
24	2.04	71	204	11.7	72	43	yes	5
25	1.84	71	184	12.7	72	39	yes	5
26	1.76	71	176	12.8	72	38	yes	5
27	2.17	71	217	12.1	72	40	yes	5
28	2.04	71	204	12.0	72	40	yes	5
29								
30								
31								

² If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.